

Illinois Tollway Standard Drawing Revisions

Section B		Drainage Structures, Curbs & Gutter	
Standard	Modification Summary	Effective: 03-01-2022	
B1-10	Gutter and Curb Details		
Sheet 1	Added details for Gutter, Type G-2N and Gutter, Type G-3N. Moved Concrete Curb, Type C and overlay details to Sheet 2.		
Sheet 2	Revised the Concrete Gutter Overlay detail and notes. Moved transition details and Gutter Plan to Sheet 3.		
Sheet 3	Added Plan for Gutter, Type G-2N and Gutter, Type G-3N.		
B6-09	Headwall Type III 18"-24"-30"-36"-42"-48"-54"-60" for 1:3, 1:4, 1:6 and 1:10 Slopes		
Sheet 3	Revised Bar No. 1 thickness from 3/4" to 1".		
B7-05	Catch Basin, Type B		
Sheet 1	Revised the minimum structure height from 5'-2" to 6'-1".		
Sheet 1	Added Note 4 for markings.		
Sheet 1	Added Note 5 for minimum 9" of monolithic reinforced concrete above pipe penetration holes >15".		
B8-08	Catch Basins Type G and Type G-3 Modified, Frames and Grates		
Sheet 1	Added Note 15 for markings.		
Sheet 1	Added Note 16 for minimum 9" of monolithic reinforced concrete above pipe penetration holes >15".		
Sheet 2	Added Note 10 for markings.		
Sheet 2	Added Note 11 for minimum 9" of monolithic reinforced concrete above pipe penetration holes >15".		
Sheet 3	Added Note 10 for markings.		
Sheet 3	Added Note 11 for minimum 9" of monolithic reinforced concrete above pipe penetration holes >15".		
Sheet 3	Revised Note 7 for a 54" maximum outfall pipe size for Catch Basin Type G-5.		
B10-13	Sloped Headwalls Type III Details		
Sheet 1	Revised Note 3 for welded wire reinforcement.		
B13-06	End Treatment with Pipe Runners, for Single Culverts 0° Skew, 1:4 Slope, H ≤ 4'		
Sheet 1	Revised the headwall thickness from 8" to 12".		
Sheet 2	Revised the Table of Reinforcing Steel for V(E) bars.		
B14-06	End Treatment with Pipe Runners, for Single and Multiple Culverts 0° Skew, 1:4 Slope, H ≤ 8'		
Sheet 1	Revised the headwall thickness from 8" to 12".		
Sheet 2	Revised the Table of Dimensions for dimension WW for 8' S x 8' H.		
Sheet 2	Revised the Table of Reinforcement Bars for V(E) bars.		
B15-05	End Treatment with Pipe Runners, for Single Culverts 15° Skew, 1:4 Slope, H ≤ 4'		
Sheet 1	Revised the headwall thickness from 8" to 12".		

Illinois Tollway Standard Drawing Revisions

Section B		Drainage Structures, Curbs & Gutter	
Standard	Modification Summary	Effective: 03-01-2022	
B16-06	End Treatment with Pipe Runners, for Single and Multiple Culverts 15° Skew, 1:4 Slope, H ≤ 8'		
Sheet 1	Revised the headwall thickness from 8" to 12".		
Sheet 2	Revised the Table of Dimensions for dimension WW for 7' S x 7' H and 8' S x 8' H.		
Sheet 2	Revised the Table of Reinforcement Bars for V(E) and V1(E) bars.		
Sheet 2	Revised the reinforcement detail for V(E) and V1(E) bars.		
B17-05	End Treatment with Pipe Runners, for Single Culverts 30° Skew, 1:4 Slope, H ≤ 4'		
Sheet 1	Revised the headwall thickness from 8" to 12".		
Sheet 2	Revised the Table of Reinforcement Bars for V(E) and V1(E) bars.		
Sheet 2	Revised the reinforcement detail for V(E) and V1(E) bars.		
B18-06	End Treatment with Pipe Runners, for Single and Multiple Culverts 30° Skew, 1:4 Slope, H ≤ 8' and S = Varies		
Sheet 1	Revised the headwall thickness from 8" to 12".		
Sheet 2	Revised the Table of Dimensions for dimension WW for 7' S x 7' H and 8' S x 8' H.		
Sheet 2	Revised the Table of Reinforcement Bars for V(E) and V1(E) bars.		
Sheet 2	Revised the reinforcement detail for V(E) and V1(E) bars.		
B20-06	Headwall Type IV Concrete Box Culvert ≤ 84" Width		
Sheet 1	Revised the #4 v(E) bar spacing in Section A-A.		
Sheet 1	Revised the number of reinforcement bars required in one wingwall 1:4 slope for 48", 54" and 60" culvert height.		
Sheet 1	Revised "headwall" to "wingwall" in the Removal Detail.		
B21-04	Grating for Headwall Type IV Box Culvert ≤ 84" Width		
Sheet 1	Revised Bar No. 1 thickness from 3/4" to 1".		
B22-05	Headwall Type IV Metal Pipe & Pipe-Arch Culverts		
Sheet 1	Revised the headwall thickness from 8" to 12".		
Sheet 1	Revised the #4 v(E) bar spacing in Section A-A.		
Sheet 1	Revised the number of v1(E) bars in Section B-B.		
Sheet 1	Revised the number of reinforcement bars required in one wingwall 1:4 slope.		
B23-04	Grating for Headwall Type IV Pipe and Pipe-Arch Culverts		
Sheet 1	Revised Bar No. 1 thickness from 3/4" to 1".		
B30-03	Headwalls Type I and II		
Sheet 1	Revised v(E) bars to t(E) bars for the apron in the Plan.		
Sheet 1	Revised the headwall thickness from 6" to 8".		
Sheet 1	Revised the dimensions in the Plan and the Table of Dimensions.		
Sheet 2	Revised the dimensions in the Plan and the Table of Dimensions.		

Illinois Tollway Standard Drawing Revisions


Section B	Drainage Structures, Curbs & Gutter	
Standard	Modification Summary	Effective: 03-01-2022
B32-01	Flat Slab Top 4'-5'-6'-7'-8'-9' Diameter	
Sheet 2	Revised the slab thickness for the 6' diameter top slab from 8" to 9".	
Sheet 2	Revised the rebar spacing for the 6' diameter top slab from 5" to 6".	
Sheet 3	Revised the rebar spacing for the 8' diameter top slab from 6" to 7".	
Sheet 3	Revised the rebar spacing for the 9' diameter top slab from 5-1/2 " to 6".	




New Sheet




Retired Standard

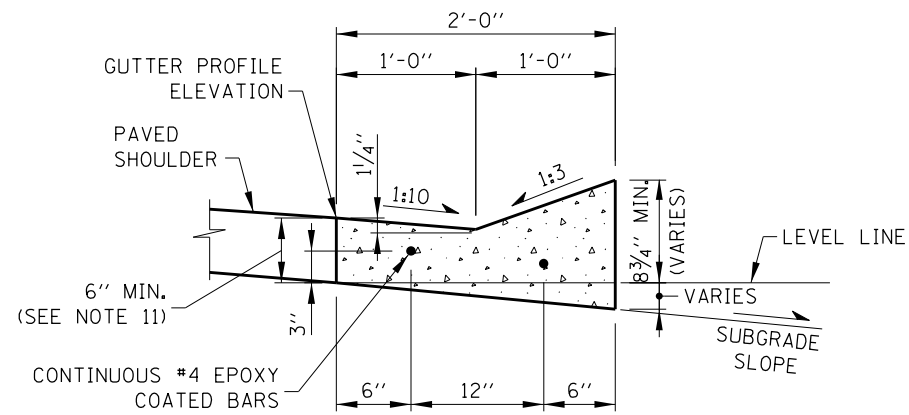


GUTTER, TYPE G-2

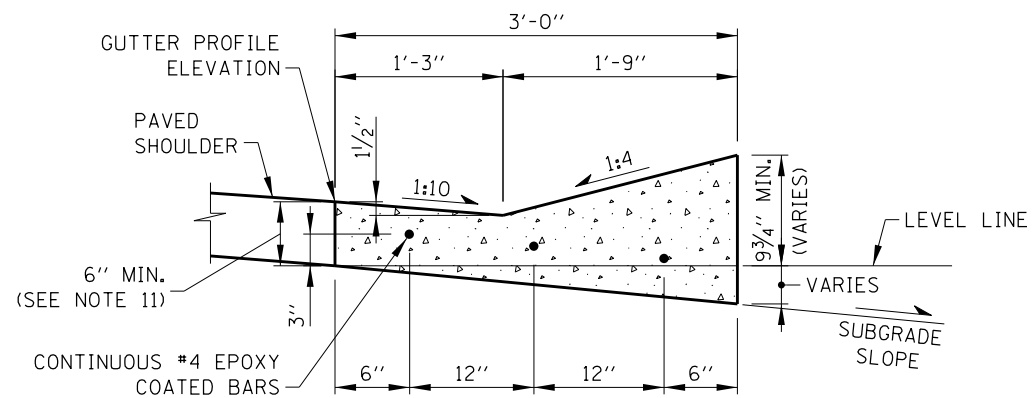


GUTTER, TYPE G-3

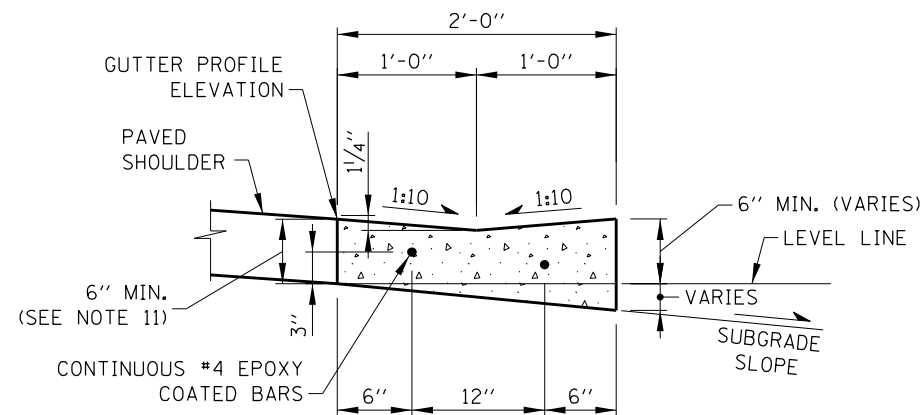


GUTTER, TYPE G-2, MODIFIED

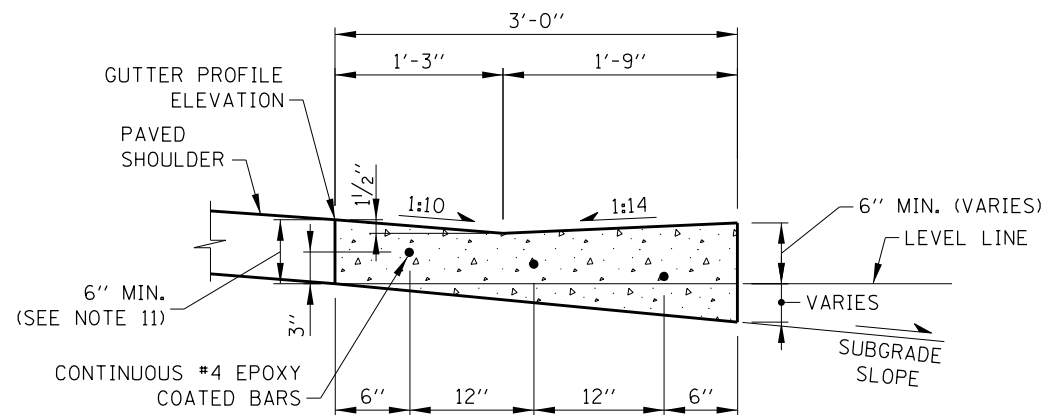

GUTTER, TYPE G-3, MODIFIED

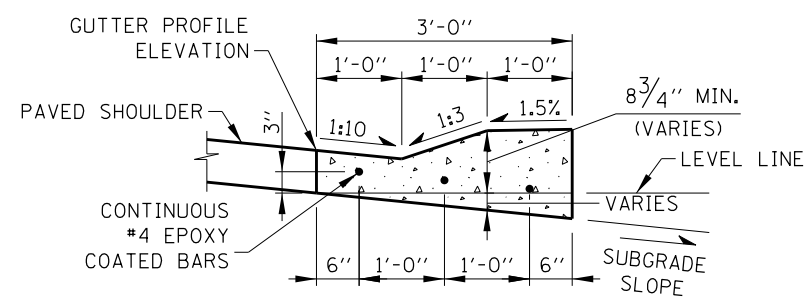

GUTTER, TYPE G-2N

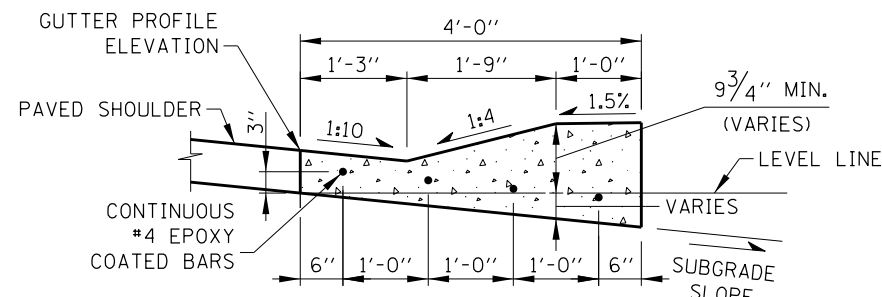

GUTTER, TYPE G-3N

NOTES:

- FOR CONCRETE CURB, TYPE C TRANSITIONS, THE LEADING ENDS OF CURB IN THE DIRECTION OF TRAFFIC SHALL BEGIN FLUSH WITH ADJACENT PAVEMENT OR SHOULDER SURFACE AND TRANSITION TO FULL HEIGHT AT THE RATE OF ONE INCH VERTICAL TO ONE FOOT HORIZONTAL.
- | GUTTER TRANSITION DETAILS | STANDARD DRAWING |
|--|------------------|
| TRAFFIC BARRIER TERMINAL TYPE T1 (SPECIAL) | B-28 |
| TRAFFIC BARRIER TERMINAL TYPE T1-A (SPECIAL) | B-29 |
| TRAFFIC BARRIER TERMINAL TYPE T10 | B-2 |
| TRAFFIC BARRIER TERMINAL TYPE T6 | B-3 |
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
 - REINFORCEMENT STEEL SHALL BE ACCURATELY PLACED AND FIRMLY HELD IN THE POSITION SPECIFIED USING EPOXY COATED STEEL CHAIRS. CHAIR SPACING SHALL NOT EXCEED 4'-0".
 - GUTTER REINFORCEMENT SHALL BE PLACED 3" ABOVE BOTTOM OF GUTTER FOLLOWING THE SUBGRADE SLOPE.
 - OTHER GUTTER AND CURB TRANSITION DETAILS WILL BE SHOWN ON THE PLANS.
 - CONTINUOUS #4 BARS SHALL BE LAPPED A MINIMUM OF 1'-1".
 - FOR CONCRETE GUTTER OVERLAYS, CRACK CONTROL JOINTS SHALL BE PLACED AT LOCATIONS OF UNDERLYING JOINTS AND WORKING CRACKS.
 - GUTTER CRACK CONTROL JOINTS TO ALIGN IN PROLONGATION WITH PCC SHOULDER JOINTS WHERE EXISTING. CRACK CONTROL JOINTS SHALL BE SEALED FULL DEPTH AND WIDTH IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.
 - EXPANSION JOINTS SHALL BE CONSTRUCTED IN GUTTER AT MAXIMUM JOINT SPACING OF 60'-0", SEE EXPANSION JOINT DETAIL ON SHEET 2 OF THIS STANDARD.
 - GUTTER DEPTH SHALL MATCH PAVED SHOULDER DEPTH.
 - THIS WORK WILL BE MEASURED FOR PAYMENT IN FEET ALONG THE FLOW LINE OF THE GUTTER, WHICH MEASUREMENT WILL INCLUDE DRAINAGE CASTINGS INCORPORATED WITHIN GUTTER.




GUTTER AND CURB DETAILS


STANDARD B1-10

DATE	REVISIONS
3-01-2022	ADDED NEW G-2N & G-3N DETAILS
	REVISED CONC. GUTTER OVERLAY
3-01-2019	NOTED GUTTER DEPTH SHALL MATCH PAVED SHOULDER DEPTH
3-01-2018	REVISED NOTE
3-31-2016	REVISED NOTE
3-11-2015	REVISED DETAIL DESCRIPTIONS



APPROVED: *Paul Kovacs*
 CHIEF ENGINEERING OFFICER DATE 2-7-2012

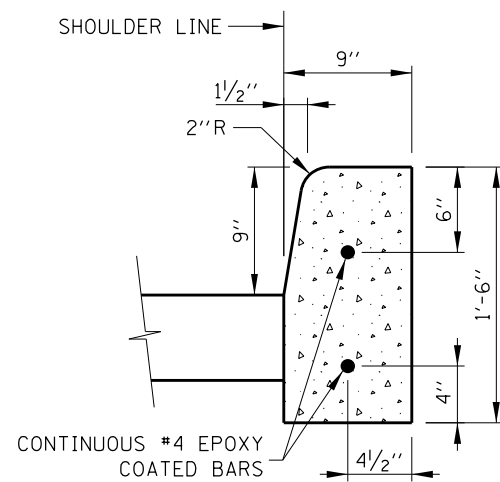

ADJACENT TO FLEXIBLE PAVEMENT

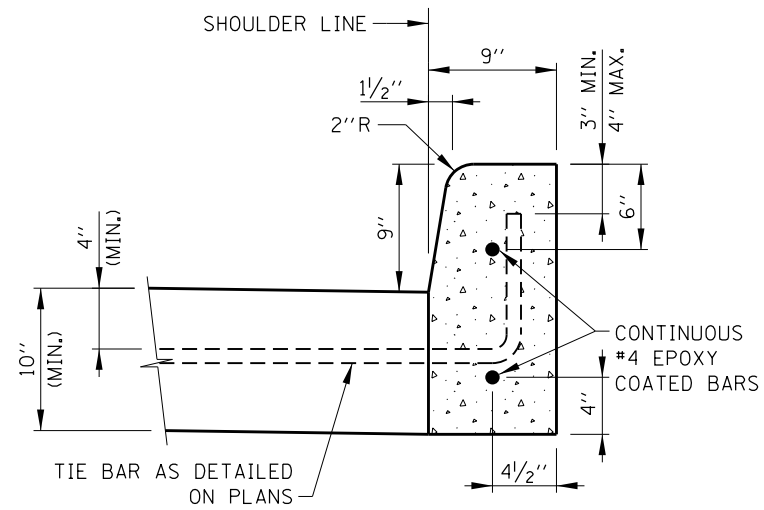

ADJACENT TO PCC PAVEMENT

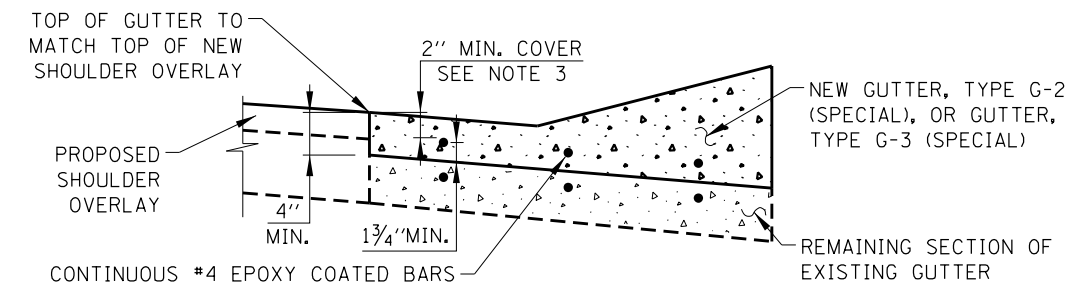
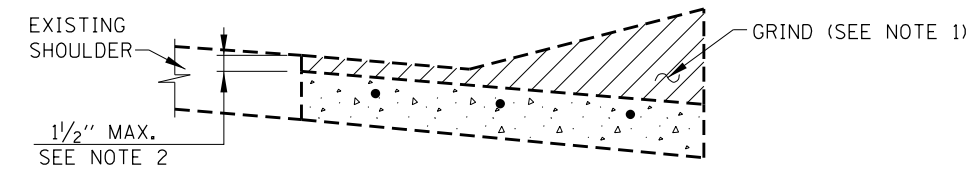


CONCRETE GUTTER OVERLAY







CONCRETE CURB, TYPE C
(RAMP TOLL PLAZAS ONLY)

NOTES:


1. GUTTER REMOVAL TO BE PAID AS GUTTER REMOVAL (SPECIAL).
2. IF CONCRETE GUTTER GRINDING IS EXPECTED TO BE GREATER THAN 1 1/2", THEN EXISTING CONCRETE GUTTER SHALL BE REMOVED AND REPLACED.
3. MINIMUM COVER SHALL BE 2" ON ALL TYPE G-2 AND TYPE G-3 GUTTERS.
4. SEE SHEET 1 OF THIS SERIES FOR ADDITIONAL NOTES.

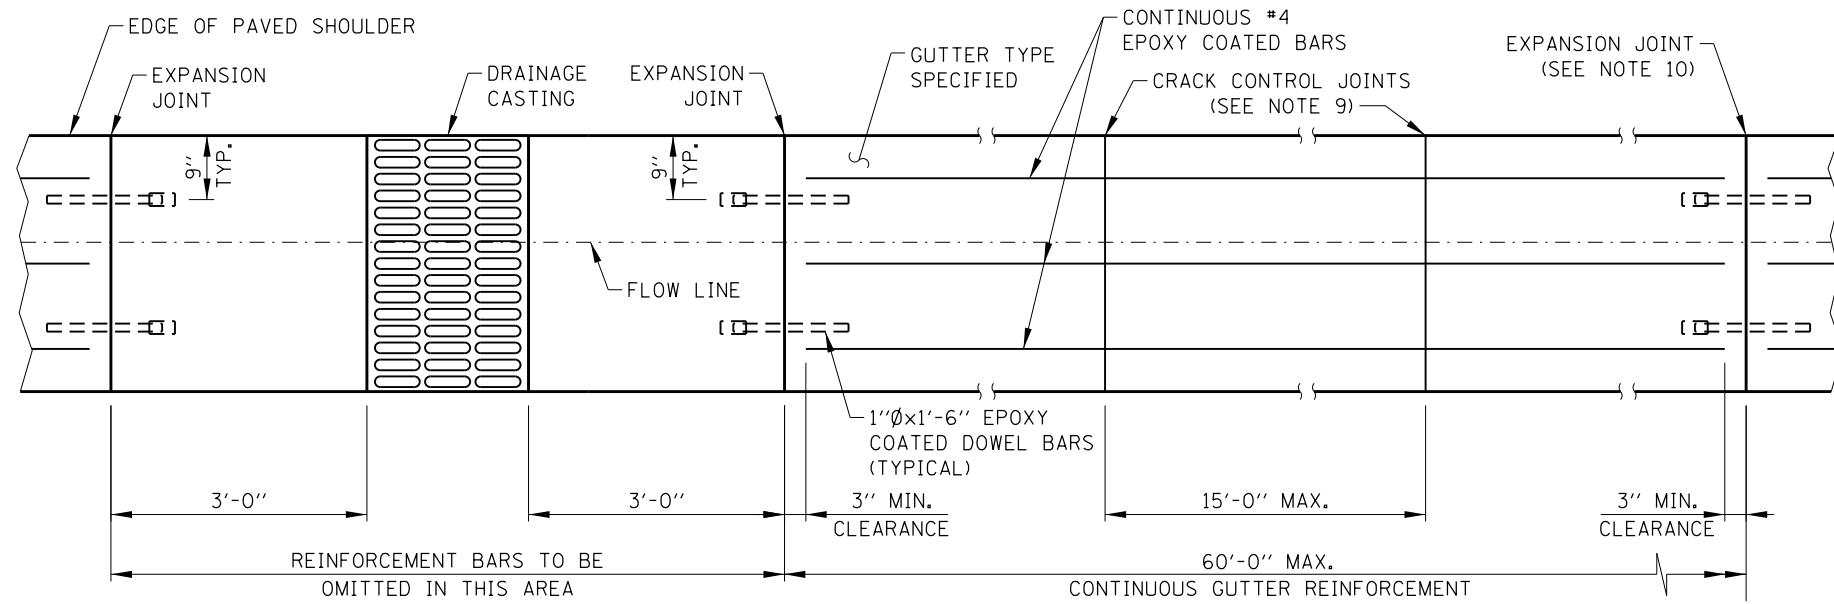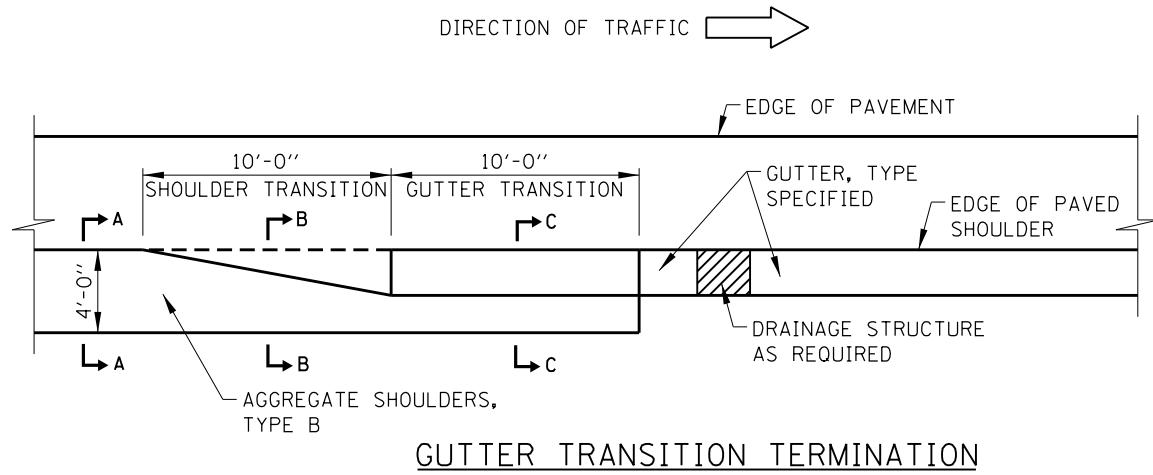

PLAN
GUTTER, TYPE G-2 OR GUTTER, TYPE G-3
(GUTTER, TYPE G-3 SHOWN)

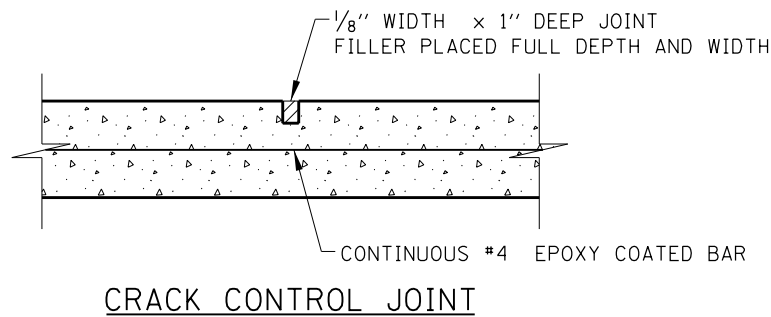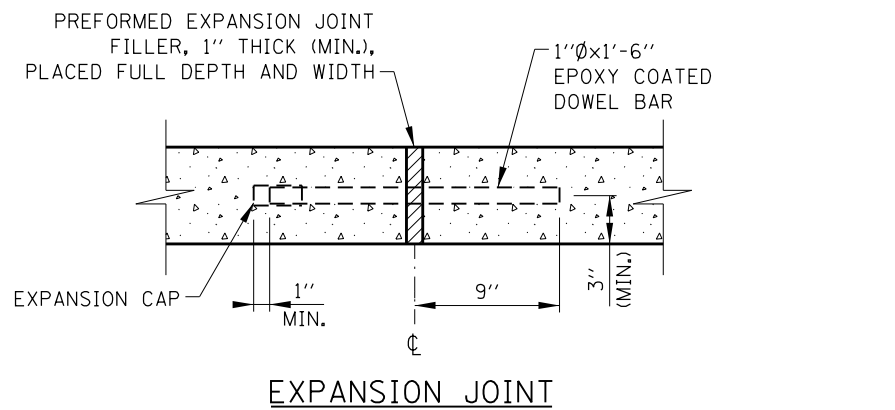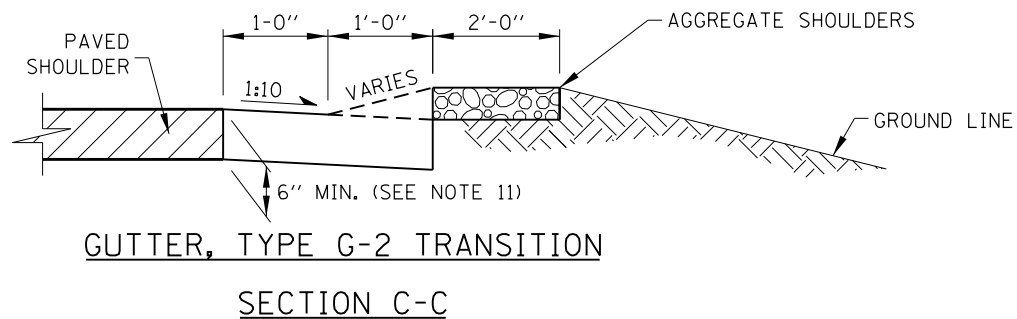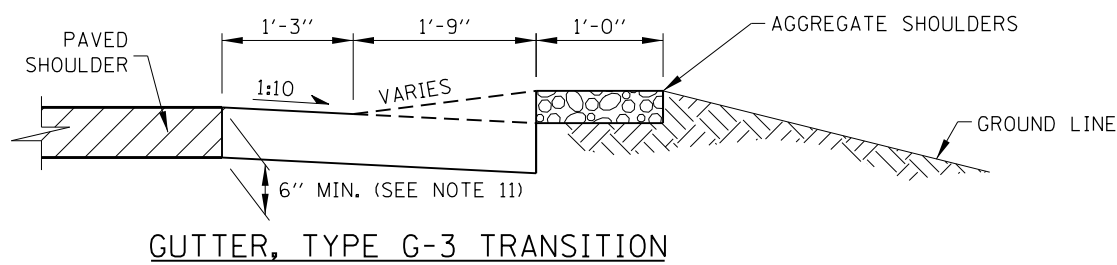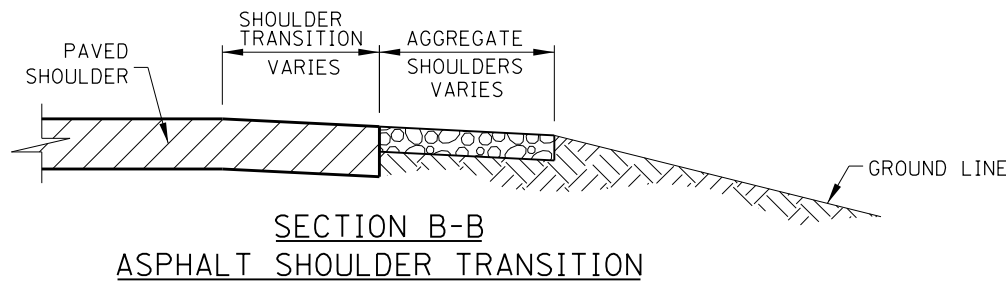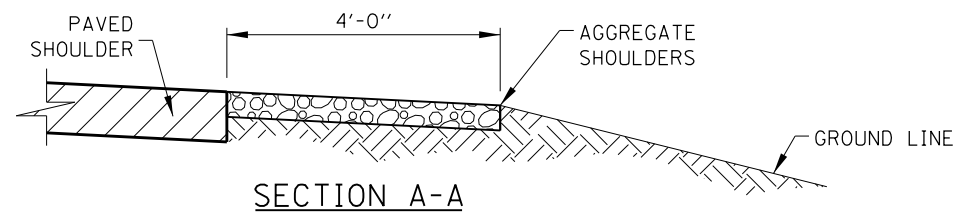

EXPANSION-CRACK CONTROL JOINTS
GUTTER, TYPE SPECIFIED

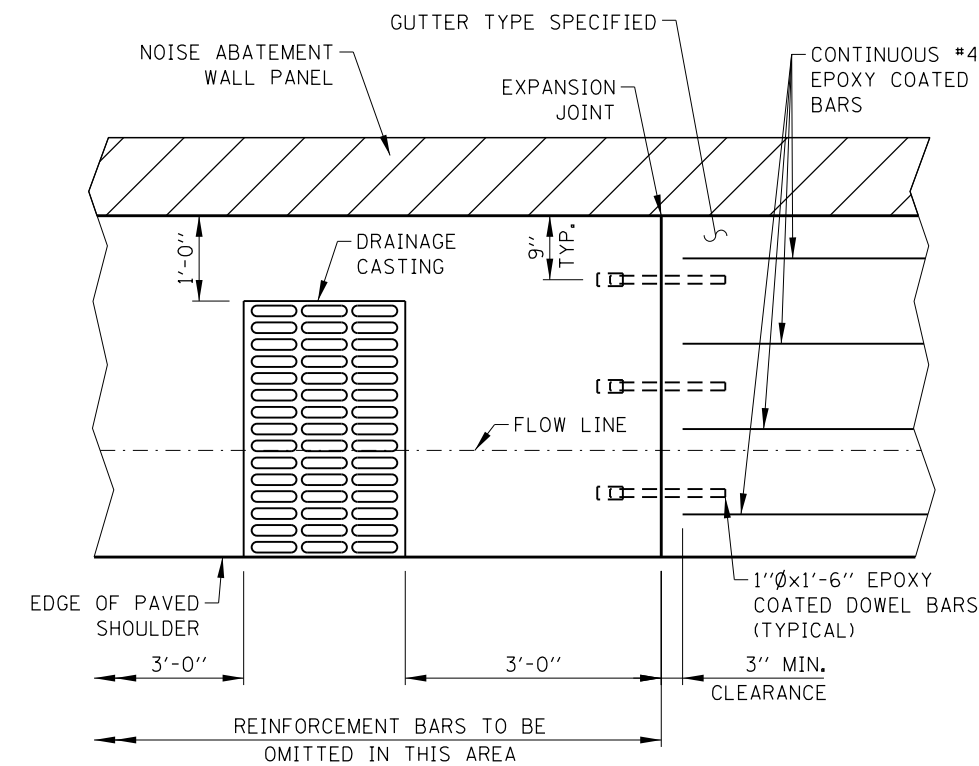

PLAN
GUTTER, TYPE G-2N OR GUTTER, TYPE G-3N
(GUTTER, TYPE G-3N SHOWN)


APPROVED *Paul Kovacs* CHIEF ENGINEERING OFFICER DATE 2-7-2012

NOTE:
 SEE SHEET 1 OF THIS SERIES FOR NOTES.


SHEET 3 OF 3

GUTTER AND CURB DETAILS

STANDARD B1-10

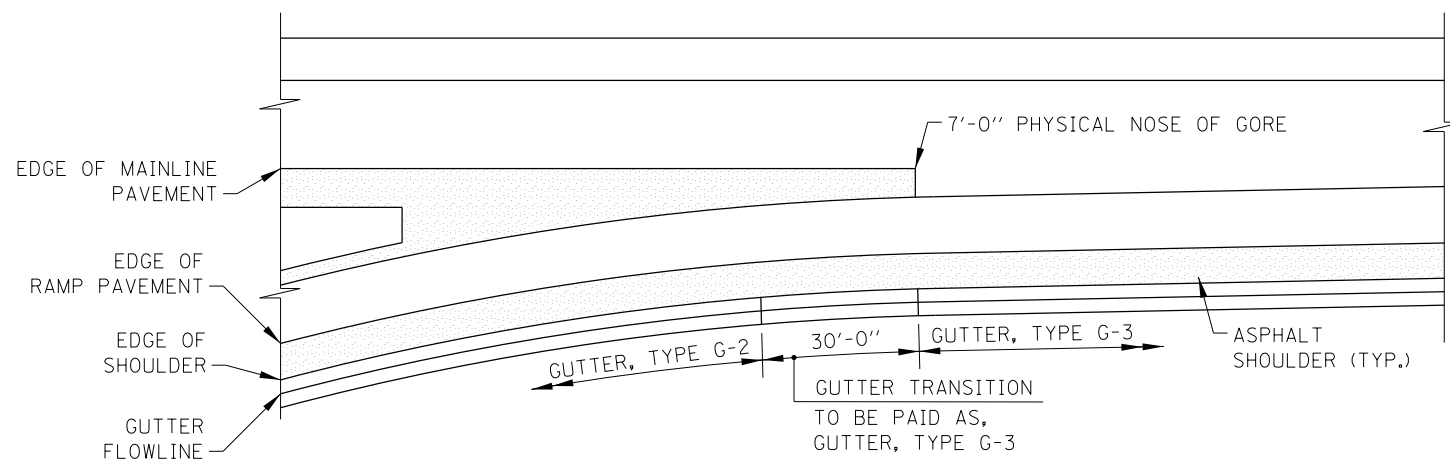

GUTTER TRANSITION AT ENTRANCE RAMP TERMINALS

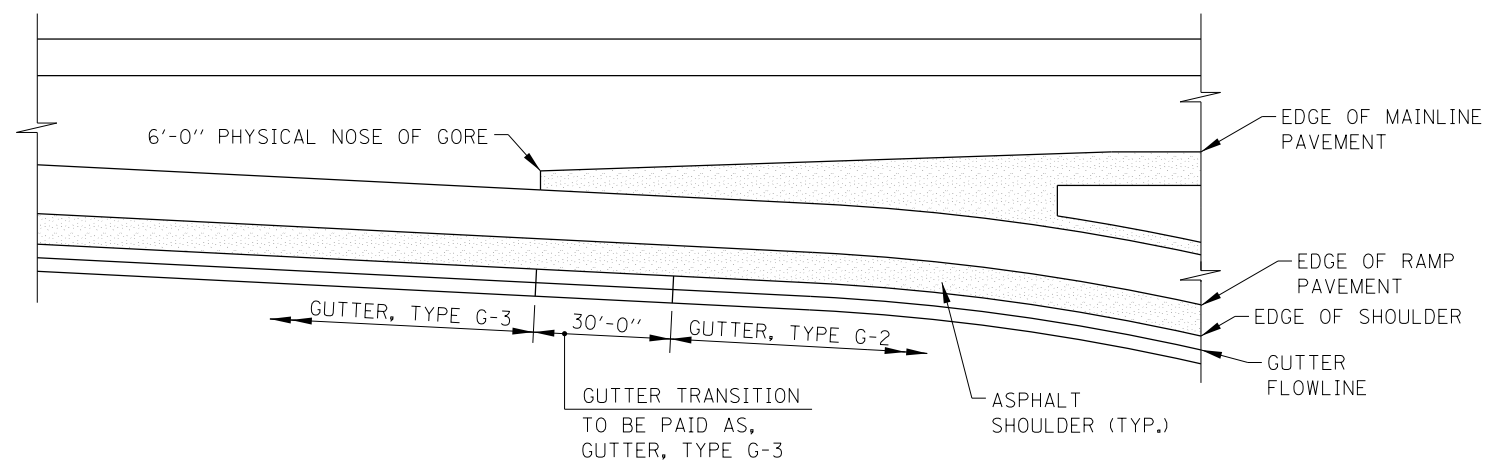

GUTTER TRANSITION AT EXIT RAMP TERMINALS

GUTTER TRANSITION NOTES:

1. PROVIDE 1" EXPANSION JOINT WITH PREFORMED JOINT FILLER BETWEEN TRANSITION SECTION AND WINGWALL, BARRIER, OR PARAPET.
2. SEE STANDARD B3 FOR GUTTER TRANSITIONS AT BRIDGE APPROACH.
3. ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
4. REINFORCEMENT BARS SHALL BE ACCURATELY PLACED AND FIRMLY HELD AT THE POSITION USING EPOXY COATED CHAIRS. CHAIR SPACING SHALL NOT EXCEED 4'-0".
5. GUTTER REINFORCEMENT BARS SHALL BE PLACED 3" ABOVE BOTTOM OF GUTTER FOLLOWING SUBGRADE SLOPE.
6. CONTINUOUS #4 BARS SHALL BE LAPPED A MINIMUM OF 1'-1".
7. GUTTER DEPTH SHALL MATCH PAVED SHOULDER DEPTH.





DATE	REVISIONS
3-01-2019	NOTED GUTTER DEPTH SHALL MATCH PAVED SHOULDER DEPTH
3-01-2018	REVISED NOTE
3-31-2016	REVISED G-2 GUTTER SHAPE
3-11-2015	REVISED DETAIL DESCRIPTIONS AND NOTES.
2-07-2012	REVISED NOTES.
3-01-2010	RELOCATED GUTTER TRANSITION DETAIL TO STANDARD B2B, REVISED NOTES
	REVISED TYPE G-3, G-2 GUTTER AT BRIDGE APPROACH.





TYPE G-2 AND G-3
GUTTER TRANSITIONS

STANDARD B2-08

APPROVED *Paul Kovacs* CHIEF ENGINEERING OFFICER DATE 2-7-2012

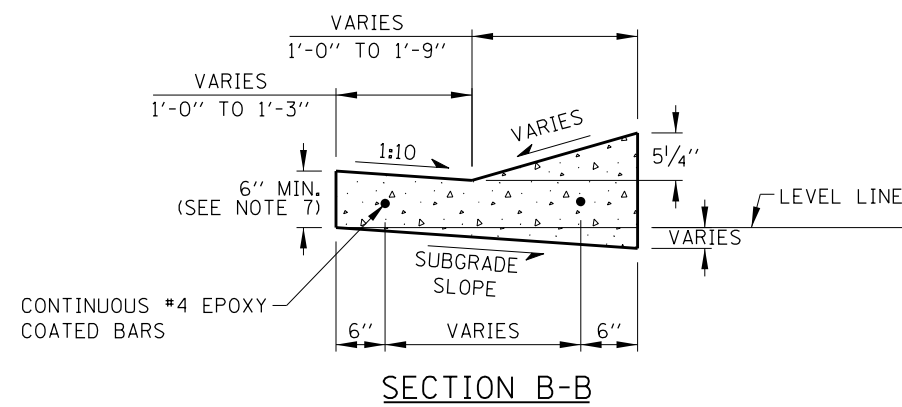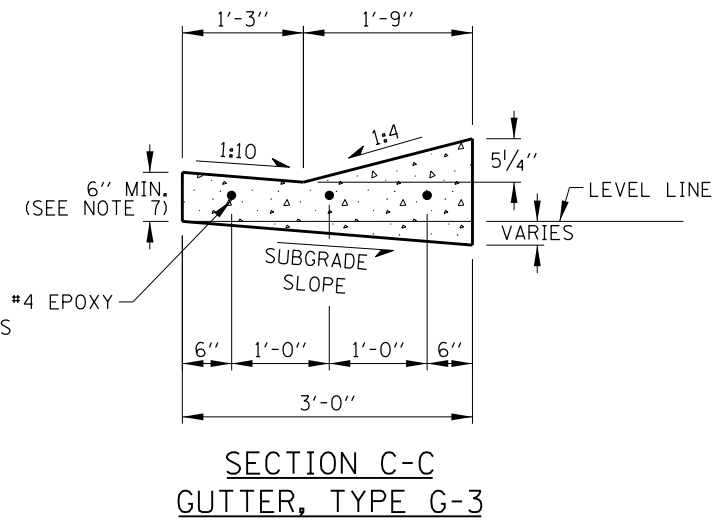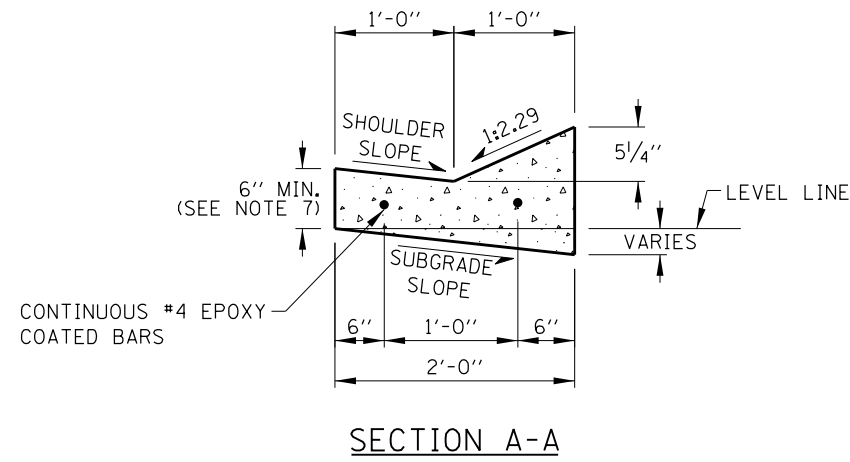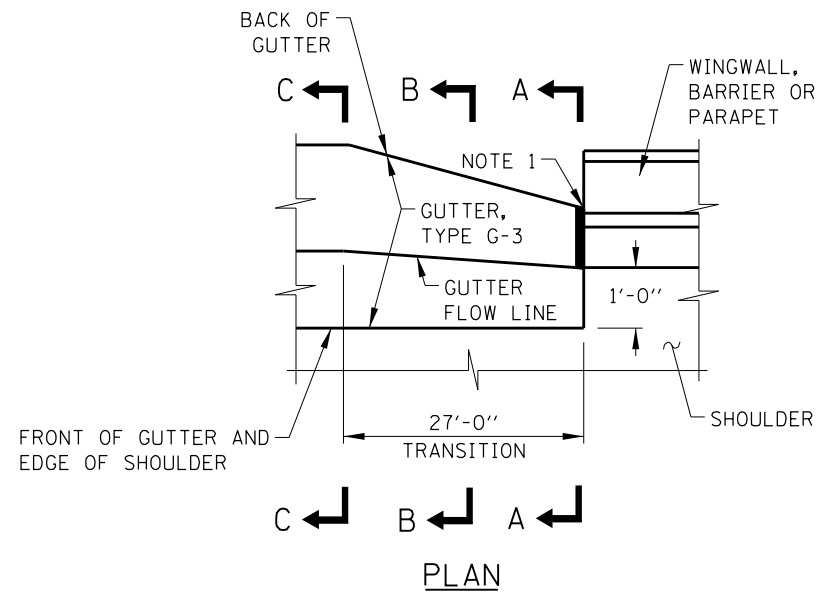



GUTTER, TYPE G-3 TRANSITION AT BRIDGE DEPARTURE

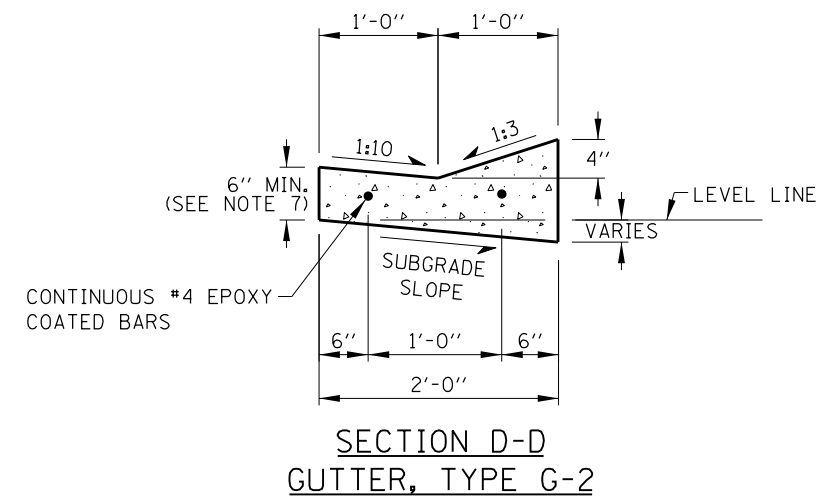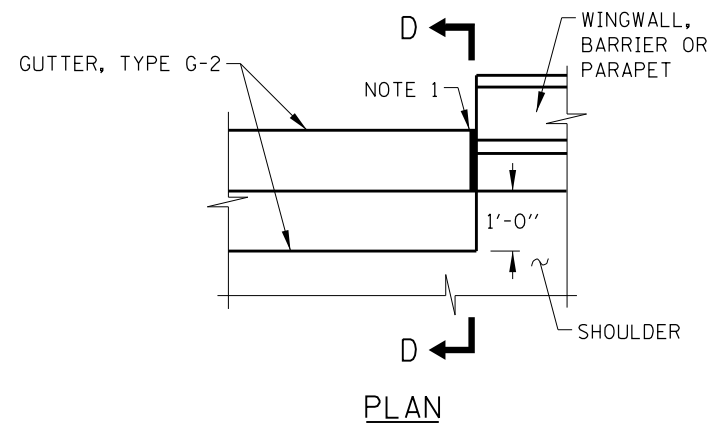

GUTTER, TYPE G-2 AT BRIDGE DEPARTURE

NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES.



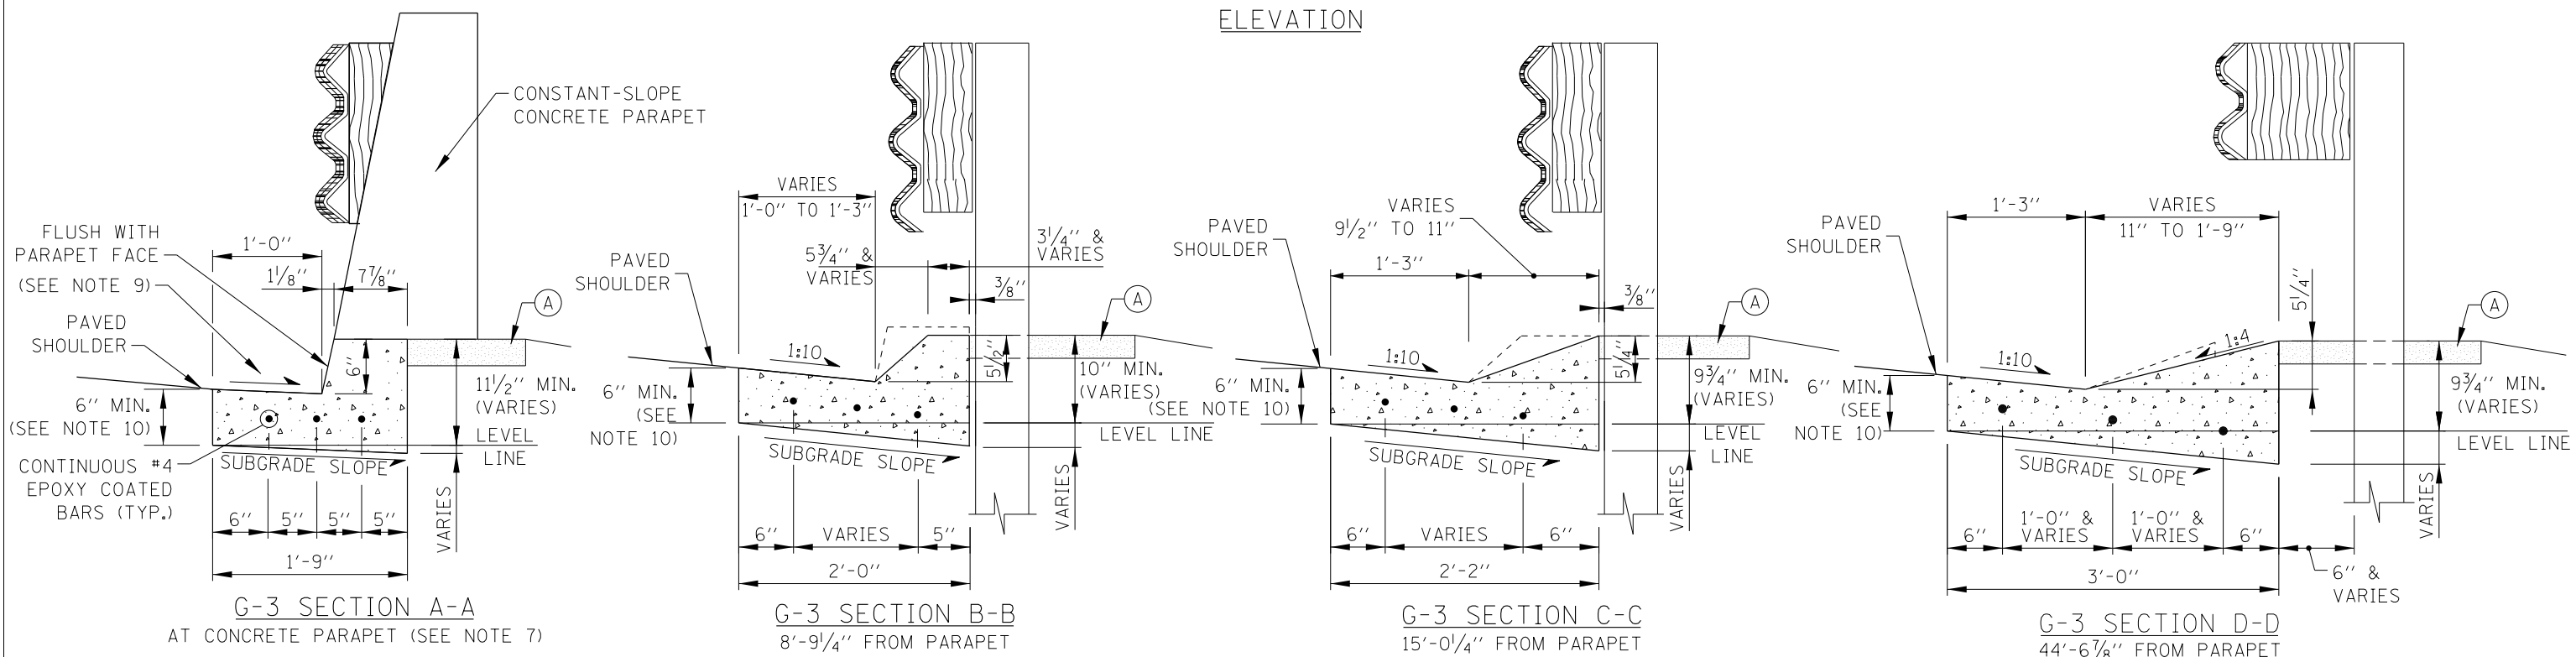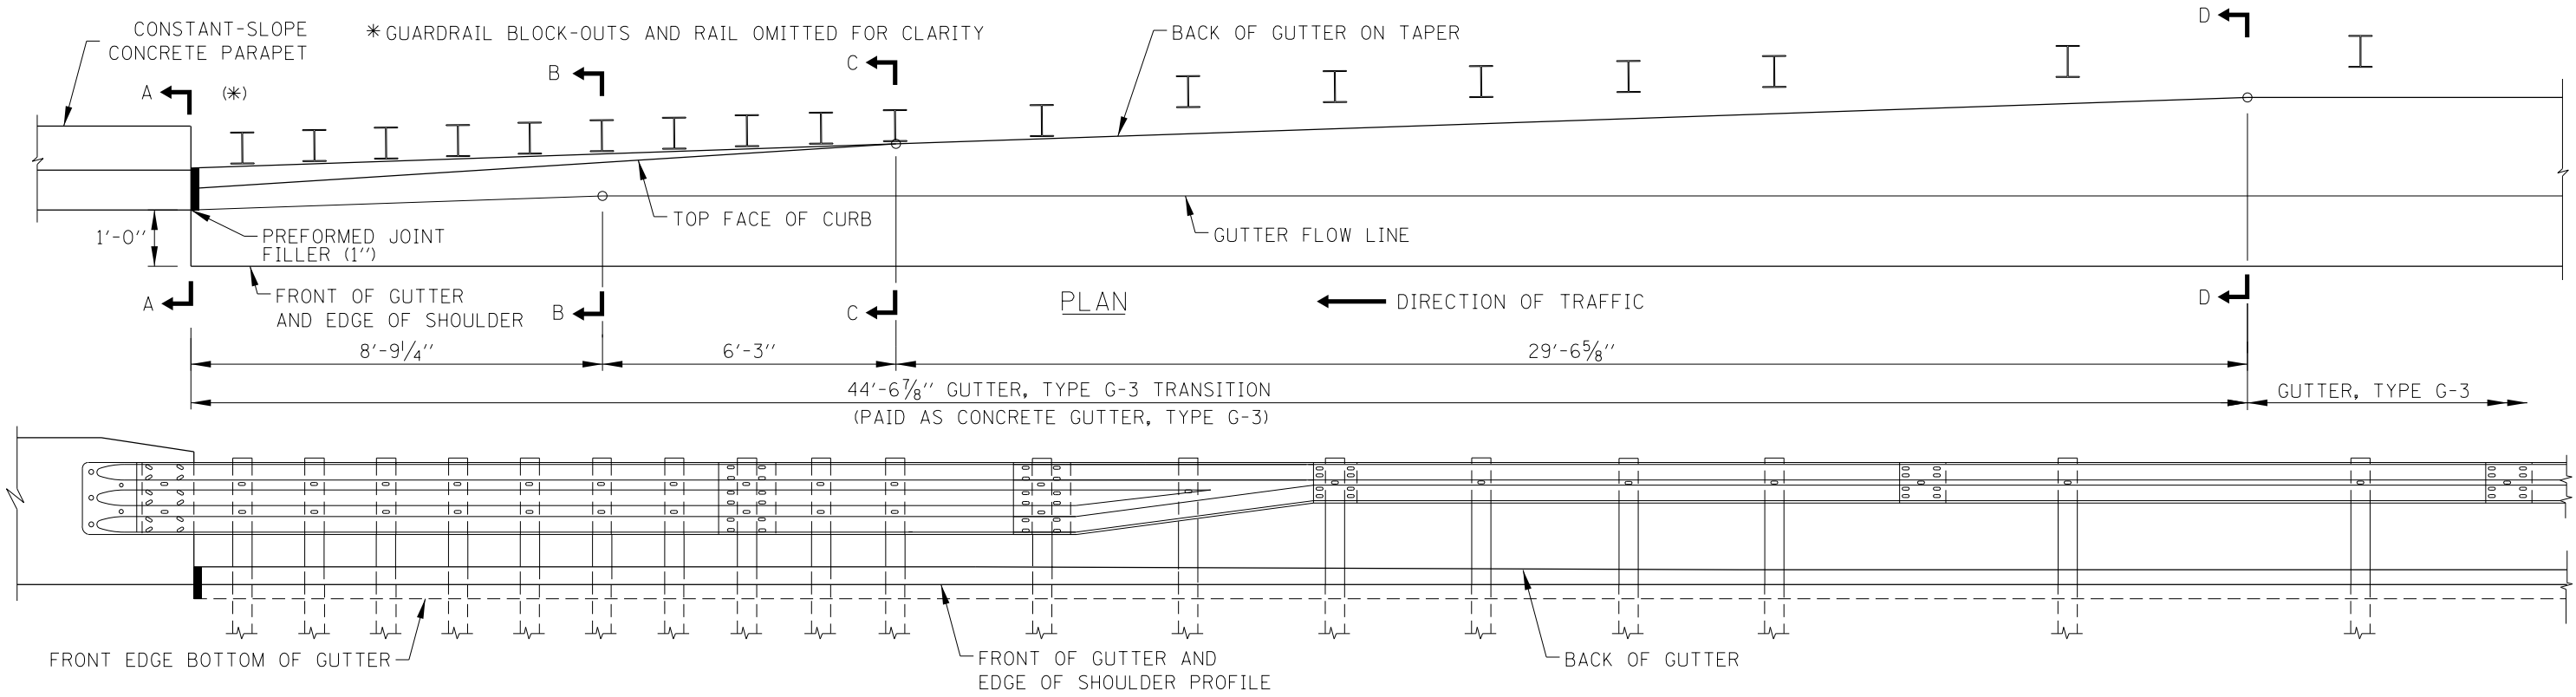

- GUTTER TRANSITION NOTES:**
1. SLOPE TO MATCH ADJACENT SHOULDER SLOPE.
 2. PROVIDE 1" EXPANSION JOINT WITH PREFORMED JOINT FILLER BETWEEN TRANSITION SECTION AND WINGWALL OR BARRIER WALL.

- GUTTER, TYPE G-3 TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6 TO CONSTANT-SLOPE CONCRETE PARAPET**
3. INSTALLATION ON CURVED WINGWALLS SIMILAR.
 4. FOR DETAILS OF TRAFFIC BARRIER TERMINAL, TYPE T6, SEE ILLINOIS TOLLWAY STANDARD C9.
 5. GUTTER TRANSITIONS SHALL BE CONSTRUCTED TO FIT THE STANDARD LOCATION OF THE TRAFFIC BARRIER TERMINAL, TYPE T6.
 6. ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
 7. GUTTER SECTION SHOWN AT BARRIER WALL SHALL MATCH PROFILE AND VERTICAL FACE OF BARRIER. MODIFY GUTTER FACE TO MATCH OTHER BARRIER/PARAPET PROFILES.
 8. CONTINUOUS #4 BARS SHALL BE LAPPED A MINIMUM OF 1'-1".
 9. MATCH SHOULDER SLOPE IN FRONT OF PARAPET OR BARRIER.
 10. GUTTER DEPTH SHALL MATCH PAVED SHOULDER DEPTH.

LEGEND
 (A) AGGREGATE SHOULDERS SPECIAL, TYPE C



DATE	REVISIONS
3-01-2020	REVISED GUTTER TRANSITION LENGTH AND TAPER
3-01-2019	ADDED PG 1, 2 & 3 CONSTANT-SLOPE BARRIER & NOTE 10 (GUTTER DEPTH).
3-01-2018	REVISED NOTES
3-31-2016	REVISED G-2 GUTTER SHAPE
3-11-2015	GUTTER TRANSITION FOR CONCRETE BARRIER, SINGLE-FACE.

APPROVED: *Paul Kovacs*
 CHIEF ENGINEERING OFFICER DATE 2-7-2012

SHEET 1 OF 6

TYPE G-2/G-3 GUTTER TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6
 STANDARD B3-09

* GUARDRAIL BLOCK-OUTS AND RAIL ARE OMITTED FOR CLARITY

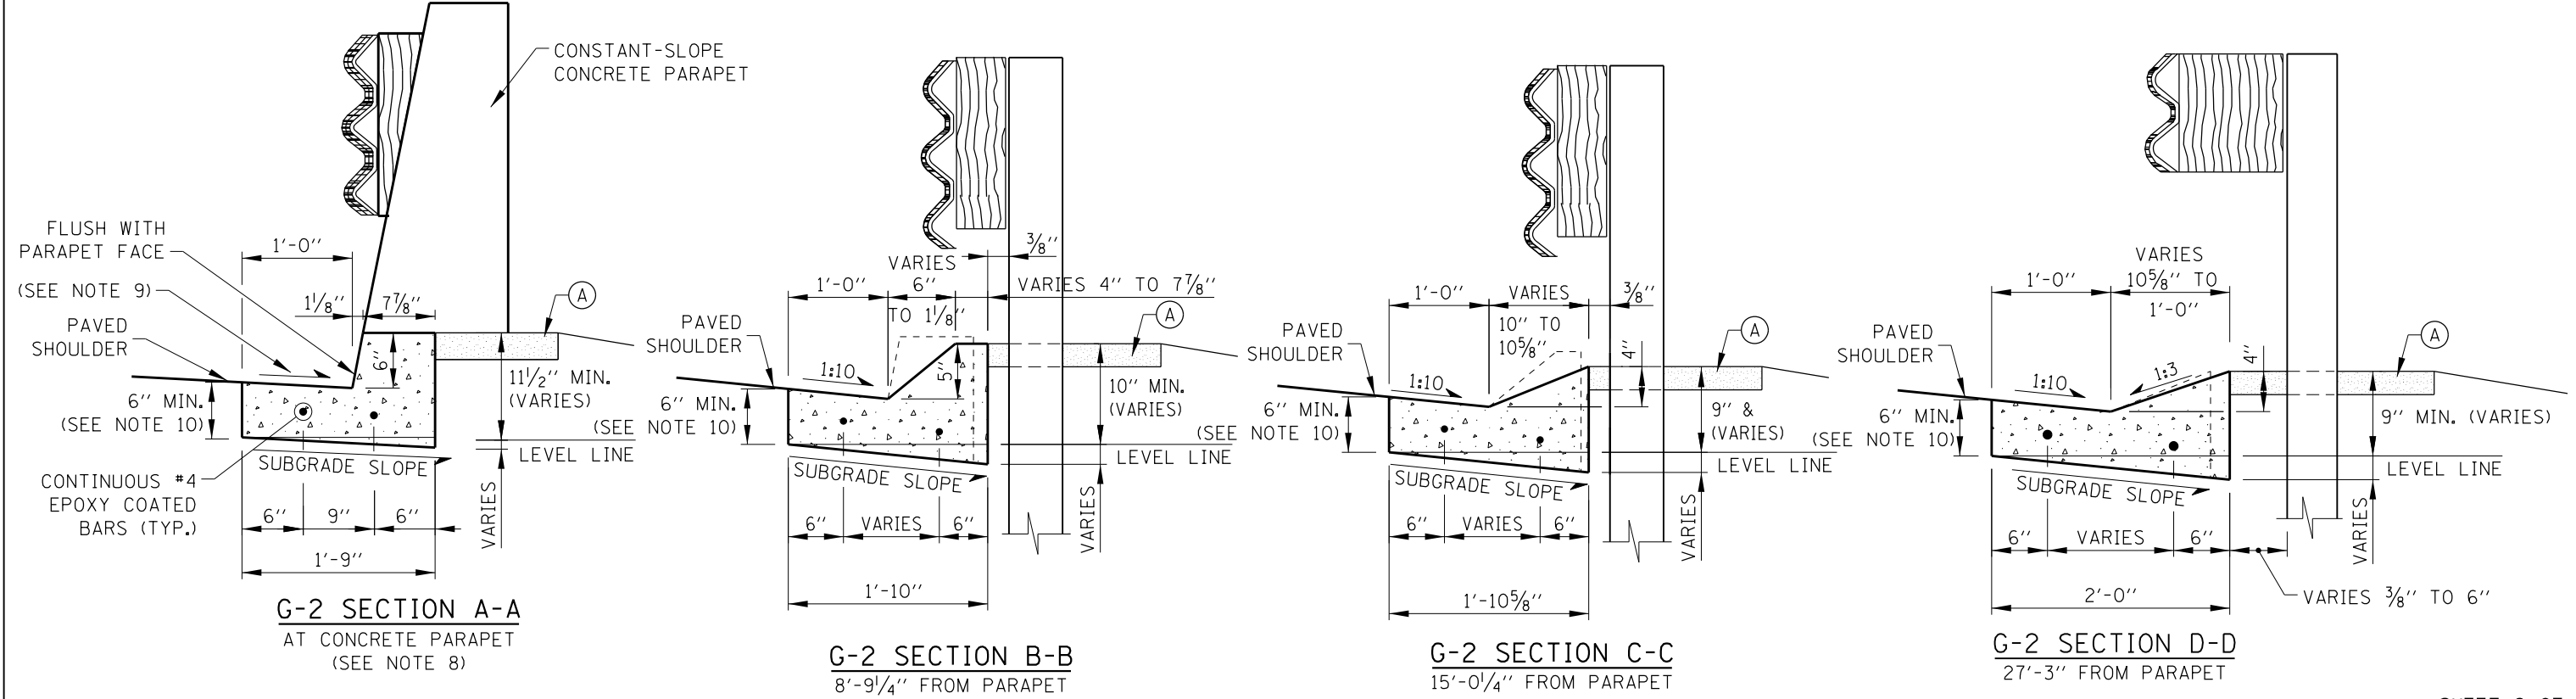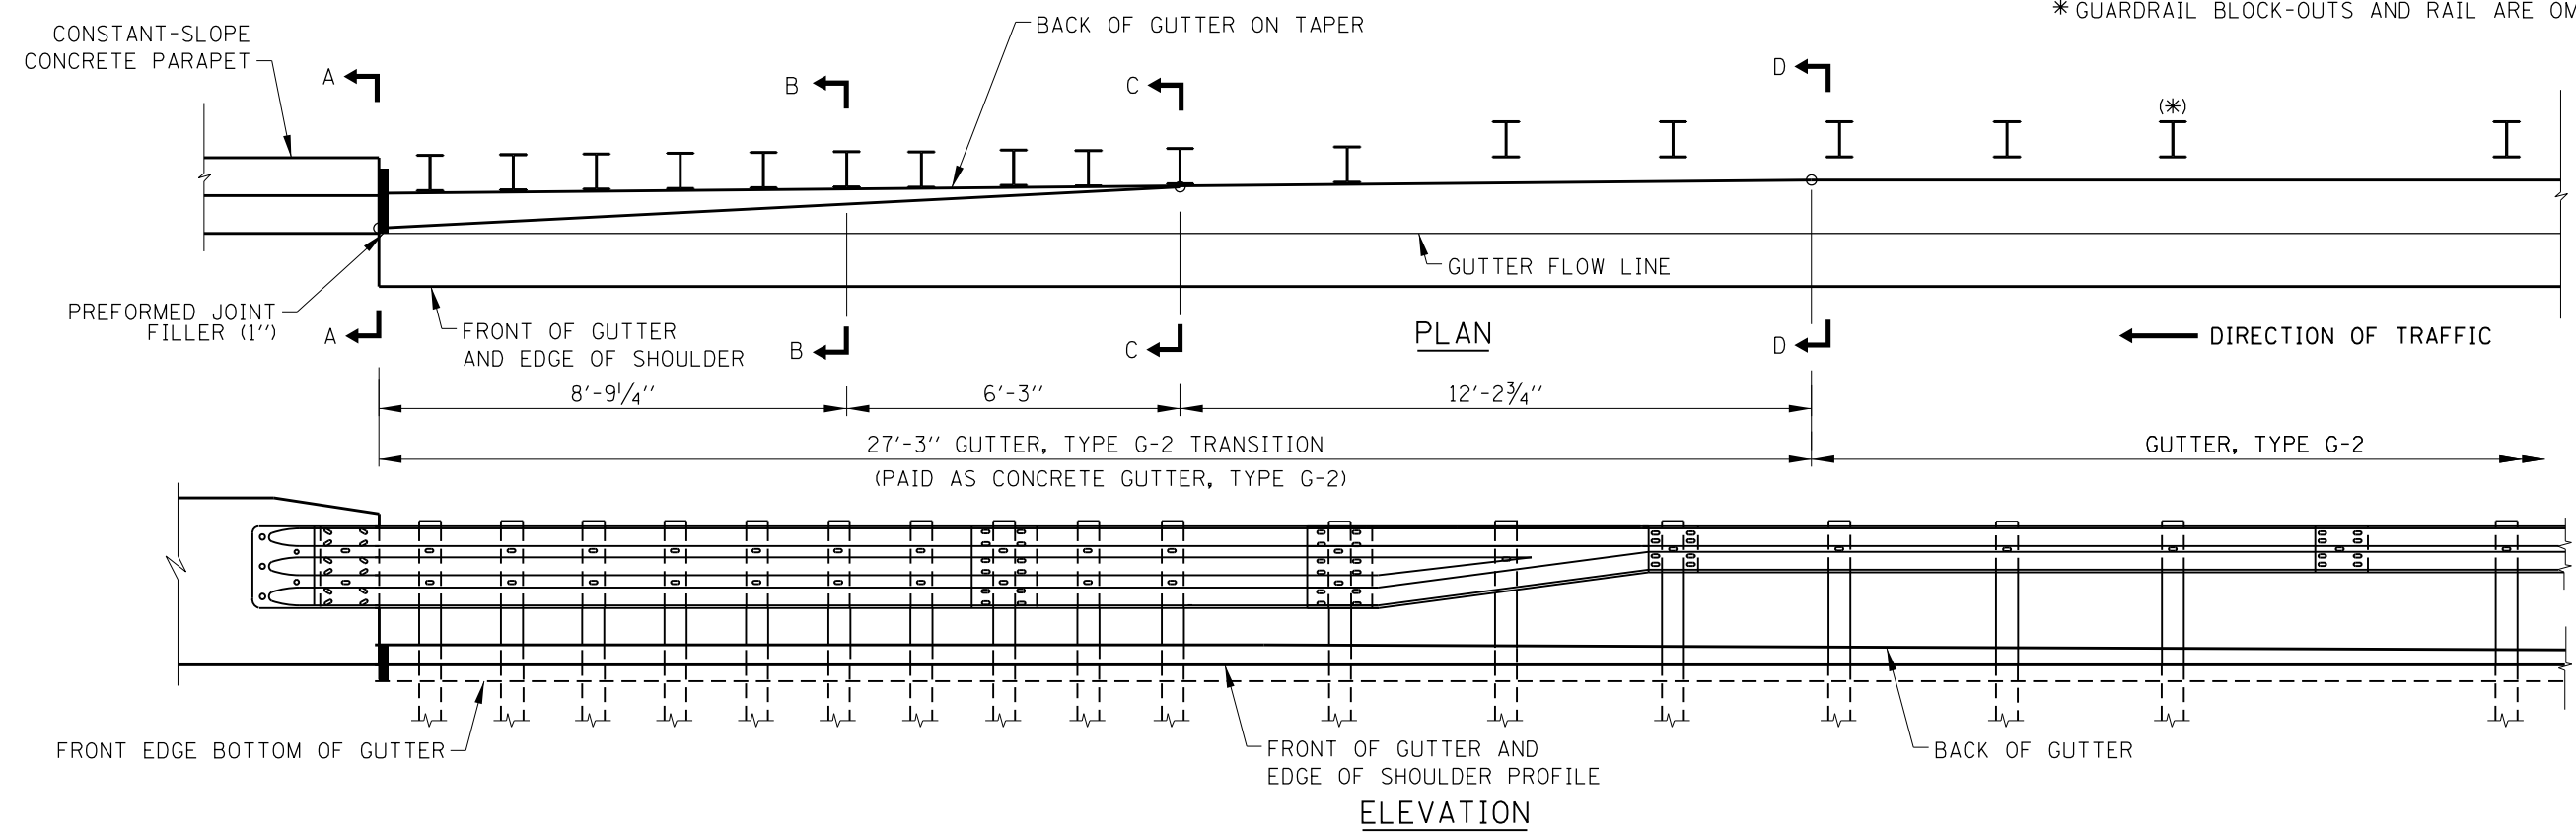



GUTTER, TYPE G-2 TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6 TO CONSTANT-SLOPE CONCRETE PARAPET

LEGEND
 (A) AGGREGATE SHOULDERS SPECIAL, TYPE C

NOTE:
 SEE SHEET 1 OF THIS SERIES FOR GUTTER TRANSITION NOTES.

TYPE G-2/G-3 GUTTER TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6
 STANDARD B3-09

Paul Kovacs
 APPROVED... CHIEF ENGINEERING OFFICER DATE 2-7-2012

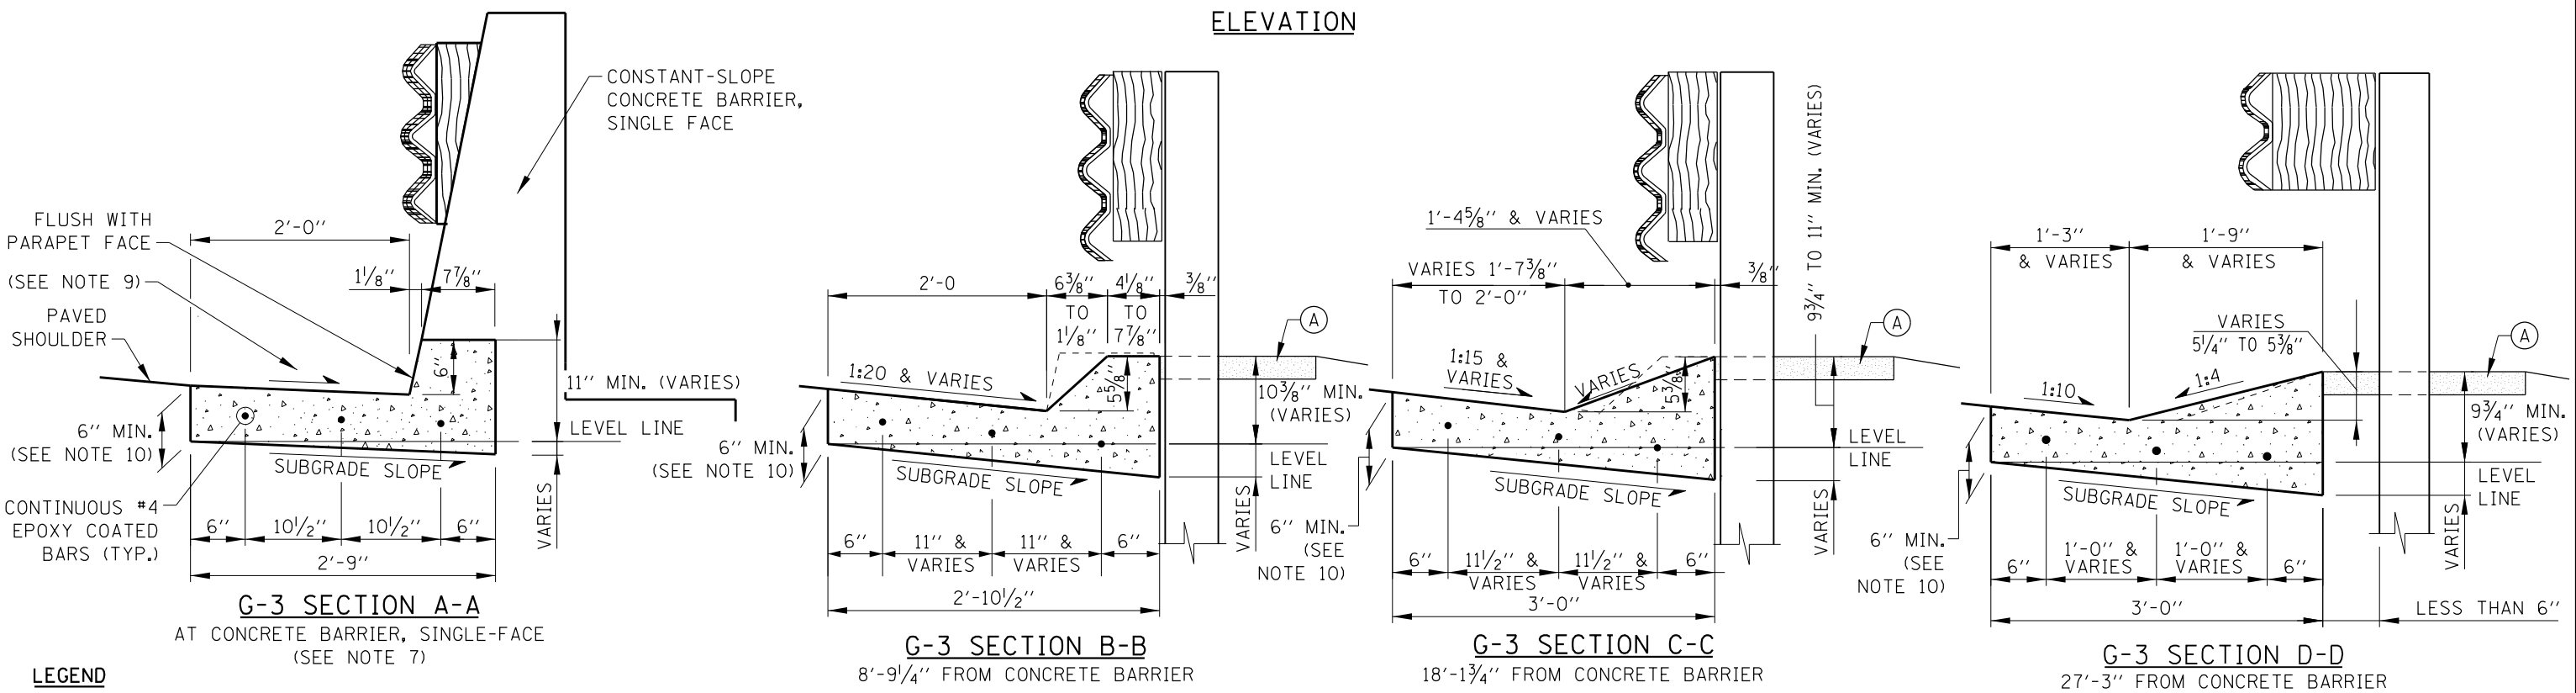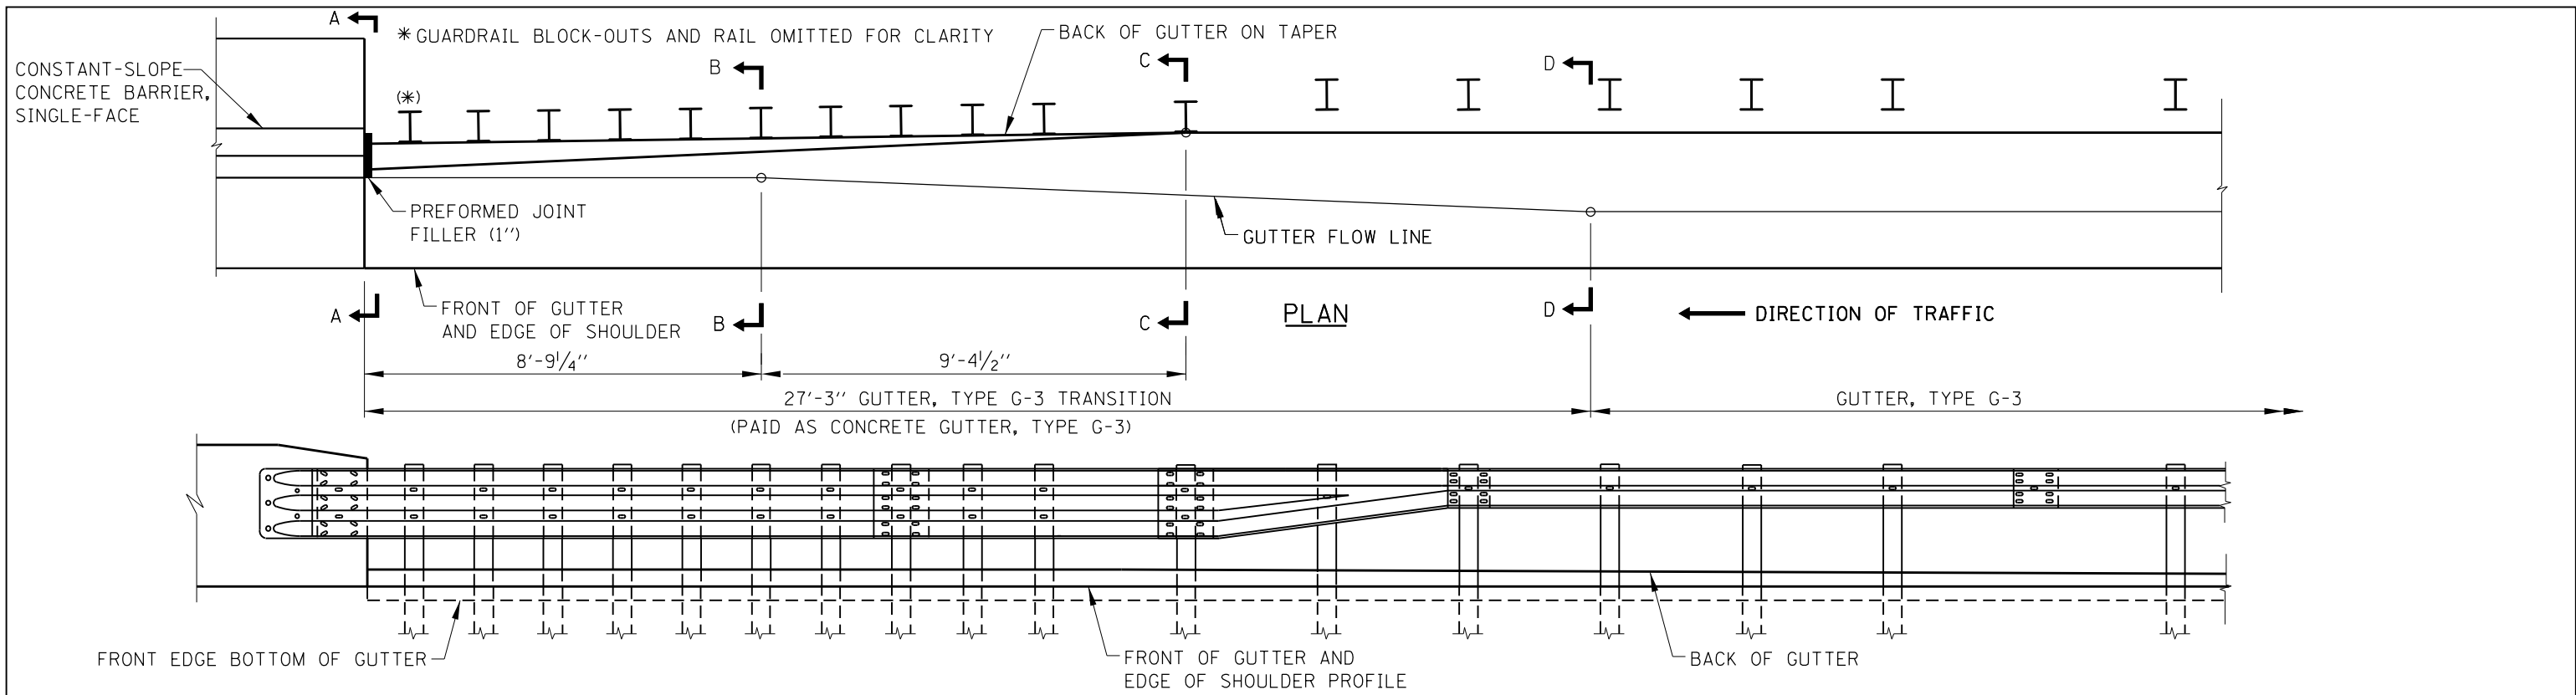



LEGEND
 (A) AGGREGATE SHOULDERS SPECIAL, TYPE C

**GUTTER, TYPE G-3 TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6,
 TO CONSTANT-SLOPE CONCRETE BARRIER, SINGLE FACE**


NOTE:
 SEE SHEET 1 OF THIS SERIES FOR GUTTER
 TRANSITION NOTES.

TYPE G-2/G-3 GUTTER
 TRANSITION AT TRAFFIC
 BARRIER TERMINAL,
 TYPE T6
 STANDARD B3-09

Paul Kovacs
 APPROVED, CHIEF ENGINEERING OFFICER DATE 2-7-2012

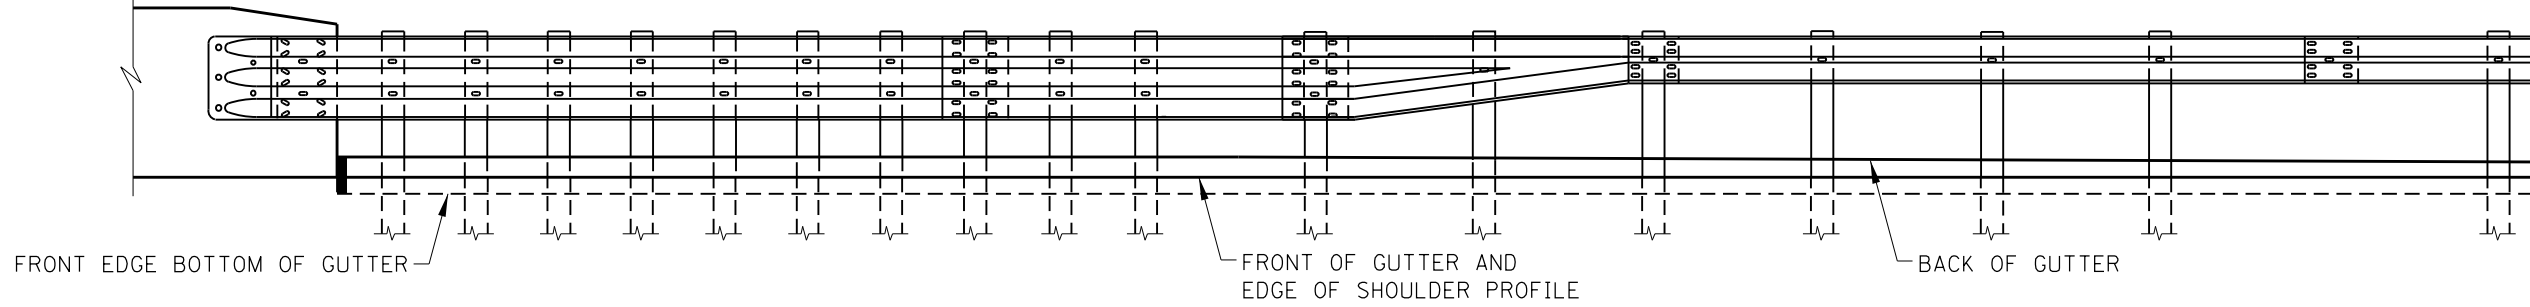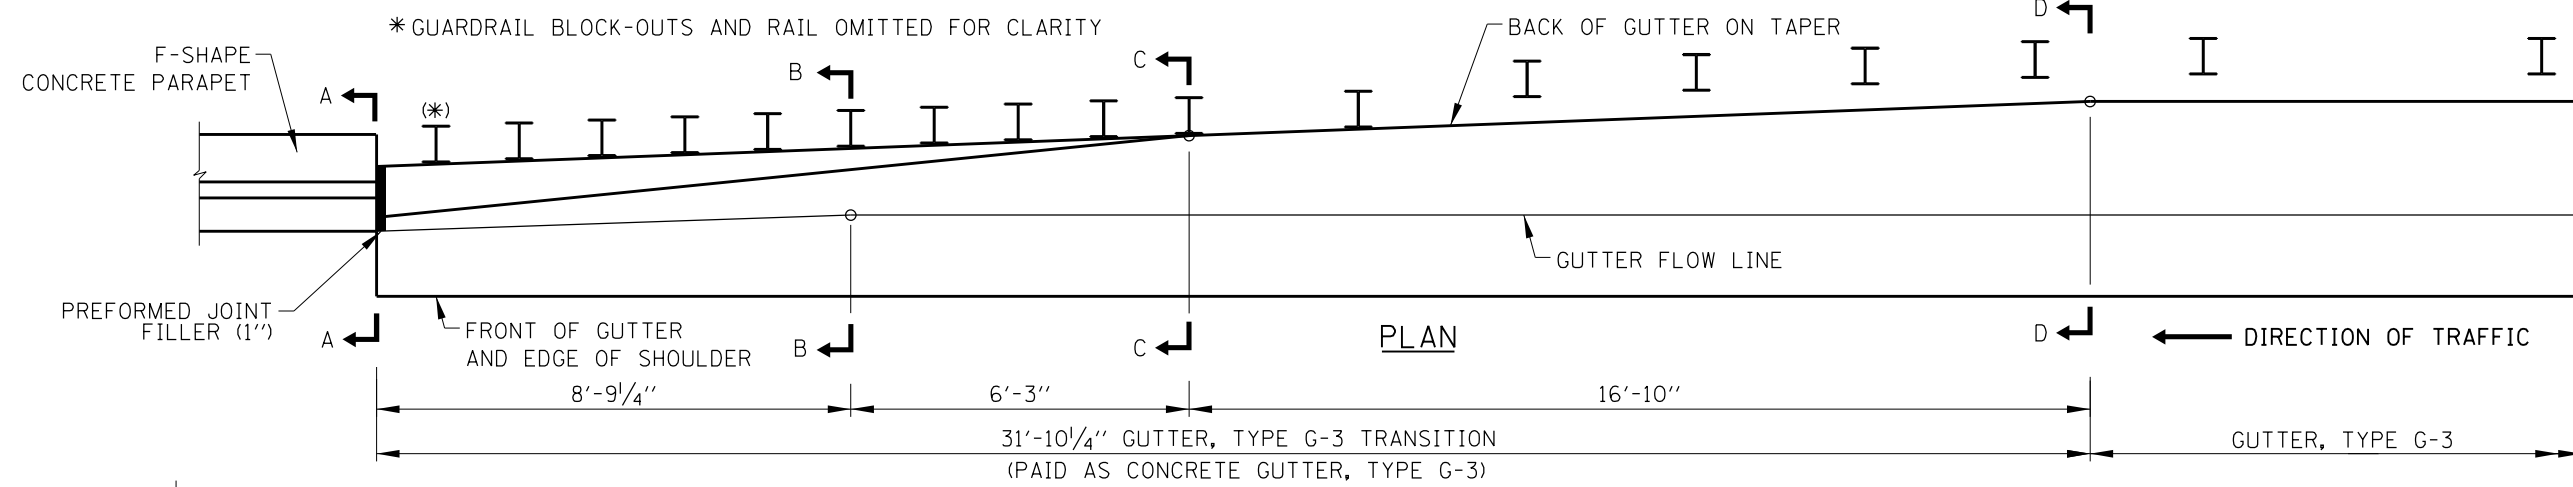

ELEVATION

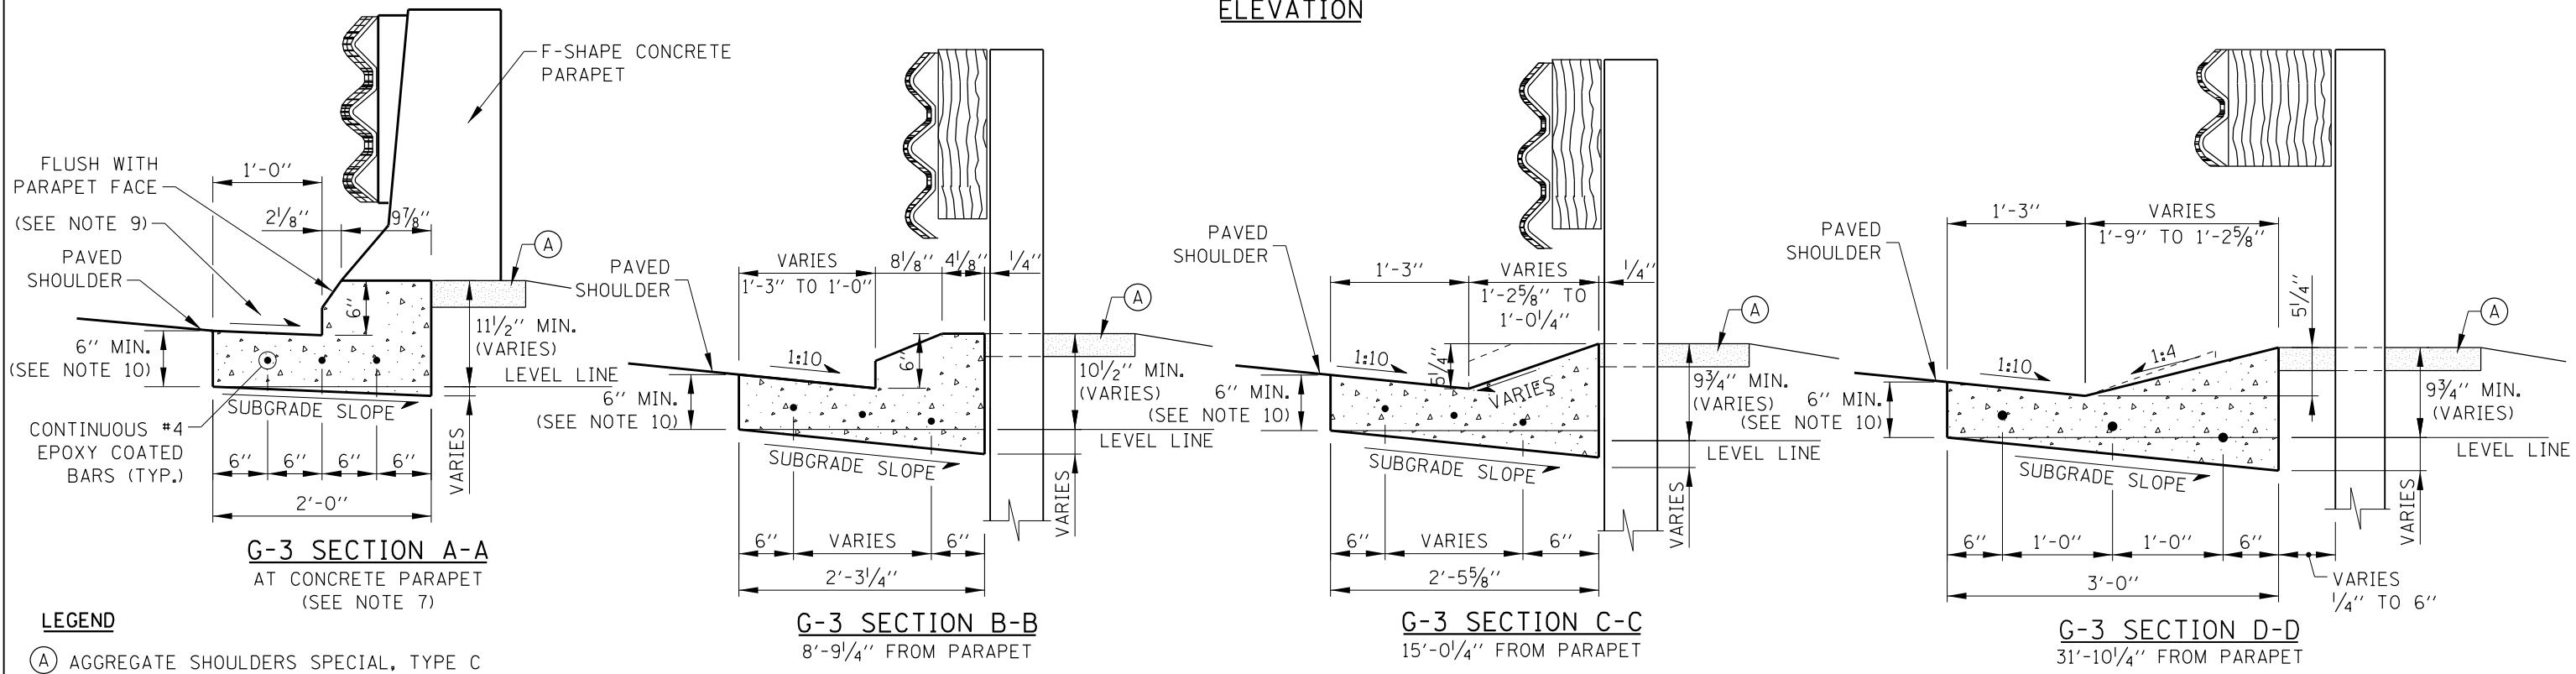



LEGEND
 (A) AGGREGATE SHOULDERS SPECIAL, TYPE C

GUTTER, TYPE G-3 TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6 TO F-SHAPE CONCRETE PARAPET


APPROVED *Paul Kovacs* CHIEF ENGINEERING OFFICER DATE 2-7-2012

NOTE:
 SEE SHEET 1 OF THIS SERIES FOR GUTTER TRANSITION NOTES.


TYPE G-2/G-3 GUTTER TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6
 STANDARD B3-09

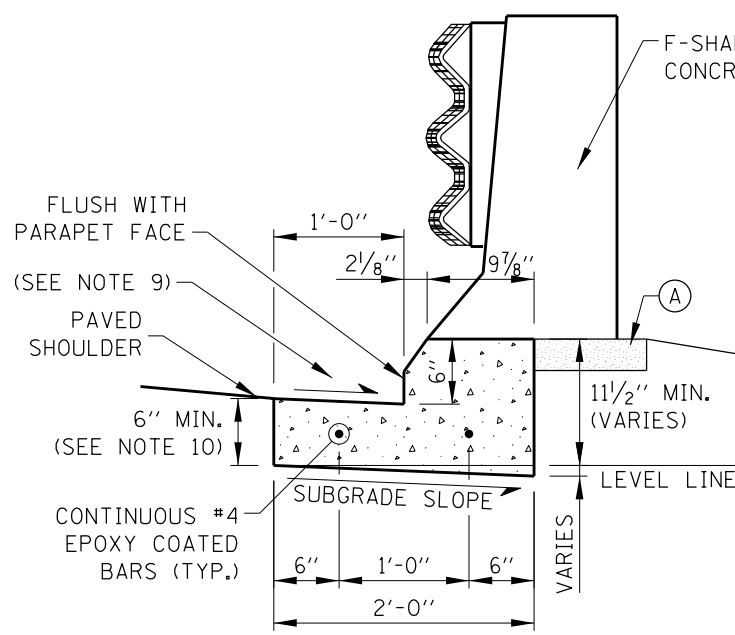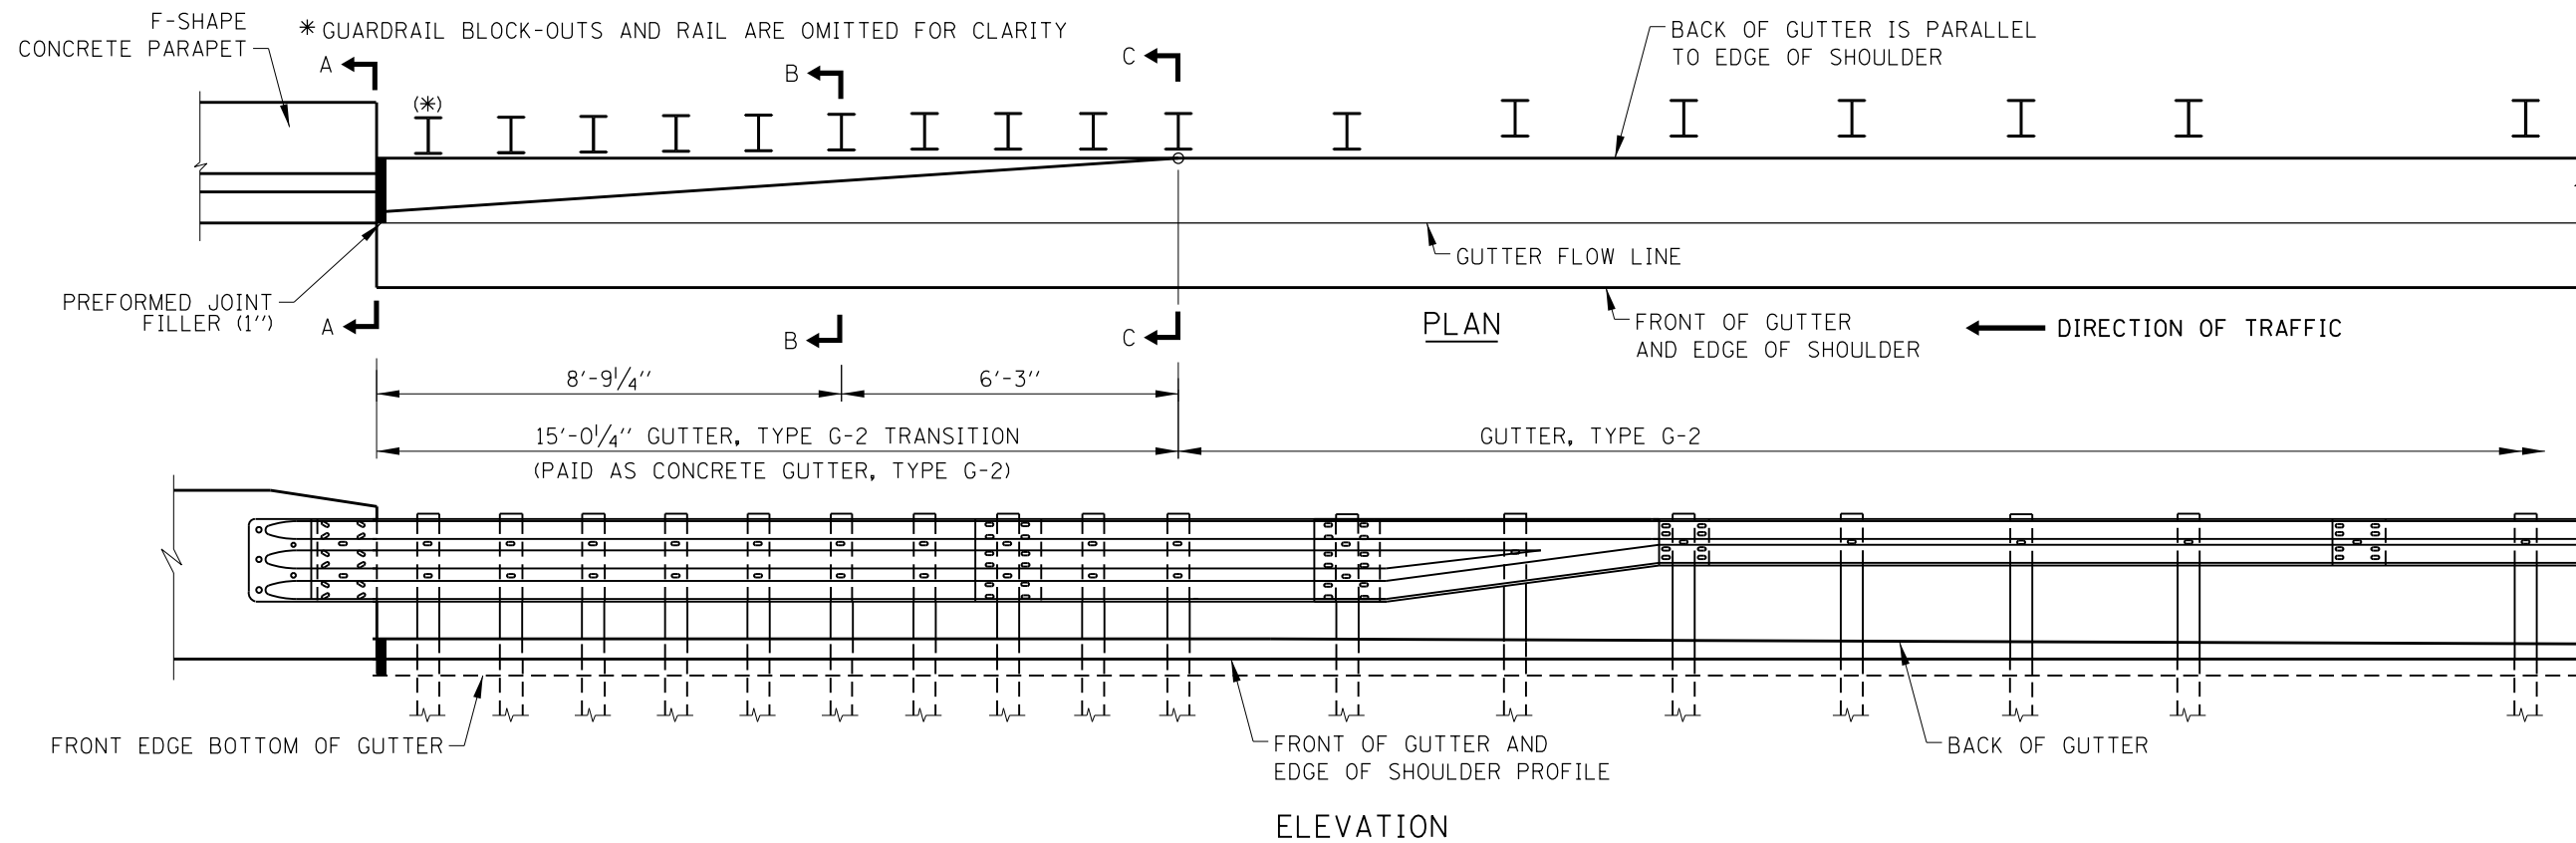

G-2 SECTION A-A
AT CONCRETE PARAPET
(SEE NOTE 7)

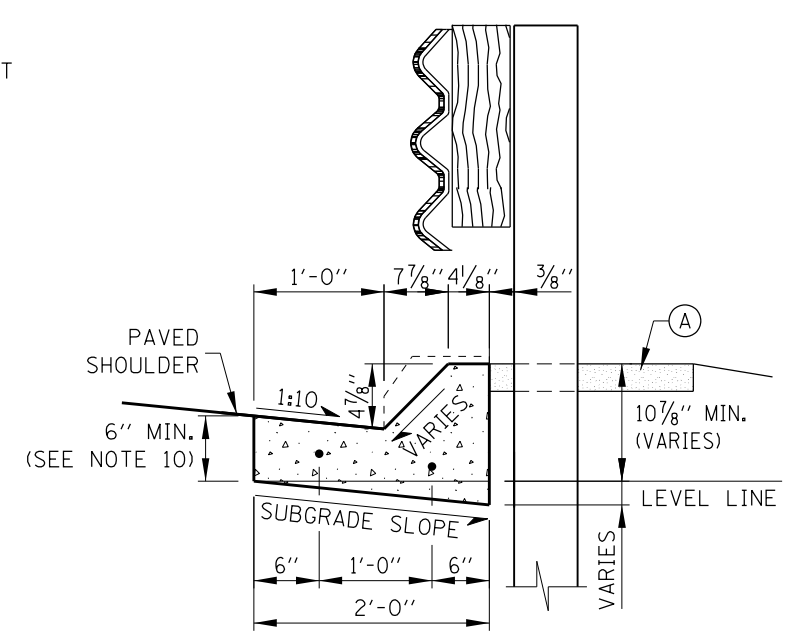

G-2 SECTION B-B
8'-9 1/4" FROM PARAPET

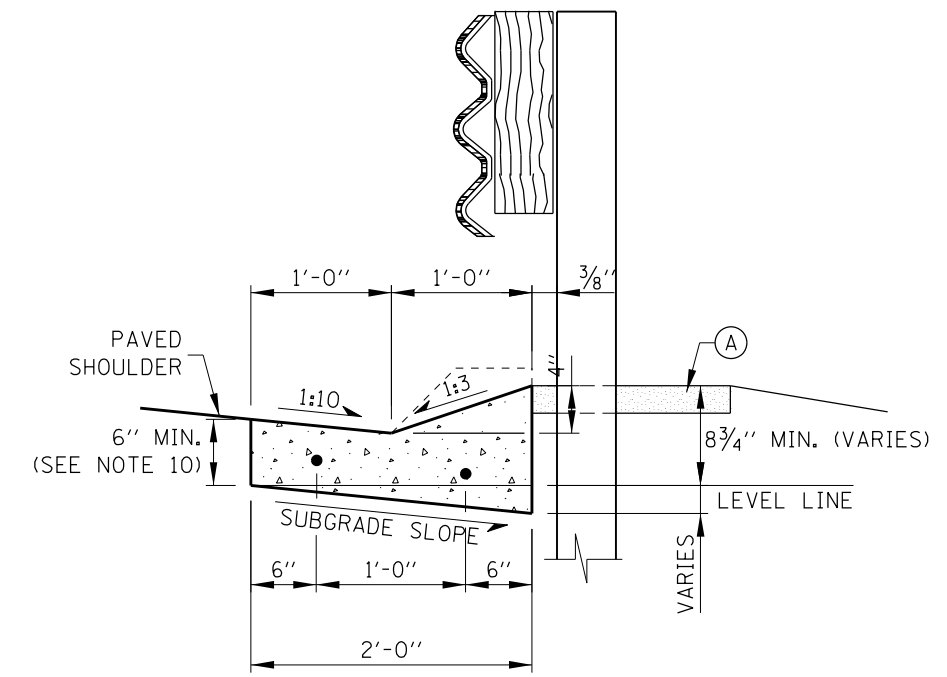

G-2 SECTION C-C
15'-0 1/4" FROM PARAPET

GUTTER, TYPE G-2 TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6 TO F-SHAPE CONCRETE PARAPET



LEGEND
 (A) AGGREGATE SHOULDERS SPECIAL, TYPE C

NOTE:
 SEE SHEET 1 OF THIS SERIES FOR GUTTER TRANSITION NOTES.

APPROVED *Paul Kovacs* CHIEF ENGINEERING OFFICER DATE 2-7-2012

SHEET 5 OF 6

TYPE G-2/G-3 GUTTER TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6
 STANDARD B3-09

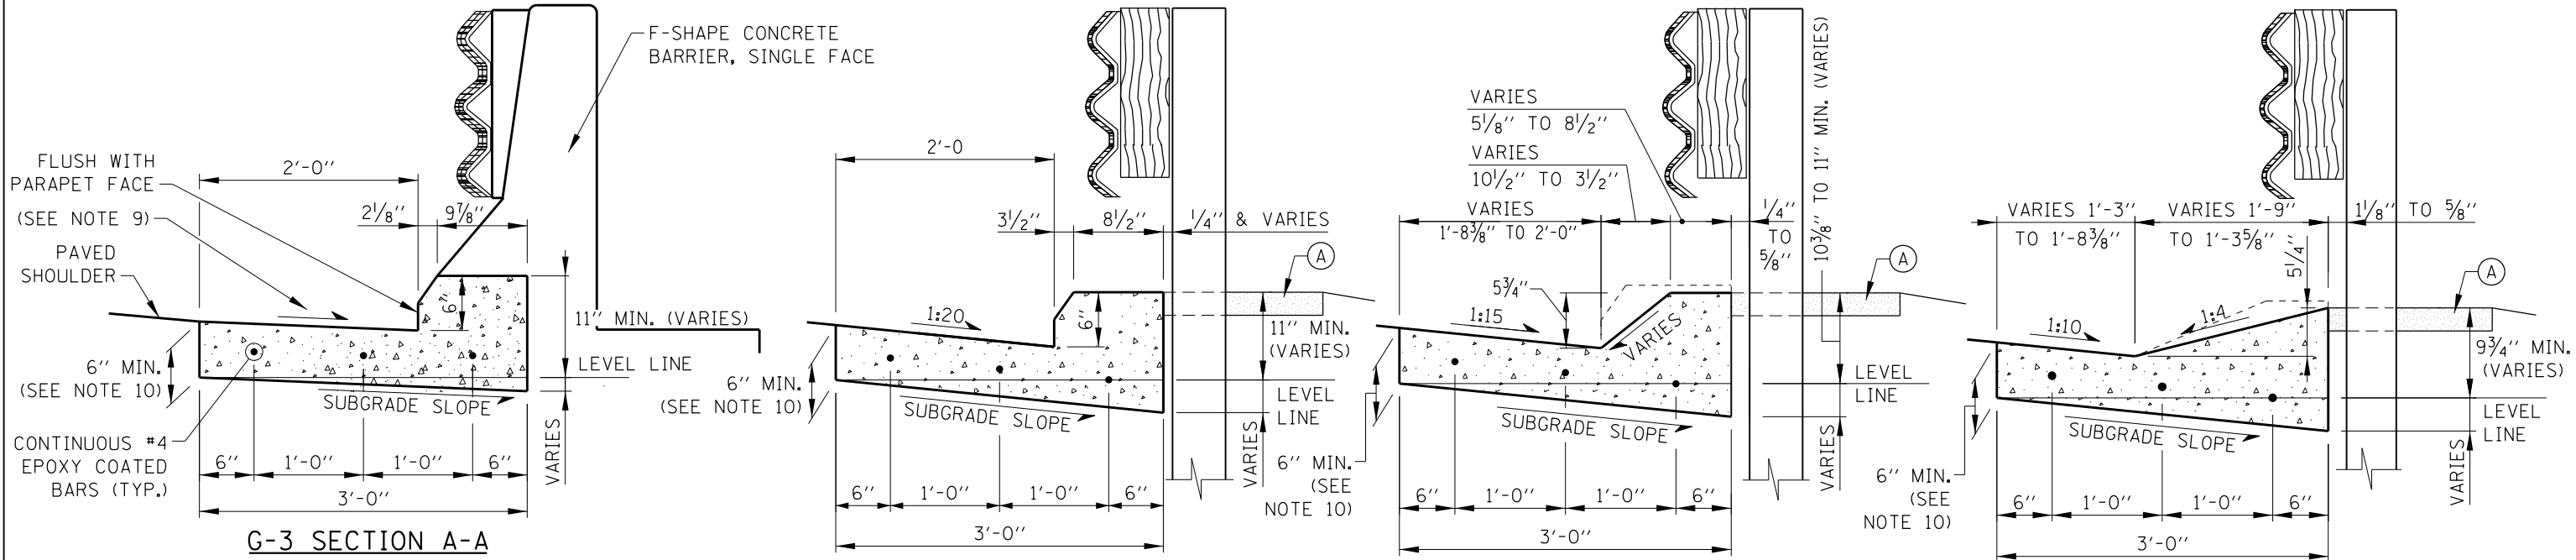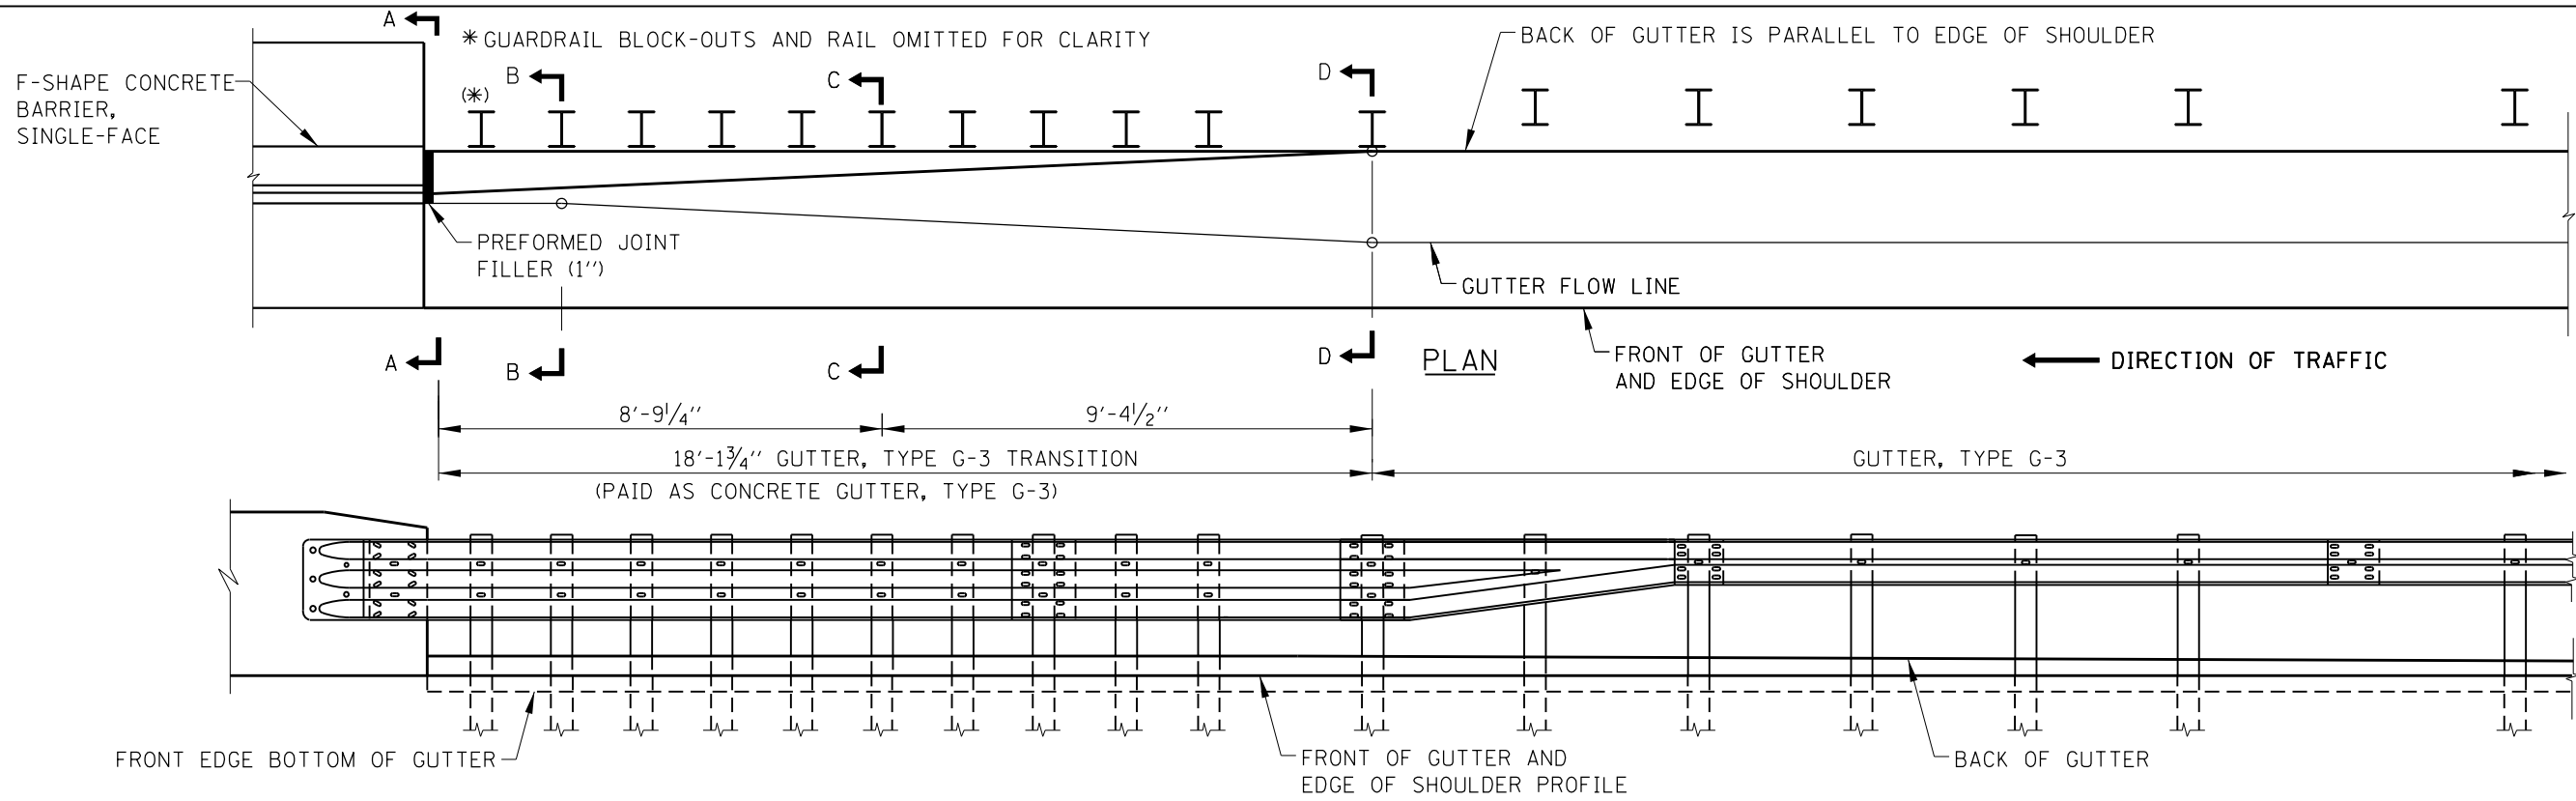


LEGEND
 (A) AGGREGATE SHOULDERS SPECIAL, TYPE C

GUTTER, TYPE G-3 TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T6, TO F-SHAPE CONCRETE BARRIER, SINGLE-FACE

NOTE:
 SEE SHEET 1 OF THIS SERIES FOR GUTTER TRANSITION NOTES.

APPROVED: *Paul Kovacs*
 CHIEF ENGINEERING OFFICER DATE: 2-7-2012

SHEET 6 OF 6




TYPE G-2/G-3 GUTTER
 TRANSITION AT TRAFFIC
 BARRIER TERMINAL,
 TYPE T6
 STANDARD B3-09


CONCRETE FLUME

NOTES:


1. CONCRETE FLUMES SHALL BE CONSTRUCTED FLUSH WITH THE ADJACENT EXISTING OR PROPOSED SURFACES.
2. CLASS SI CONCRETE SHALL BE USED THROUGHOUT.
3. WELDED WIRE REINFORCEMENT SHALL BE EPOXY COATED 6x6 W4xW4, 58 LBS. PER 100 SQ. FT.
4. #4 EPOXY COATED TIE BARS 2'-6" LONG AT 12" O/C SHALL BE PROVIDED AT ALL CONSTRUCTION JOINTS.
5. EPOXY COATED EXPANDED METAL FABRIC OF EQUIVALENT STRENGTH MAY BE USED IN LIEU OF WELDED WIRE REINFORCEMENT SUBJECT TO ENGINEER'S APPROVAL.
6. THE LOCATION OF THE ANCHOR WALL MAY BE ADJUSTED AS DIRECTED BY THE ENGINEER.
7. THE MATERIALS AND CONSTRUCTION OF THE CONCRETE FLUME SHALL CONFORM TO THE APPLICABLE PORTIONS OF THE STANDARD SPECIFICATIONS.

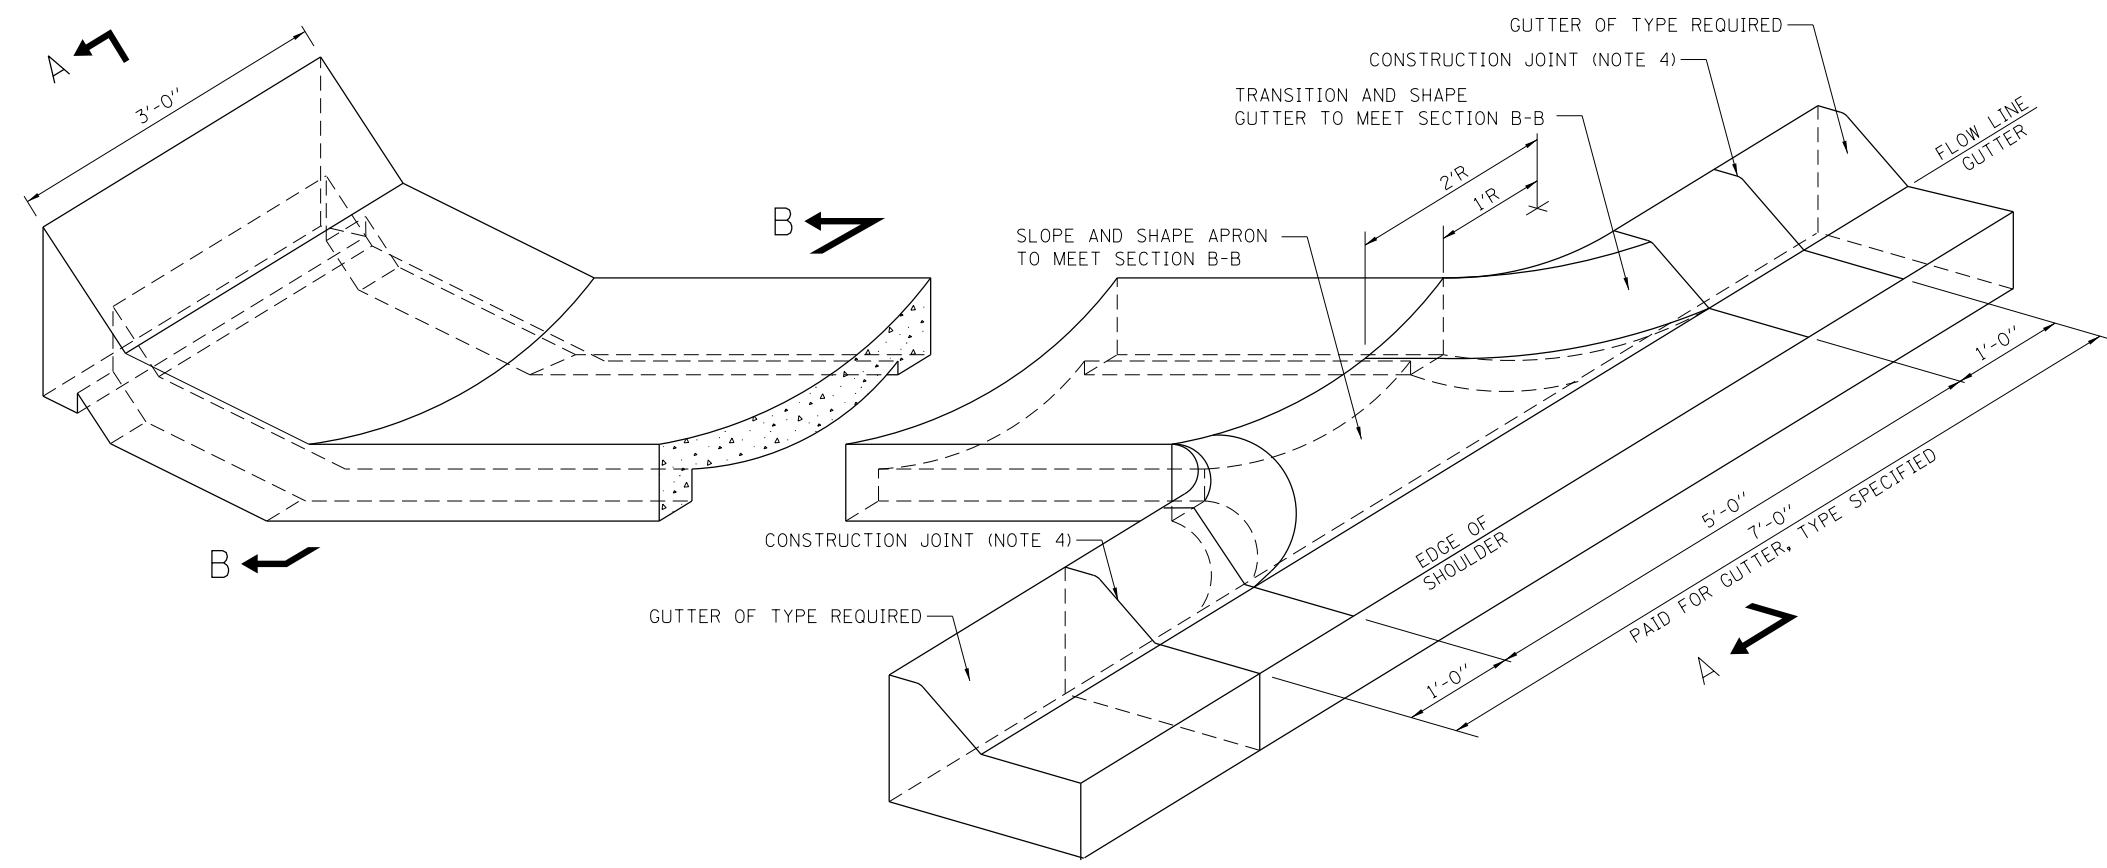

PLAN

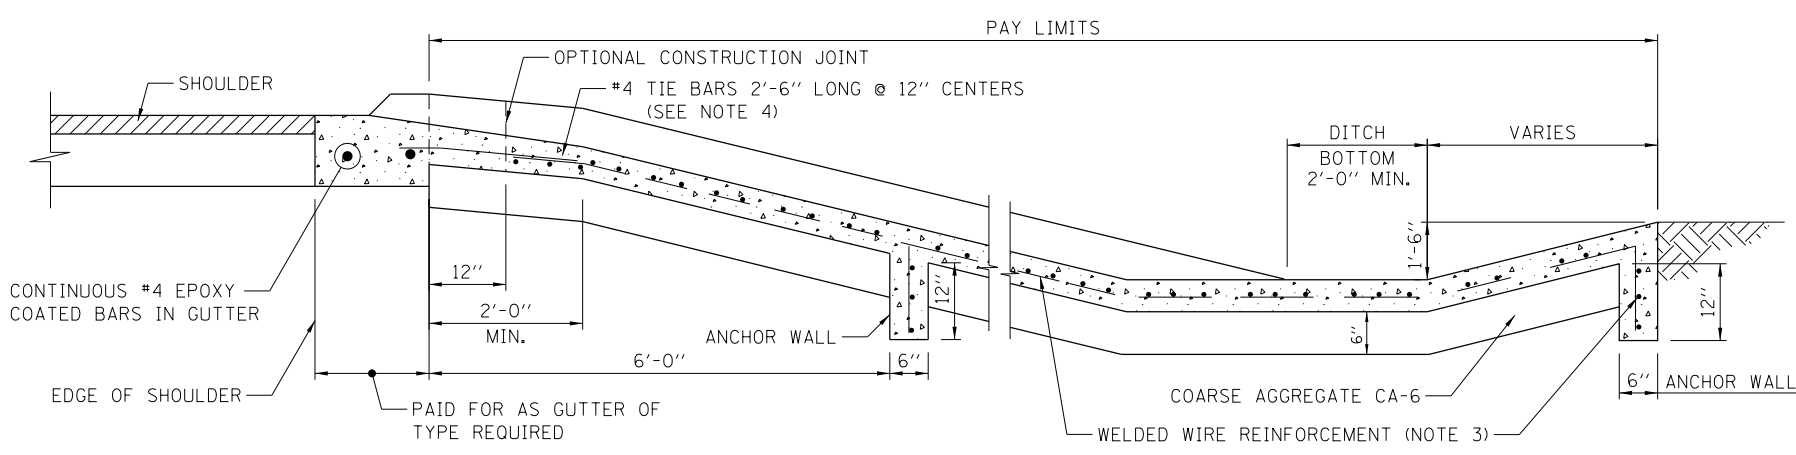

SECTION A-A
ADJACENT TO GUTTER

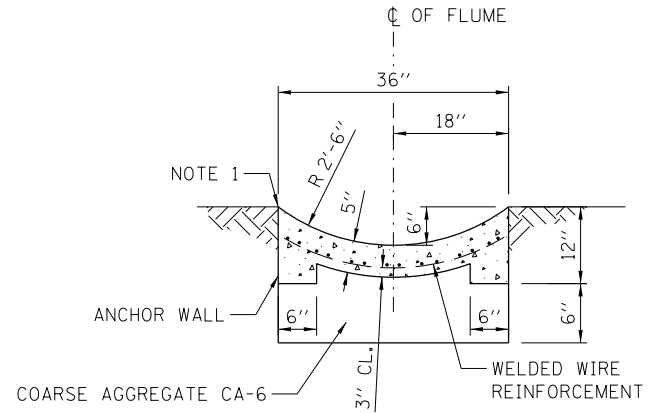

NOTE:

0.62 C.Y. CONCRETE / L.F.

SECTION B-B


Paul Kovacs
APPROVED, CHIEF ENGINEERING OFFICER DATE 2-7-2012

DATE	REVISIONS
3-01-2018	REVISED SECTION A-A TO INCLUDE COARSE AGGREGATE NOTE 8 WAS REMOVED
3-31-2016	CHANGED TERMINOLOGY TO WELDED WIRE REINFORCEMENT
3-11-2015	DELETED CURB SECTION
2-07-2012	REVISED NOTES




CONCRETE FLUME DETAILS


STANDARD B5-04

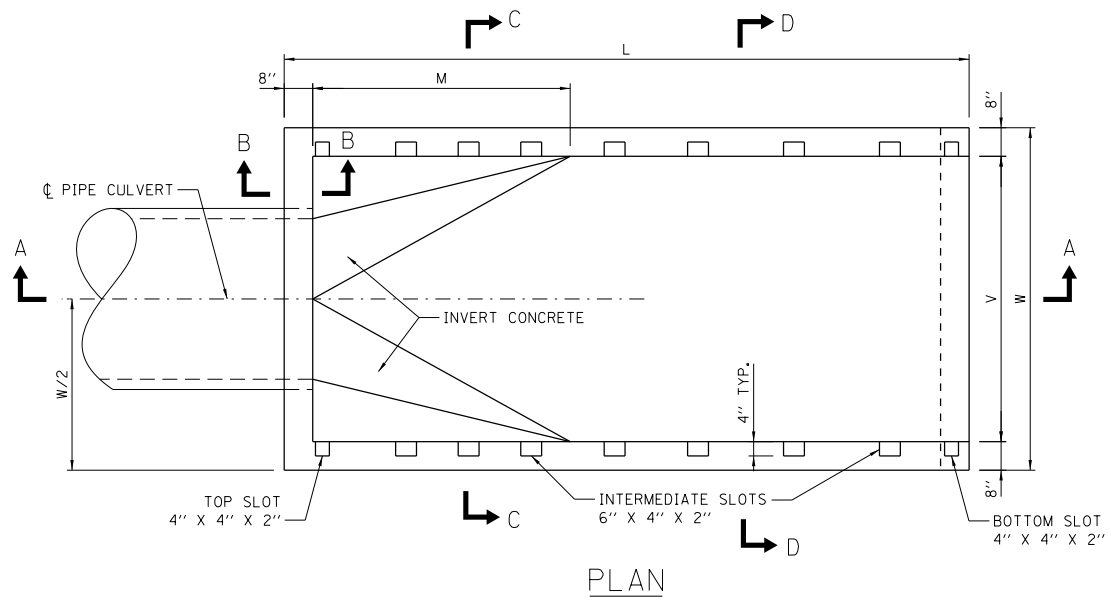

PLAN

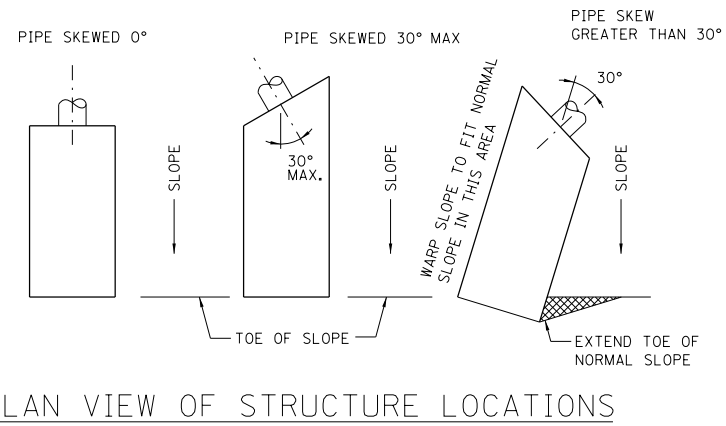

PLAN VIEW OF STRUCTURE LOCATIONS

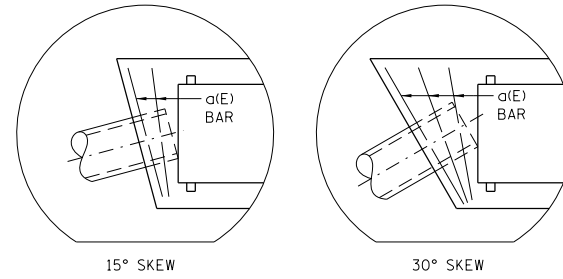


FLARED BAR DETAILS


NOTES:

ADDITIONAL "a" BARS SHALL BE FURNISHED AND PLACED BY THE CONTRACTOR. THE ADDITIONAL BARS ARE NOT INCLUDED IN THE LISTED QUANTITIES, BUT WILL BE PAID FOR AS REINFORCEMENT BARS (EPOXY COATED).


1 ADDITIONAL BAR REQUIRED FOR EACH 15° SKEW OR FRACTION THEREOF.

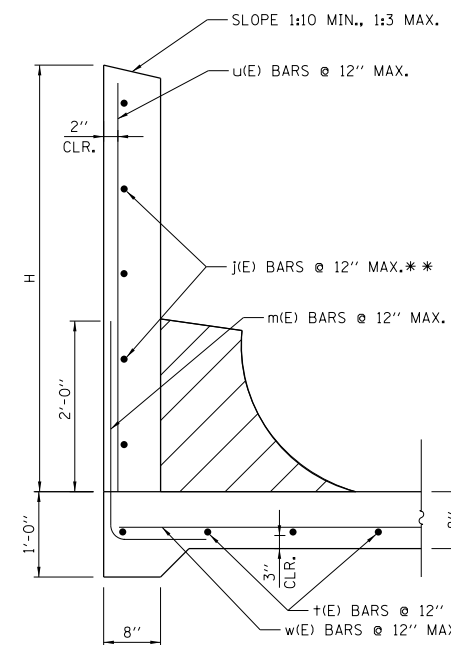

SECTION B-B

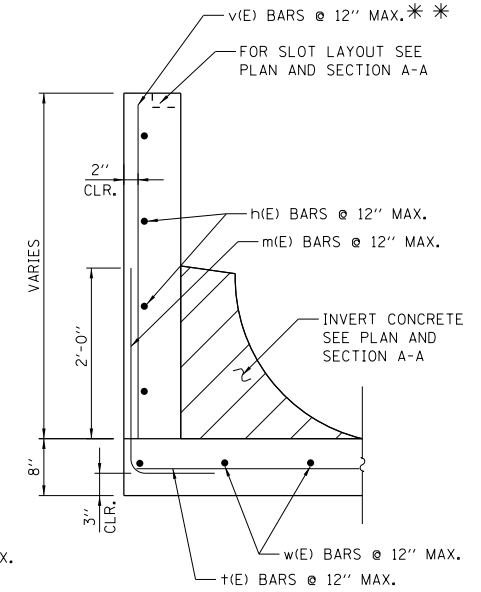

SECTION C-C

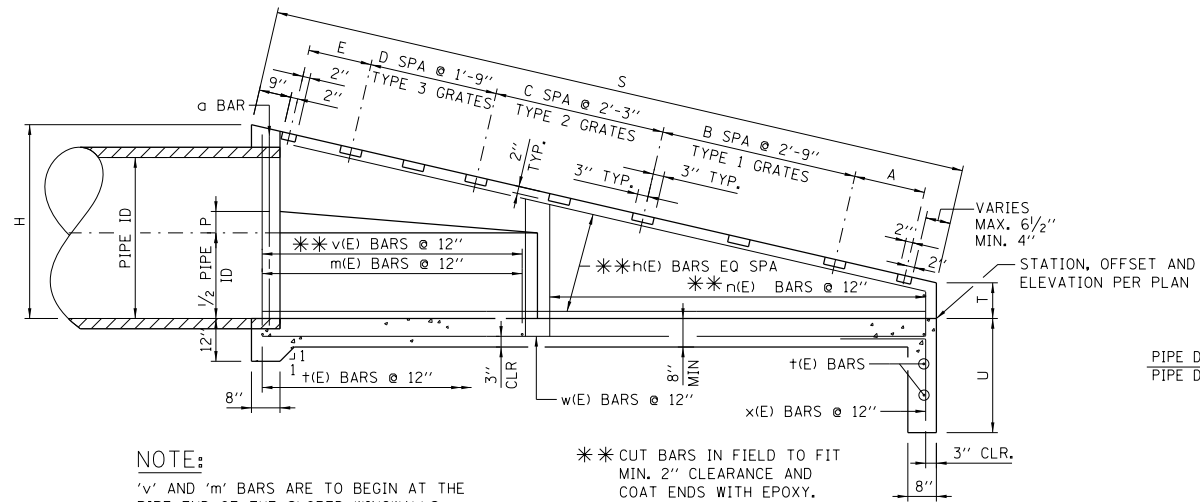


SECTION A-A

NOTE:

"v" AND "m" BARS ARE TO BEGIN AT THE PIPE END OF THE SLOPED WINGWALLS.


** CUT BARS IN FIELD TO FIT MIN. 2" CLEARANCE AND COAT ENDS WITH EPOXY.

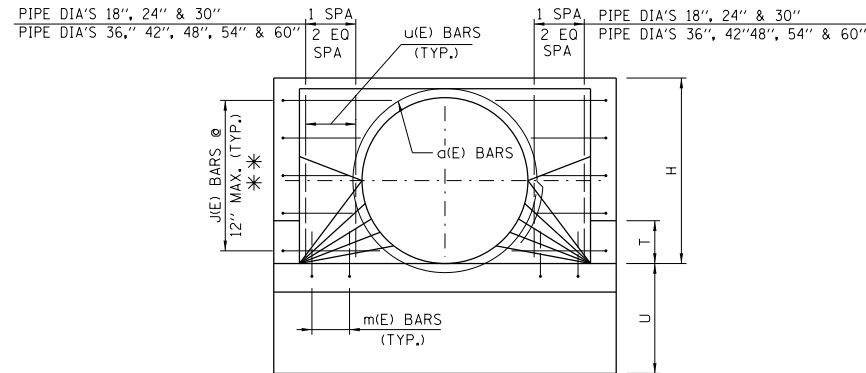


FRONT ELEVATION

NOTES:


1. HEADWALL TYPE III SHALL BE CONSTRUCTED FLUSH WITH EXISTING OR PROPOSED SLOPE.
2. CLASS SI CONCRETE SHALL BE USED THROUGHOUT.
3. ALL REINFORCEMENT BARS SHOWN SHALL BE EPOXY COATED (E).
4. BAR BENDING DETAILS ARE DIMENSIONED OUT TO OUT OF BARS.
5. ALL EXPOSED EDGES SHALL HAVE A 3/4" - 45° CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW THE FINISHED GROUND LINE.
6. COVER FROM THE FACE OF CONCRETE TO FACE OF REINFORCEMENT BAR SHALL BE 3" FOR SURFACES FORMED AGAINST EARTH AND 2" FOR ALL OTHER SURFACES UNLESS OTHERWISE SHOWN.
7. CARE SHALL BE EXERCISED IN REMOVING ANY LENGTH OF EXISTING PIPE SO THE REMAINING PIPE IS UNDAMAGED AND FULLY FUNCTIONING.
8. FOR DIMENSIONS AND QUANTITIES FOR ONE HEADWALL, SEE SHEET 2 IN THIS SERIES.
9. FOR STEEL GRATING DETAILS, SEE SHEET 3 IN THIS SERIES.
10. FOR ALTERNATE PRECAST CONCRETE DETAILS AND NOTES, SEE SHEET 4 IN THIS SERIES.
11. ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).

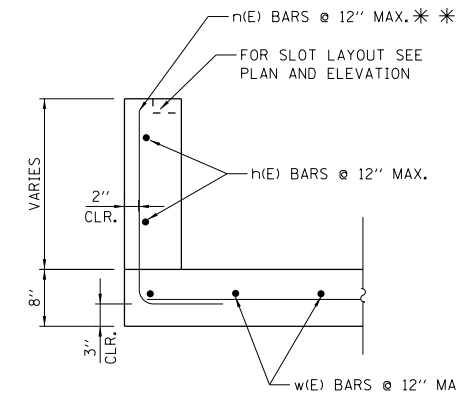

SECTION D-D

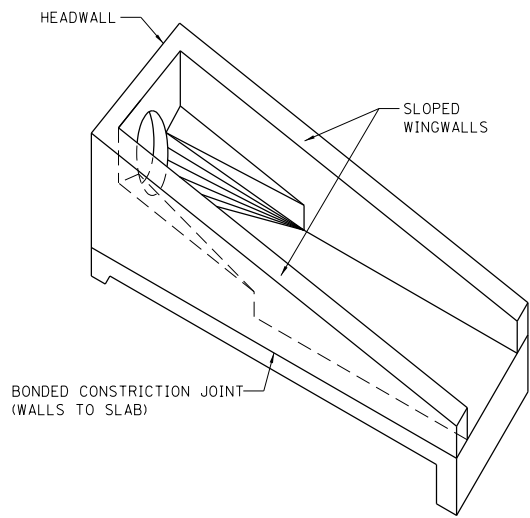

ISOMETRIC VIEW

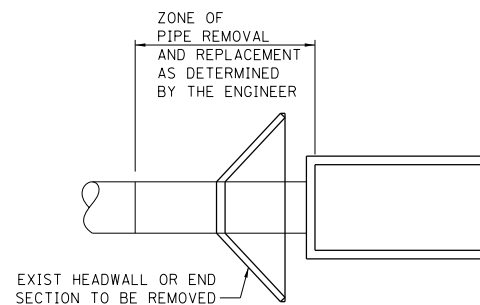

INSTALLATION DETAIL

APPROVED: *Paul Kovacs* DATE 5-1-2009
CHIEF ENGINEERING OFFICER



HEADWALL TYPE III
18"-24"-30"-36"-42"-48"-54"-60"
FOR 1:3, 1:4, 1:6, AND
1:10 SLOPES
STANDARD B6-09

DATE	REVISIONS
3-01-2022	REVISED BAR NO. 1 THICKNESS AND WEIGHT OF HEADWALL GRATES
3-01-2021	ADJUSTED LENGTH OF "h" BARS FOR THE 1:3 SLOPE HEADWALL
3-01-2019	MINOR EDIT

DIMENSIONS AND QUANTITIES IN ONE HEADWALL TYPE III 1:3 SLOPE

Table with columns for PIPE DIA, DIMENSIONS (H, L, M, P, S, T, U, V, W, A, E), NO. OF SPACES (B, C, D), CONCRETE CLASS SI CU. YD., and REINF. BARS LB. Rows include pipe diameters 36, 42, 48, 54, and 60 inches.

DIMENSIONS AND QUANTITIES IN ONE HEADWALL TYPE III 1:4 SLOPE


Table with columns for PIPE DIA, DIMENSIONS (H, L, M, P, S, T, U, V, W, A, E), NO. OF SPACES (B, C, D), CONCRETE CLASS SI CU. YD., and REINF. BARS LB. Rows include pipe diameters 36, 42, 48, 54, and 60 inches.

DIMENSIONS AND QUANTITIES IN ONE HEADWALL TYPE III 1:6 SLOPE


Table with columns for PIPE DIA, DIMENSIONS (H, L, M, P, S, T, U, V, W, A, E), NO. OF SPACES (B, C, D), CONCRETE CLASS SI CU. YD., and REINF. BARS LB. Rows include pipe diameters 36, 42, 48, 54, and 60 inches.

DIMENSIONS AND QUANTITIES IN ONE HEADWALL TYPE III 1:10 SLOPE

Table with columns for PIPE DIA, DIMENSIONS (H, L, M, P, S, T, U, V, W, A, E), NO. OF SPACES (B, C, D), CONCRETE CLASS SI CU. YD., and REINF. BARS LB. Rows include pipe diameters 18, 24, 30, 36, 42, 48, 54, and 60 inches.



TYPE 1



TYPE 2

REINFORCEMENT BARS SCHEDULE FOR ONE HEADWALL TYPE III 1:10 SLOPE

Large reinforcement bars schedule table for 1:10 slope. Columns include PIPE DIA, MARK(E), TYPE, NO REQ'D, LENGTH, a, and b. Rows are organized by pipe diameter from 18" to 60".

REINFORCEMENT BARS SCHEDULE FOR ONE HEADWALL TYPE III 1:6 SLOPE

Large reinforcement bars schedule table for 1:6 slope. Columns include PIPE DIA, MARK(E), TYPE, NO REQ'D, LENGTH, a, and b. Rows are organized by pipe diameter from 36" to 60".

REINFORCEMENT BARS SCHEDULE FOR ONE HEADWALL TYPE III 1:4 SLOPE

Large reinforcement bars schedule table for 1:4 slope. Columns include PIPE DIA, MARK(E), TYPE, NO REQ'D, LENGTH, a, and b. Rows are organized by pipe diameter from 36" to 60".

REINFORCEMENT BARS SCHEDULE FOR ONE HEADWALL TYPE III 1:3 SLOPE

Large reinforcement bars schedule table for 1:3 slope. Columns include PIPE DIA, MARK(E), TYPE, NO REQ'D, LENGTH, a, and b. Rows are organized by pipe diameter from 36" to 60".

NOTES:

- 1. THE 'v', 'n' and 'j' BARS, TYPE 3, SHALL BE ORDERED FULL LENGTH AND CUT IN THE FIELD.
2. THE LONG LEG OF THE 'm' AND 'n' BARS SHALL BE VERTICAL.
3. QUANTITIES ON THIS DRAWING ARE BASED ON THE CAST-IN-PLACE DESIGN. SEE SHEET 4 IN THIS SERIES FOR ALTERNATE PRECAST CONCRETE NOTES.
4. "STR." = STRAIGHT BAR
5. ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).

* CUT BARS IN FIELD TO FIT MIN. 2" CLEARANCE
** PROVIDE 2'-0" MIN. LAP



HEADWALL TYPE III
18"-24"-30"-36"-42"-48"-54"-60"
FOR 1:3, 1:4, 1:6, AND
1:10 SLOPES

Paul Kovacs

APPROVED CHIEF ENGINEERING OFFICER DATE 5-1-2009

GRATE DIMENSIONS AND QUANTITIES IN ONE HEADWALL TYPE III END ENTRANCE 1:3 SLOPE

INSIDE PIPE DIAMETER	GRATES		BARS FOR ONE GRATE				HEADWALL GRATES (POUND)	
	NUMBER REQUIRED	TYPE REQ'D	BAR NO 1		BAR NO 2		EACH GRATE	TOTAL
			BARS REQ'D	LENGTH	BARS REQ'D	LENGTH		
36"	0	1	2	6'-7"	11	2'-4"	133	601
	3	2	2	6'-7"	11	1'-10"	124	
	2	3	2	6'-7"	11	1'-4"	115	
42"	0	1	2	7'-1"	12	2'-4"	144	772
	3	2	2	7'-1"	12	1'-10"	134	
	3	3	2	7'-1"	12	1'-4"	124	
48"	0	1	2	7'-7"	13	2'-4"	155	1062
	0	2	2	7'-7"	13	1'-10"	144	
	8	3	2	7'-7"	13	1'-4"	133	
54"	0	1	2	8'-1"	14	2'-4"	166	1170
	3	2	2	8'-1"	14	1'-10"	154	
	5	3	2	8'-1"	14	1'-4"	142	
60"	3	1	2	8'-7"	15	2'-4"	176	1283
	0	2	2	8'-7"	15	1'-10"	164	
	5	3	2	8'-7"	15	1'-4"	151	

GRATE DIMENSIONS AND QUANTITIES IN ONE HEADWALL TYPE III END ENTRANCE 1:4 SLOPE

INSIDE PIPE DIAMETER	GRATES		BARS FOR ONE GRATE				HEADWALL GRATES (POUND)	
	NUMBER REQUIRED	TYPE REQ'D	BAR NO 1		BAR NO 2		EACH GRATE	TOTAL
			BARS REQ'D	LENGTH	BARS REQ'D	LENGTH		
36"	5	1	2	6'-7"	11	2'-4"	133	666
	0	2	2	6'-7"	11	1'-10"	124	
	0	3	2	6'-7"	11	1'-4"	115	
42"	1	1	2	7'-1"	12	2'-4"	144	947
	6	2	2	7'-1"	12	1'-10"	134	
	0	3	2	7'-1"	12	1'-4"	124	
48"	1	1	2	7'-7"	13	2'-4"	155	1161
	7	2	2	7'-7"	13	1'-10"	144	
	0	3	2	7'-7"	13	1'-4"	133	
54"	1	1	2	8'-1"	14	2'-4"	166	1395
	8	2	2	8'-1"	14	1'-10"	154	
	0	3	2	8'-1"	14	1'-4"	142	
60"	0	1	2	8'-7"	15	2'-4"	176	1961
	0	2	2	8'-7"	15	1'-10"	164	
	13	3	2	8'-7"	15	1'-4"	151	

GRATE DIMENSIONS AND QUANTITIES IN ONE HEADWALL TYPE III END ENTRANCE 1:10 SLOPE



INSIDE PIPE DIAMETER	GRATES		BARS FOR ONE GRATE				HEADWALL GRATES (POUND)	
	NUMBER REQUIRED	TYPE REQ'D	BAR NO 1		BAR NO 2		EACH GRATE	TOTAL
			BARS REQ'D	LENGTH	BARS REQ'D	LENGTH		
18"	3	1	2	3'-7"	5	2'-4"	69	528
	5	2	2	3'-7"	5	1'-10"	64	
	0	3	2	3'-7"	5	1'-4"	60	
24"	0	1	2	4'-7"	7	2'-4"	90	1096
	0	2	2	4'-7"	7	1'-10"	84	
	14	3	2	4'-7"	7	1'-4"	78	
30"	7	1	2	5'-7"	9	2'-4"	112	1302
	5	2	2	5'-7"	9	1'-10"	104	
	0	3	2	5'-7"	9	1'-4"	96	
36"	8	1	2	6'-7"	11	2'-4"	133	1810
	6	2	2	6'-7"	11	1'-10"	124	
	0	3	2	6'-7"	11	1'-4"	115	
42"	15	1	2	7'-1"	12	2'-4"	144	2161
	0	2	2	7'-1"	12	1'-10"	134	
	0	3	2	7'-1"	12	1'-4"	124	
48"	0	1	2	7'-7"	13	2'-4"	155	3019
	21	2	2	7'-7"	13	1'-10"	144	
	0	3	2	7'-7"	13	1'-4"	133	
54"	19	1	2	8'-1"	14	2'-4"	166	3146
	0	2	2	8'-1"	14	1'-10"	154	
	0	3	2	8'-1"	14	1'-4"	142	
60"	20	1	2	8'-7"	15	2'-4"	176	3691
	1	2	2	8'-7"	15	1'-10"	164	
	0	3	2	8'-7"	15	1'-4"	151	

GRATE DIMENSIONS AND QUANTITIES IN ONE HEADWALL TYPE III END ENTRANCE 1:6 SLOPE

INSIDE PIPE DIAMETER	GRATES		BARS FOR ONE GRATE				HEADWALL GRATES (POUND)	
	NUMBER REQUIRED	TYPE REQ'D	BAR NO 1		BAR NO 2		EACH GRATE	TOTAL
			BARS REQ'D	LENGTH	BARS REQ'D	LENGTH		
36"	0	1	2	6'-7"	11	2'-4"	133	1375
	0	2	2	6'-7"	11	1'-10"	124	
	12	3	2	6'-7"	11	1'-4"	115	
42"	0	1	2	7'-1"	12	2'-4"	144	1731
	0	2	2	7'-1"	12	1'-10"	134	
	14	3	2	7'-1"	12	1'-4"	124	
48"	0	1	2	7'-7"	13	2'-4"	155	2123
	0	2	2	7'-7"	13	1'-10"	144	
	16	3	2	7'-7"	13	1'-4"	133	
54"	0	1	2	8'-1"	14	2'-4"	166	2340
	6	2	2	8'-1"	14	1'-10"	154	
	10	3	2	8'-1"	14	1'-4"	142	
60"	0	1	2	8'-7"	15	2'-4"	176	2892
	2	2	2	8'-7"	15	1'-10"	164	
	17	3	2	8'-7"	15	1'-4"	151	

NOTES:

- ALL STRUCTURAL STEEL SHALL BE AASHTO M270, GRADE 36 OR 50.
- GALVANIZING SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.
- FOR PLACEMENT OF GRATES, SEE SHEET 1 IN THIS SERIES.
- ALL TABLE DIMENSIONS AND QUANTITIES ARE FOR SINGLE HEADWALL, TYPE III.
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- GRATING IS DESIGNED FOR A TRANSVERSING LOAD OF 1,800 POUNDS AT YIELD.

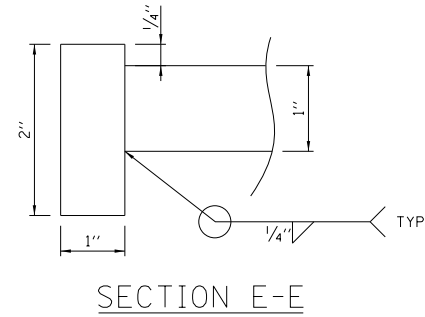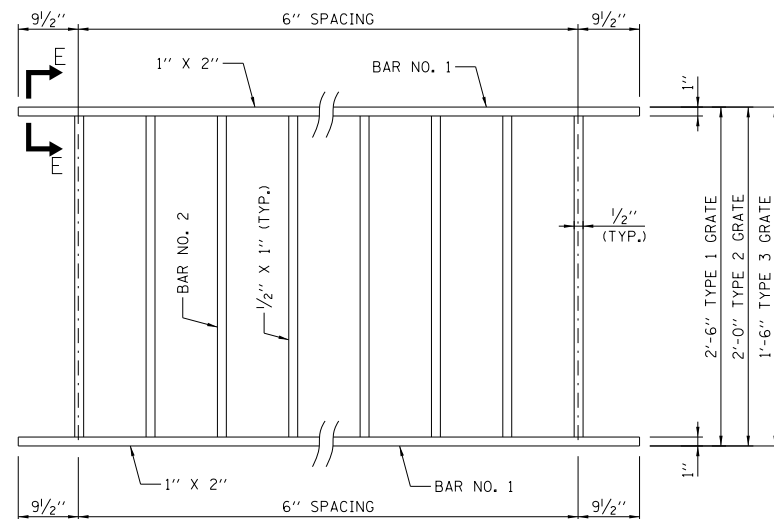


TYPICAL GRATE


APPROVED: *Paul Kovacs* DATE 5-1-2009
CHIEF ENGINEERING OFFICER



HEADWALL TYPE III
18"-24"-30"-36"-42"-48"-54"-60"
FOR 1:3, 1:4, 1:6, AND
1:10 SLOPES

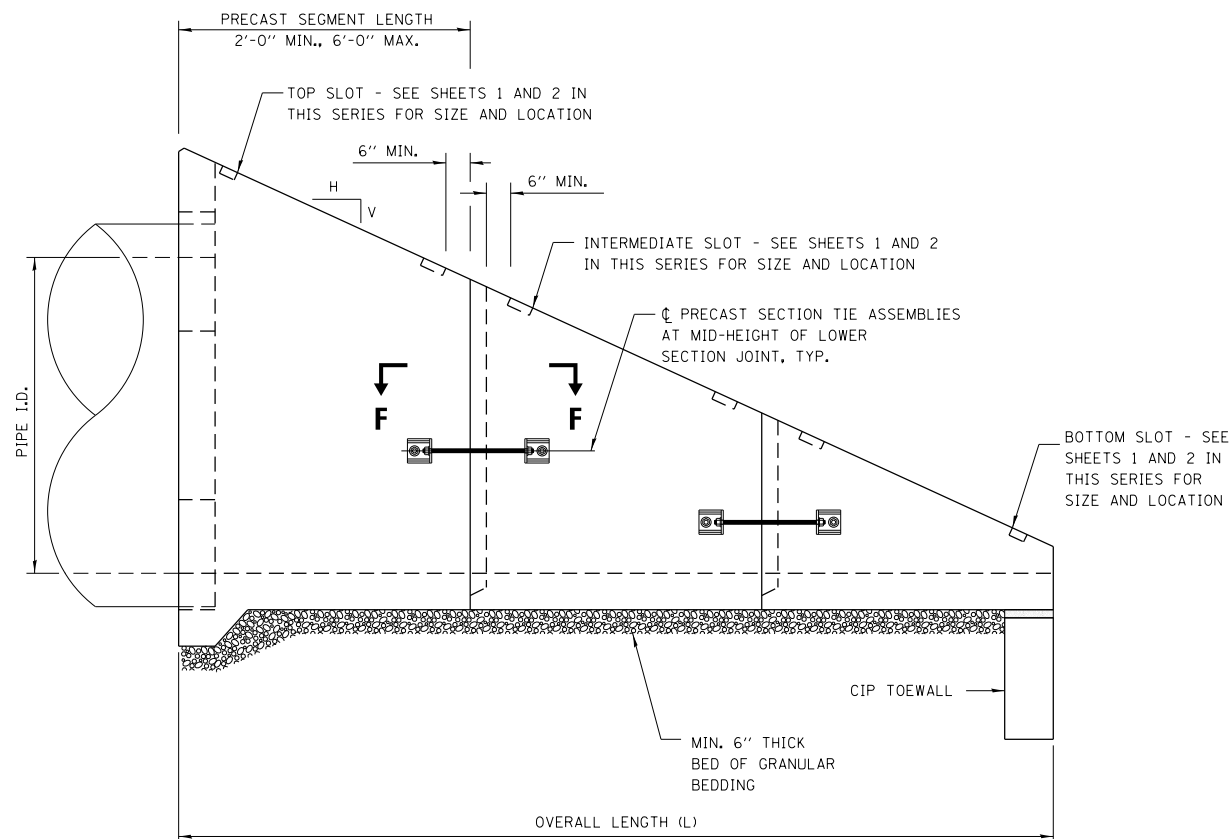


ELEVATION

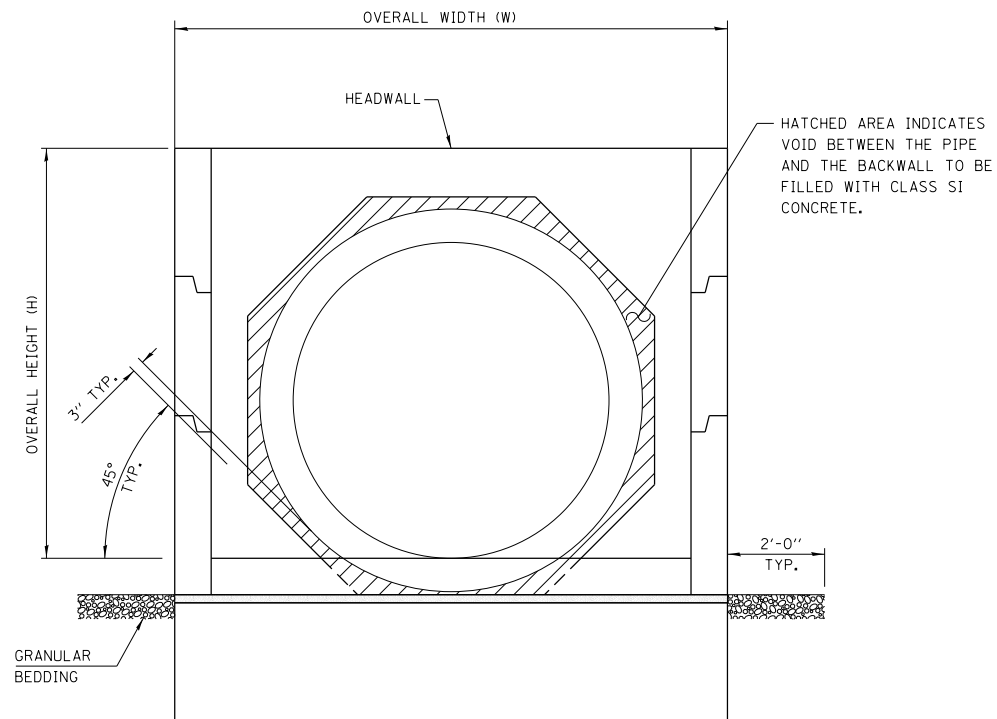


END VIEW

GENERAL NOTES:


1. THE NUMBER OF SEGMENTS SHOWN IN ELEVATION IS FOR EXAMPLE ONLY. THE LENGTH AND NUMBER OF PRECAST SECTIONS REQUIRED TO CONSTRUCT THE END SECTION SHALL BE DETERMINED BY THE CONTRACTOR.
2. CONTRACTOR SHALL RETAIN THE SERVICES OF AN ILLINOIS LICENSED STRUCTURAL ENGINEER TO PROPORTION, DESIGN AND DETAIL PRECAST SECTIONS FOR INSTALLATION AND FOR SERVICE. SEE CAST-IN-PLACE DIMENSIONS AND REINFORCING DETAILS FOR MINIMUM REQUIREMENTS. INCREASE MEMBER SIZES AND REINFORCING AS NECESSARY TO SATISFY HANDLING AND INSTALLATION STRESSES IN PRECAST SECTIONS.
3. CLASS "SI" CONCRETE SHALL BE USED THROUGHOUT.
4. REINFORCEMENT BARS (GRADE 60) SHALL BE EPOXY COATED. SEE CAST-IN-PLACE DETAILS FOR BENDING DIAGRAMS. SEE NOTES ON SHEET 1 IN THIS SERIES FOR REINFORCING COVER REQUIREMENTS.
5. ALL EXPOSED EDGES SHALL BE CHAMFERED. SEE NOTES ON SHEET 1 IN THIS SERIES.
6. SEE ROADWAY PLANS FOR SLOPE (V:H) AND PIPE INSIDE DIAMETER.
7. HOLES IN THE WALLS FOR THE PRECAST TIE ASSEMBLY MAY BE DRILLED USING CORE BITS IN LIEU OF FORMED HOLES. AVOID DAMAGE TO REINFORCING FROM DRILLING HOLES.
8. FOR STEEL GRATING DETAILS, SEE SHEET 3 IN THIS SERIES.
9. ALL SLOPE RATIOS ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
10. TIE ASSEMBLIES, CONSISTING OF ANCHOR RODS, TIE PLATES, RESTRAINT ANGLES, RESTRAINT RODS AND ALL NUTS AND WASHERS SHALL CONFORM WITH AASHTO M270 GR36, OR GR50 AND SHALL BE HOT DIPPED GALVANIZED IN ACCORDANCE WITH AASHTO M 111 AFTER FABRICATION.

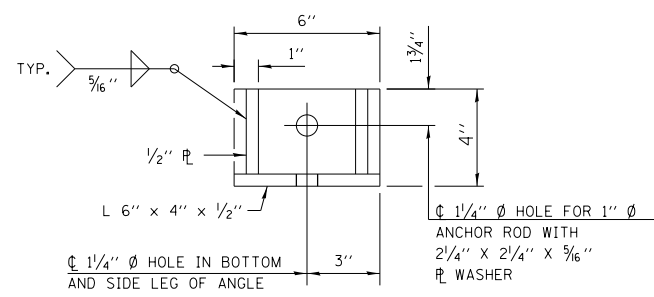


RESTRAINT ANGLE DETAIL

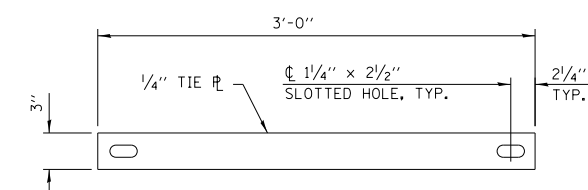


TIE PLATE DETAIL

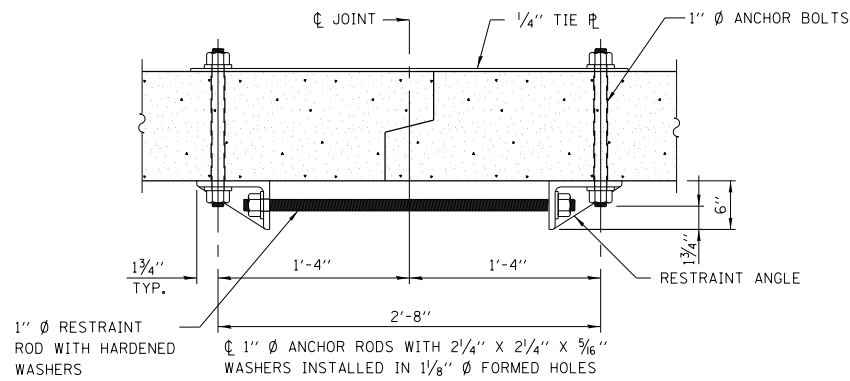

SECTION F-F (SHOWING PRECAST SECTION TIE DETAILS)

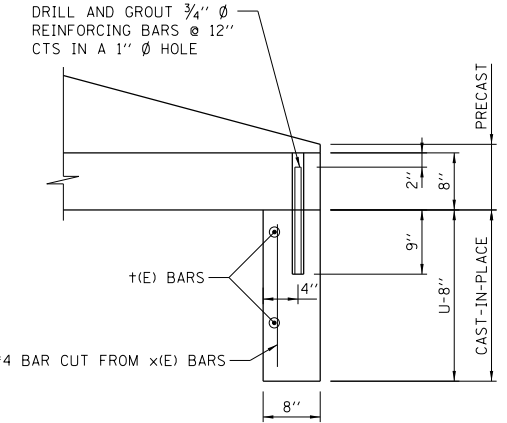

PRECAST CONNECTION DETAIL

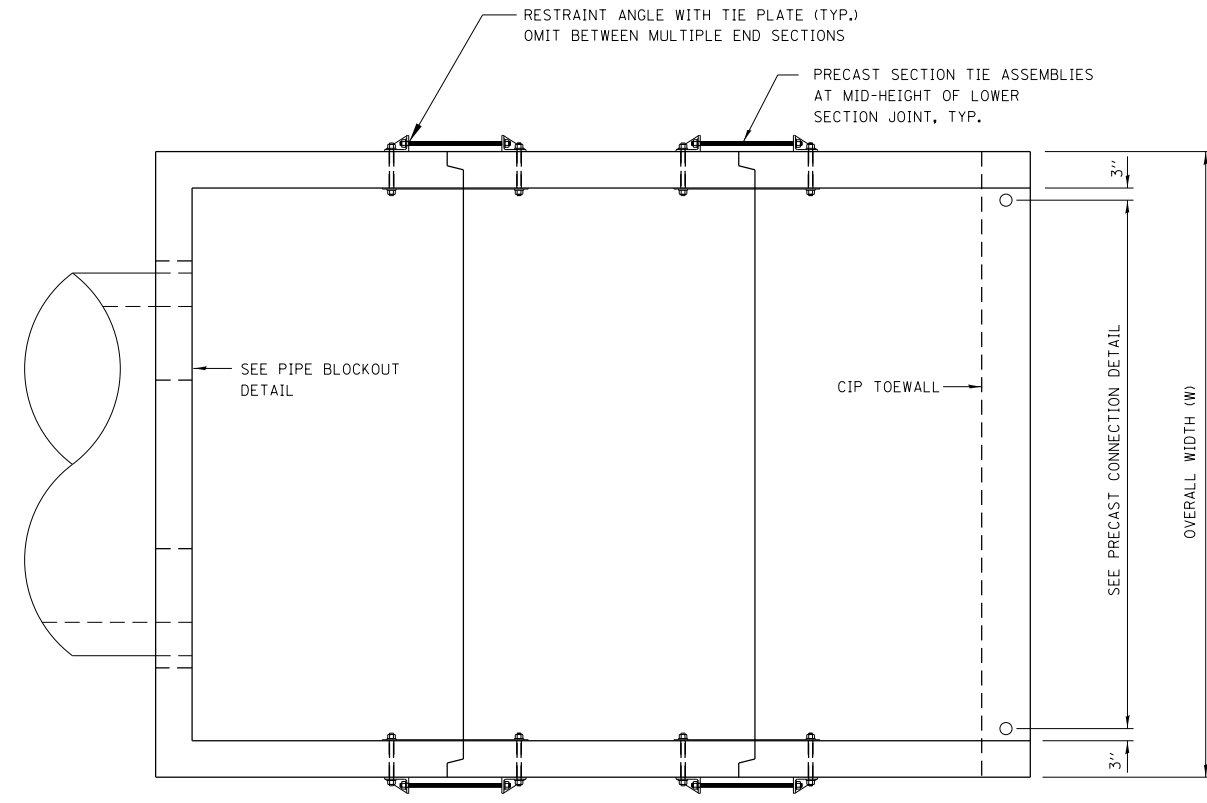


PLAN


APPROVED *Paul Kovacs* DATE 5-1-2009
CHIEF ENGINEERING OFFICER

HEADWALL TYPE III ALTERNATE PRECAST CONCRETE DETAILS

HEADWALL TYPE III
18"-24"-30"-36"-42"-48"-54"-60"
FOR 1:3, 1:4, 1:6, AND
1:10 SLOPES
STANDARD B6-09

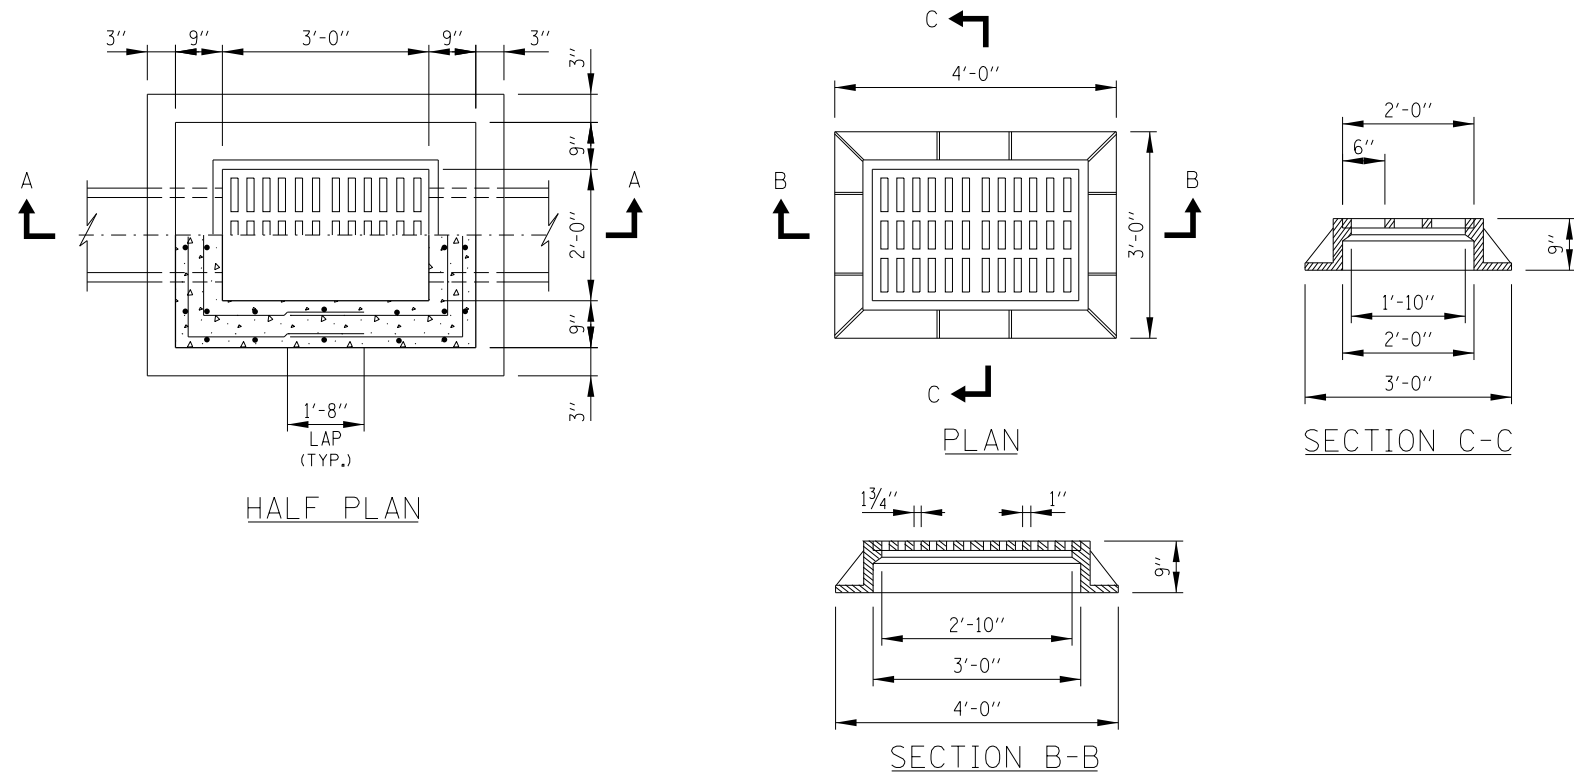


FRAME AND GRATE DETAIL

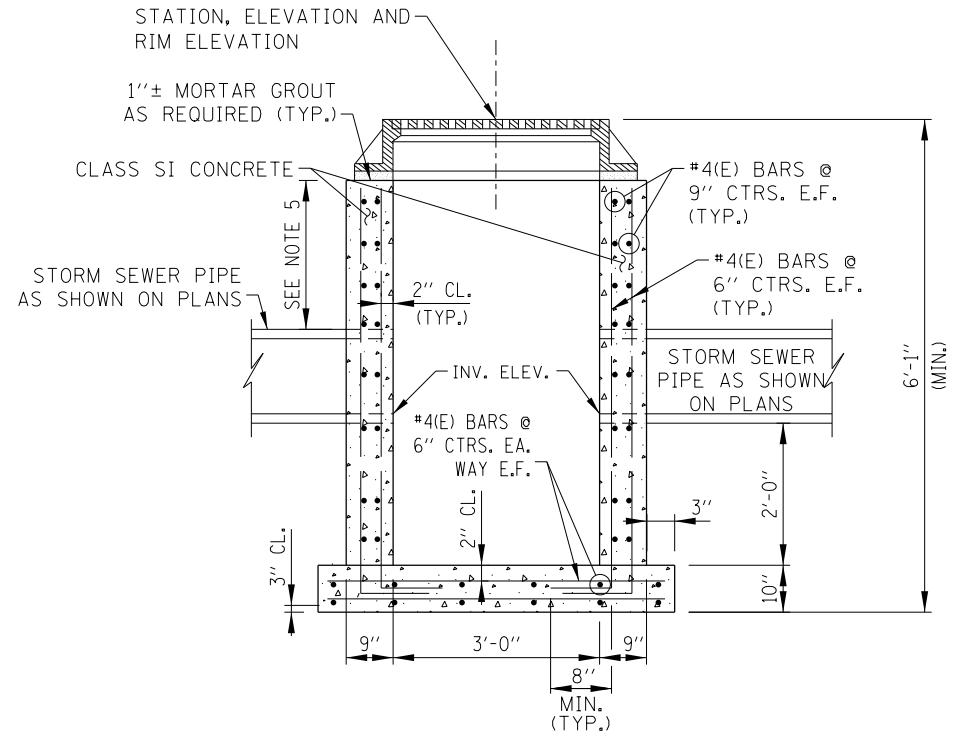

SECTION A-A


CATCH BASIN TYPE B

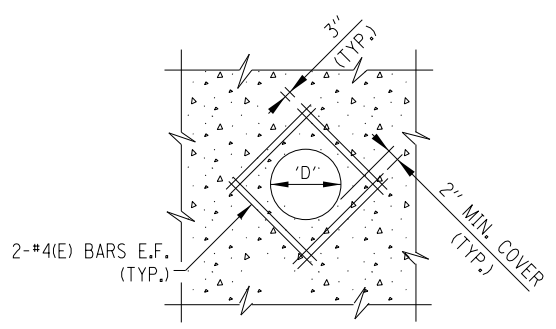

TYPICAL REINFORCEMENT AROUND STORM SEWER PIPE


NOTES:

1. FOR MATERIALS AND CONSTRUCTION REQUIREMENTS OF THE CATCH BASIN, REFER TO THE STANDARD SPECIFICATIONS.
2. FRAME AND GRATE FOR CATCH BASIN TYPE B SHALL BE NEENAH FOUNDRY COMPANY TYPE R-3455C, EAST JORDAN IRON WORKS V5360-1 OR APPROVED EQUAL.
3. REINFORCEMENT BARS DESIGNATED (E) SHALL BE EPOXY COATED.
4. THE CONTRACTOR SHALL CLEARLY MARK EACH CATCH BASIN WITH "ILLINOIS TOLLWAY", CONTRACT NUMBER, STRUCTURE NUMBER, PRODUCER NAME AND DATE OF MANUFACTURE. THIS INFORMATION SHALL BE MARKED ON THE OUTSIDE FACE OF THE STRUCTURE IN A VISIBLE SURFACE AS DESIGNATED BY THE ENGINEER. THE MARKING SHALL BE PAINTED/STAMPED IN THE STRUCTURE WITH WATERPROOF PAINT/INK OR RECESSED IN THE STRUCTURE BY 1/2". THE LETTERS SHALL BE CAPITALS, NOT LESS THAN 2 IN. AND NOT MORE THAN 3 IN. IN HEIGHT.
5. A MINIMUM OF 9" OF MONOLITHIC REINFORCED CONCRETE SHALL BE MAINTAINED ABOVE PIPE PENETRATION HOLES >15".



 APPROVED, CHIEF ENGINEERING OFFICER
 DATE 2-7-2012

DATE	REVISIONS
3-01-2022	ADDED NOTES FOR MARKINGS AND MINIMUM 9" ABOVE PIPE PENETRATION HOLES
3-01-2020	REVISED TYPICAL REINFORCEMENT AROUND PIPE
3-11-2015	SLOPE DRAIN CHANGE TO BASE SHEET
03-31-14	REVISED SLOPE DRAIN ALSO FRAME AND GRATE CASTINGS



 CATCH BASIN, TYPE B
 STANDARD B7-05

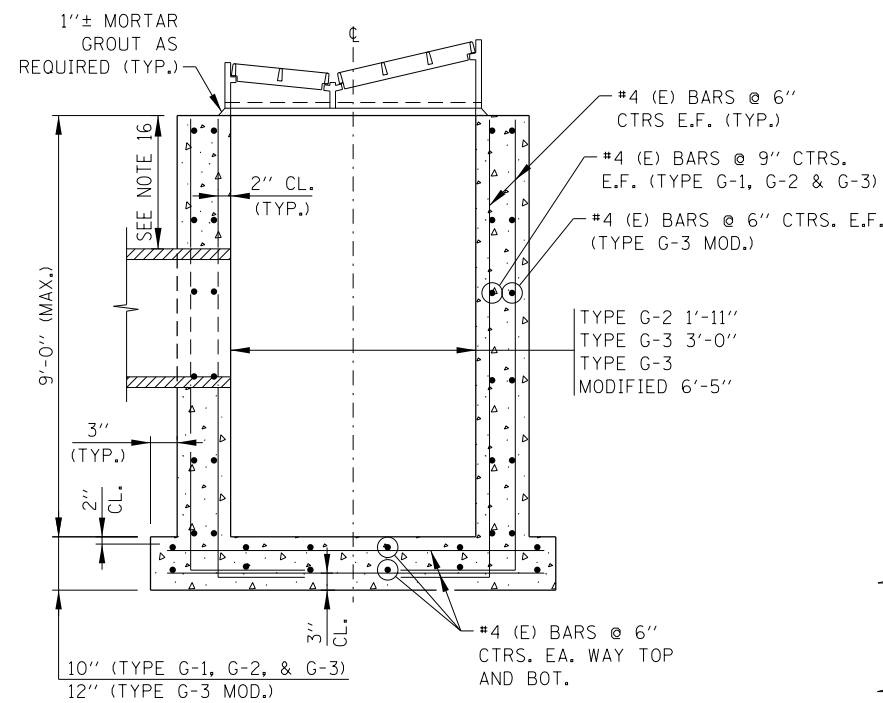


SECTION A-A

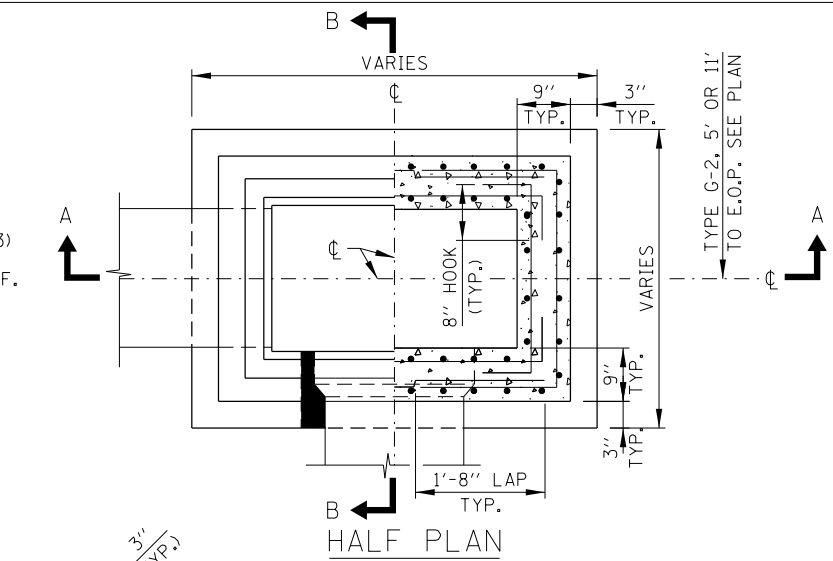


HALF PLAN

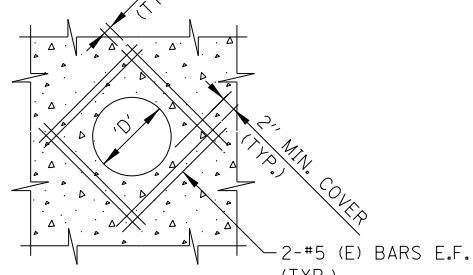

TYPICAL REINFORCEMENT AROUND STORM SEWER PIPE

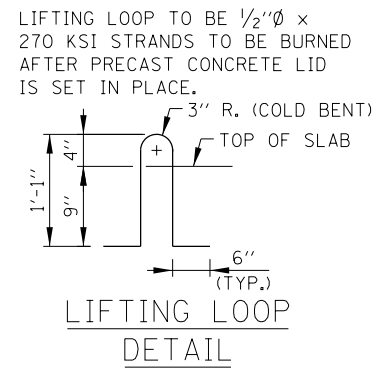


LIFTING LOOP DETAIL

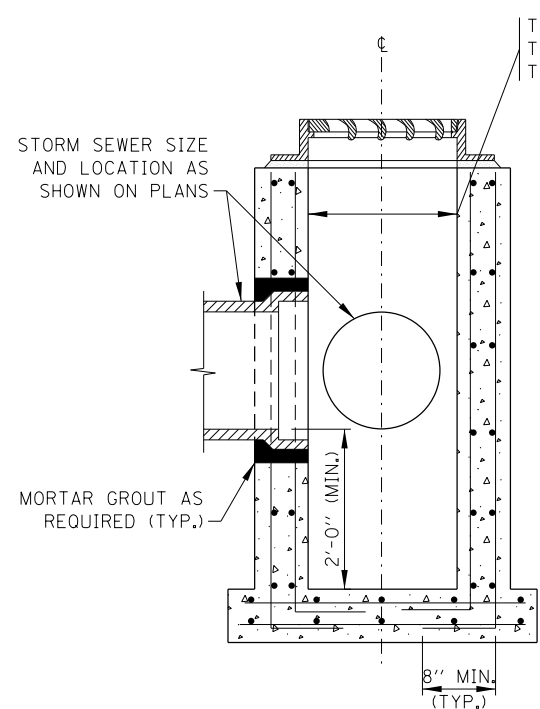


SECTION B-B
CATCH BASIN TYPE "G" SERIES

NOTES:


1. PRECAST CONCRETE UNITS WILL BE ACCEPTABLE PROVIDED THEY MEET ALL THE REQUIREMENTS AS SHOWN ON THIS DRAWING. BASE EXTENSION OF 3" NOT REQUIRED FOR PRECAST UNITS. FABRICATION DRAWINGS SHOWING PIPE OPENINGS, REINFORCEMENT AND OTHER PERTINENT DIMENSIONS WILL BE REQUIRED FOR EACH UNIT, FOR APPROVAL BY THE ENGINEER PRIOR TO FABRICATION.
2. CATCH BASIN, TYPE G-2 SHALL BE USED ALONG RAMPS WHERE GUTTER TYPE G-2 IS PROVIDED.
3. CATCH BASIN, TYPE G-3 SHALL BE USED WHERE GUTTER TYPE G-3 IS PROVIDED.
4. CATCH BASIN, TYPE G-3 MODIFIED SHALL BE USED IN PAVEMENT SECTIONS AND ON THE LOW SIDE OF SUPERELEVATED PAVEMENT.
5. CATCH BASIN, TYPE G-3 MODIFIED SHALL BE PROVIDED WITH A REINFORCED CONCRETE SLAB TOP AS DETAILED ON THIS DRAWING.
6. TYPE G-2 FRAME AND GRATE SHALL BE NEENAH R-3508-A2, EAST JORDAN IRON WORKS 7300 OR APPROVED EQUAL.
7. TYPE G-3 FRAME AND GRATE SHALL BE NEENAH INLET FOR ROLL TYPE CURB R-3501-U OR EAST JORDAN IRON WORKS 7545 OR APPROVED EQUAL.
8. TYPE G-3, MODIFIED FRAME AND GRATE SHALL BE NEENAH INLET FOR ROLL TYPE CURB SPECIAL R-3501-U1, EAST JORDAN IRON WORKS 7546 OR APPROVED EQUAL.
9. TYPE G-2, MODIFIED FRAME AND GRATE FOR ROLL TYPE CURB R-3508-B2 OR APPROVED EQUAL.
10. MORTAR OR SEALER SHALL BE USED WHEN A PRECAST REINFORCED CONCRETE LID IS USED.
11. REINFORCEMENT BARS DESIGNATED (E) SHALL BE EPOXY COATED.
12. E.O.P. = EDGE OF PAVEMENT.
13. ALL CONCRETE SHALL BE CLASS SI CONCRETE.
14. FRAME AND GRATE RIM ELEVATION AND OFFSET MEASURED AT THE EDGE OF SHOULDER.
15. THE CONTRACTOR SHALL CLEARLY MARK EACH CATCH BASIN WITH "ILLINOIS TOLLWAY", CONTRACT NUMBER, STRUCTURE NUMBER, PRODUCER NAME AND DATE OF MANUFACTURE. THIS INFORMATION SHALL BE MARKED ON THE OUTSIDE FACE OF THE STRUCTURE IN A VISIBLE SURFACE AS DESIGNATED BY THE ENGINEER. THE MARKING SHALL BE PAINTED/STAMPED IN THE STRUCTURE WITH WATERPROOF PAINT/INK OR RECESSED IN THE STRUCTURE BY 1/2". THE LETTERS SHALL BE CAPITALS, NOT LESS THAN 2 IN. AND NOT MORE THAN 3 IN. IN HEIGHT.
16. A MINIMUM OF 9" OF MONOLITHIC REINFORCED CONCRETE SHALL BE MAINTAINED ABOVE PIPE PENETRATION HOLES >15".

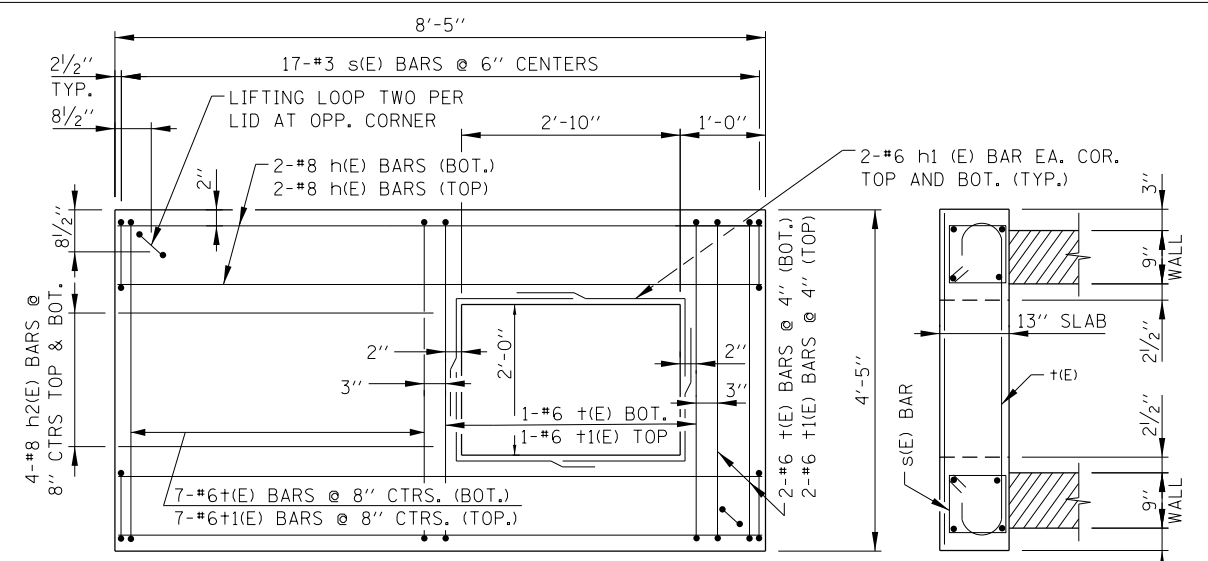

REINFORCED CONCRETE LID
TYPE G-3 FRAME AND GRATE
CATCH BASIN, TYPE G-3, MODIFIED

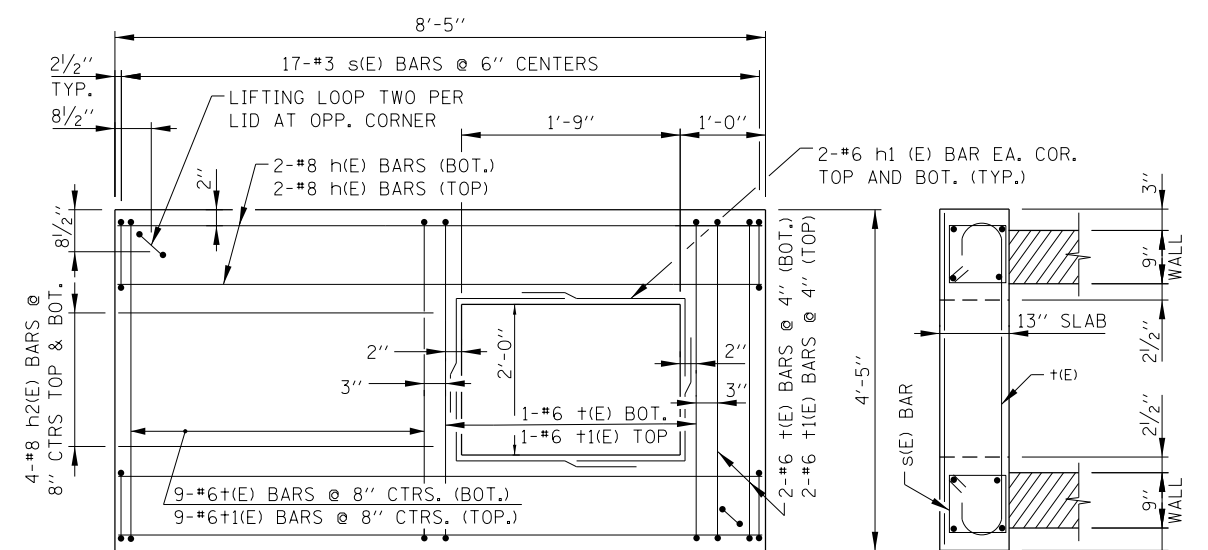

REINFORCED CONCRETE LID
TYPE 20A FRAME AND GRATE
CATCH BASIN, TYPE G-3, MODIFIED

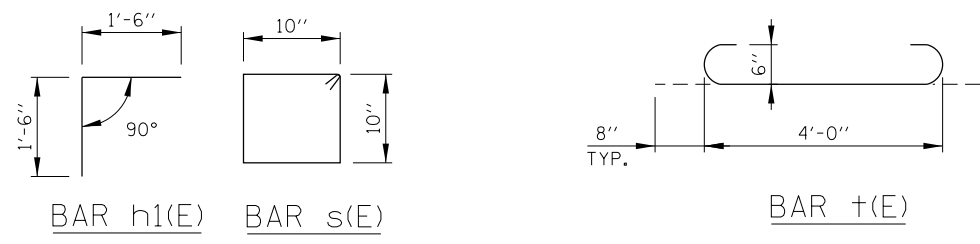

NOTE:

POSITION OF OPENING VARIES FROM 3'-2" TO 5'-4" MEASURED FROM BACK OF GUTTER LINE.


APPROVED: *Paul Kovacs* CHIEF ENGINEERING OFFICER DATE 6-1-2009




DATE	REVISIONS
3-01-2022	ADDED NOTES FOR MARKINGS AND MINIMUM 9" ABOVE PIPE PENETRATION HOLES
3-01-2020	ADDED TYPE 20A FRAME AND GRATE OPTION FOR CATCH BASIN, TYPE G-3, MODIFIED
3-01-2019	NOTED MAXIMUM HEIGHT, AND PROVIDED RIM ELEVATION AND OFFSET LOCATION FOR CATCH BASINS TYPE G-2, G-3, AND G-3 MODIFIED
3-11-2015	REVISED NOTES AND ADDED CATCH BASIN TYPE G-4 AND TYPE G-5

CATCH BASINS TYPE G AND TYPE G-3 MODIFIED, FRAMES AND GRATES


STANDARD B8-08

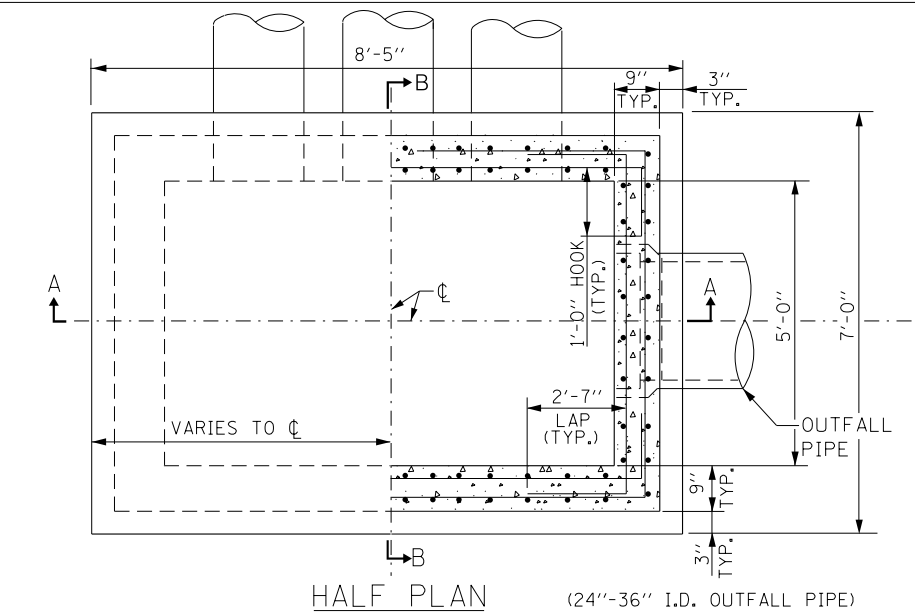



HALF PLAN (24" TO 36" I.D. OUTFALL PIPE)

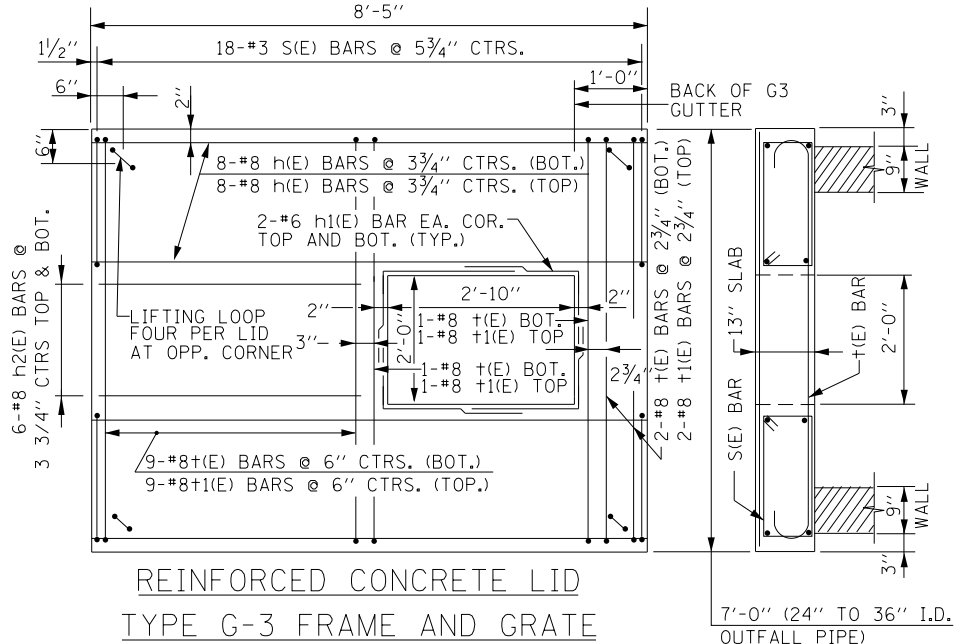

REINFORCED CONCRETE LID TYPE G-3 FRAME AND GRATE

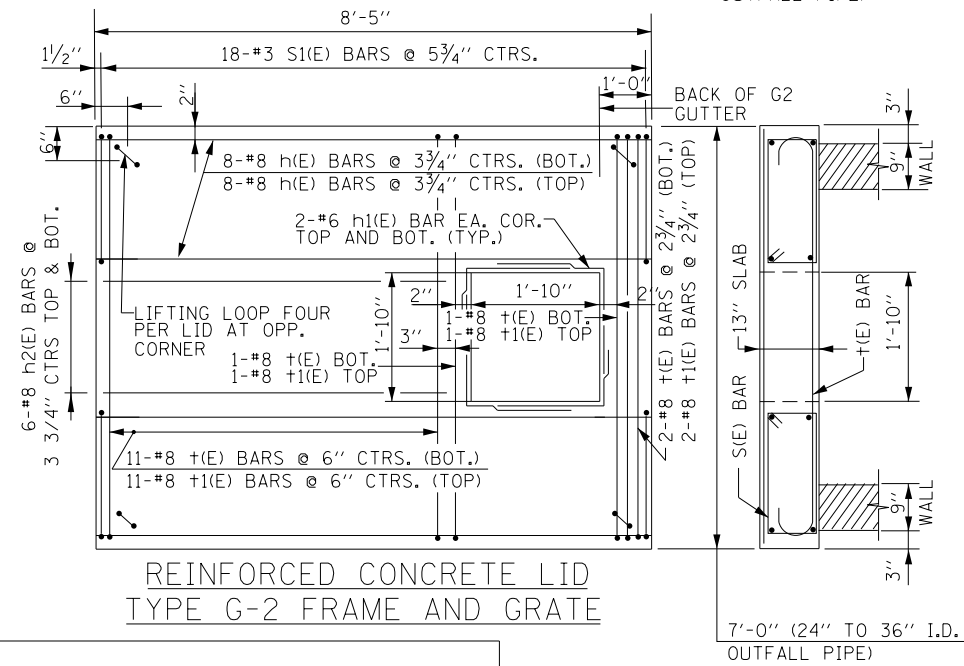


REINFORCED CONCRETE LID TYPE G-2 FRAME AND GRATE

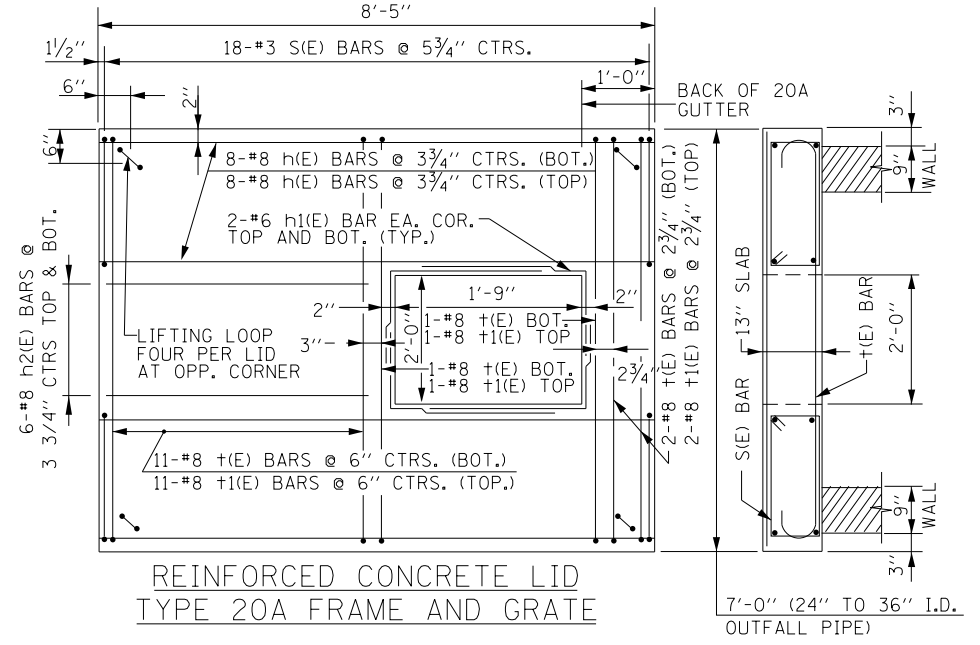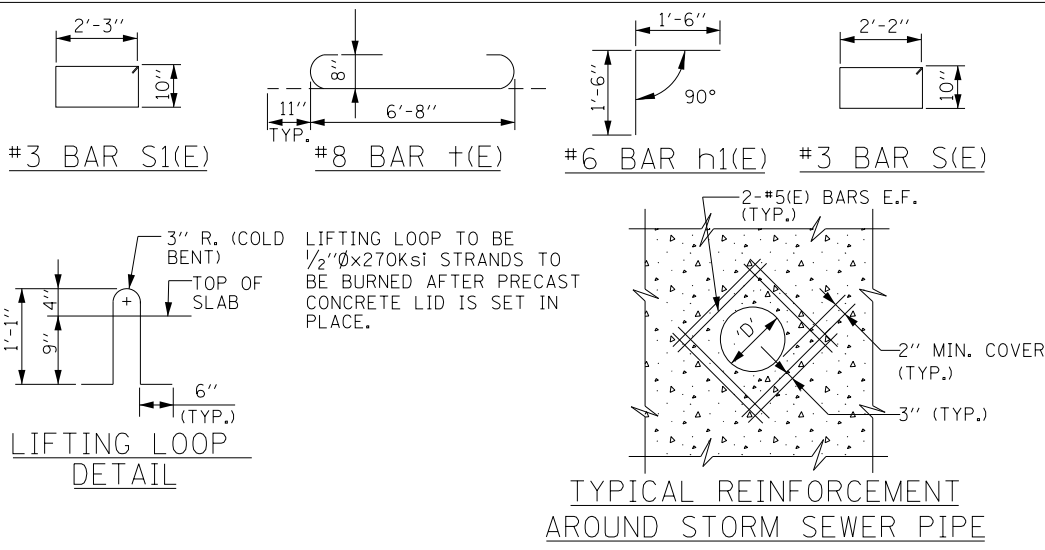


CATCH BASIN TYPE G-4

NOTES:

- SEE SHEET 1 OF THIS SERIES FOR ADDITIONAL NOTES.
- CATCH BASINS TYPE G-4 SHALL BE USED IN TANGENT SECTIONS AND ON THE LOW SIDE OF SUPERELEVATED PAVEMENT.
- CATCH BASINS TYPE G-4 SHALL BE PROVIDED WITH A REINFORCED CONCRETE SLAB TOP AS DETAILED ON THIS DRAWING.
- CATCH BASINS TYPE G-4 SHALL BE USED WHEN GUTTER, TYPE G-3 IS PROVIDED.
- MORTAR OR SEALER SHALL BE USED WHEN A PRECAST REINFORCED CONCRETE LID IS USED.
- FRAME AND GRATE RIM ELEVATION AND OFFSET MEASURED AT THE EDGE OF SHOULDER.
- 36" Ø MAX. OUTFALL PIPE FOR TYPE G-4 CATCH BASIN.
- ALL CONCRETE SHALL BE CLASS SI CONCRETE.
- DISTANCE FROM CL OUTFALL PIPE TO CL ROADWAY TO BE VERIFIED BY ENGINEER.
- THE CONTRACTOR SHALL CLEARLY MARK EACH CATCH BASIN WITH "ILLINOIS TOLLWAY", CONTRACT NUMBER, STRUCTURE NUMBER, PRODUCER NAME AND DATE OF MANUFACTURE. THIS INFORMATION SHALL BE MARKED ON THE OUTSIDE FACE OF THE STRUCTURE IN A VISIBLE SURFACE AS DESIGNATED BY THE ENGINEER. THE MARKING SHALL BE PAINTED/STAMPED IN THE STRUCTURE WITH WATERPROOF PAINT/INK OR RECESSED IN THE STRUCTURE BY 1/2". THE LETTERS SHALL BE CAPITALS, NOT LESS THAN 2 IN. AND NOT MORE THAN 3 IN. IN HEIGHT.
- A MINIMUM OF 9" OF MONOLITHIC REINFORCED CONCRETE SHALL BE MAINTAINED ABOVE PIPE PENETRATION HOLES >15".

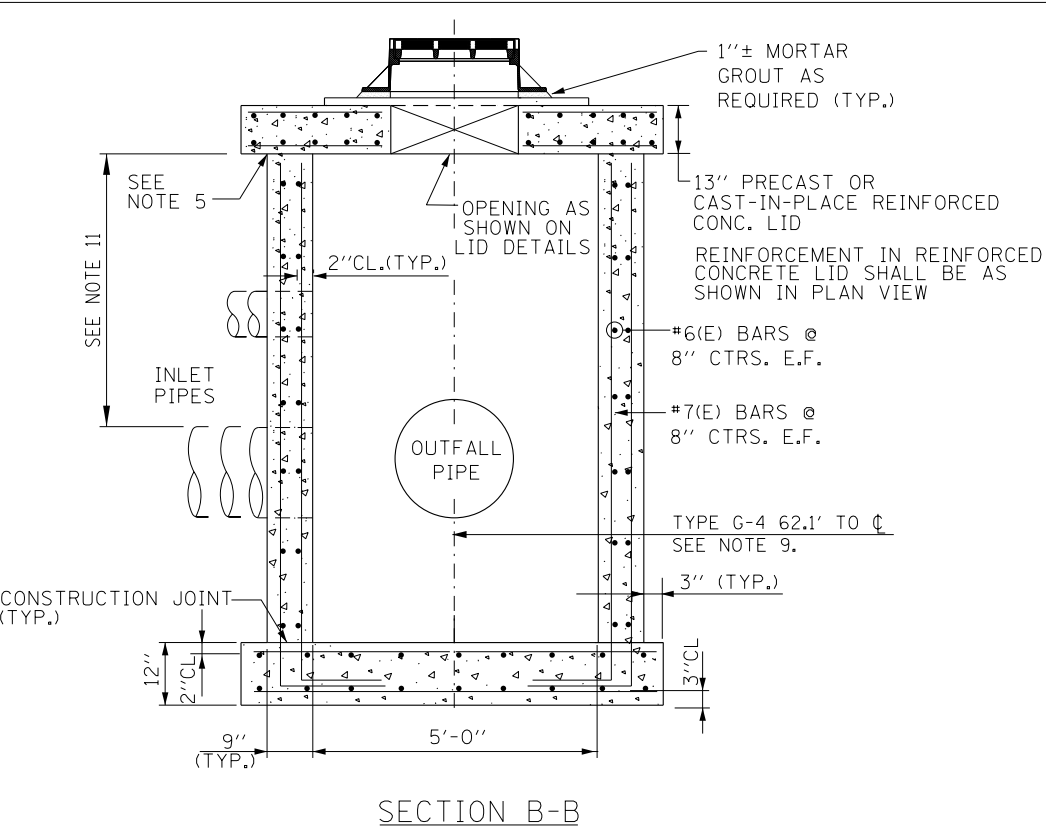








SECTION B-B

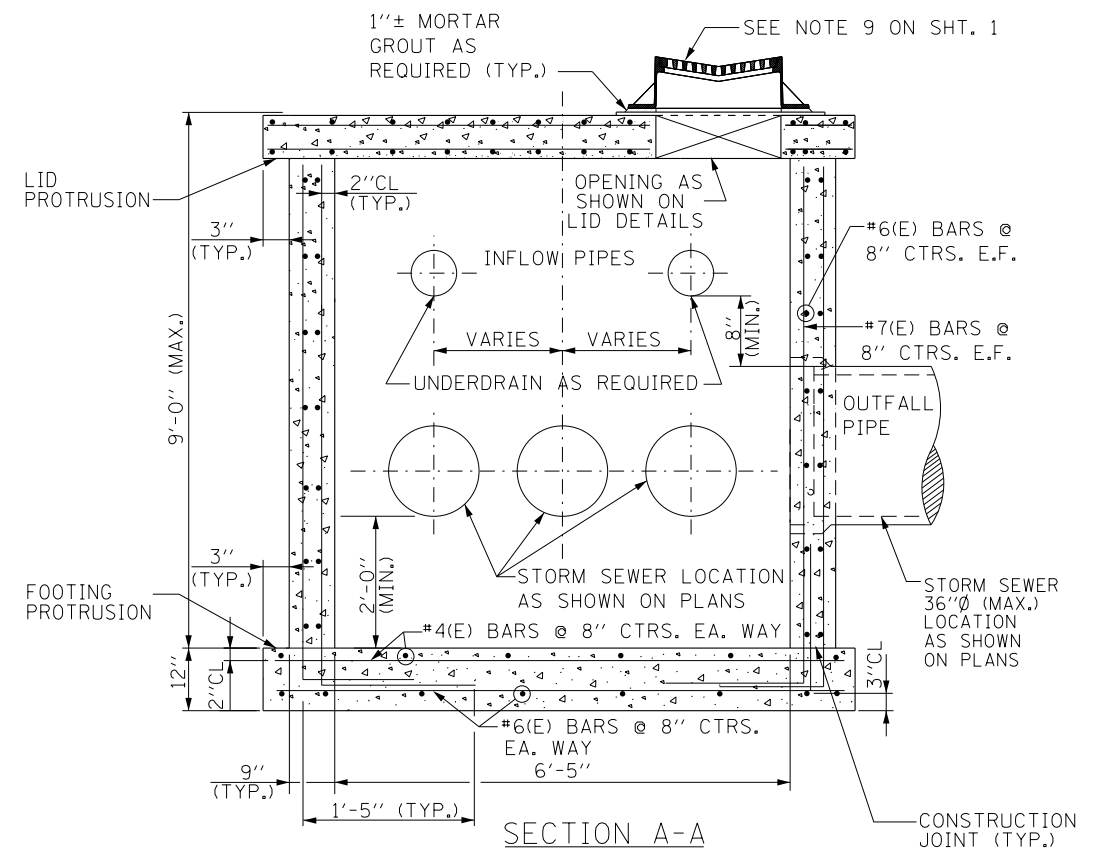

SECTION A-A

APPROVED: *Paul Kovacs* DATE 6-1-2009
 CHIEF ENGINEERING OFFICER

CATCH BASINS TYPE G AND TYPE G-3 MODIFIED, FRAMES AND GRATES
 STANDARD B8-08

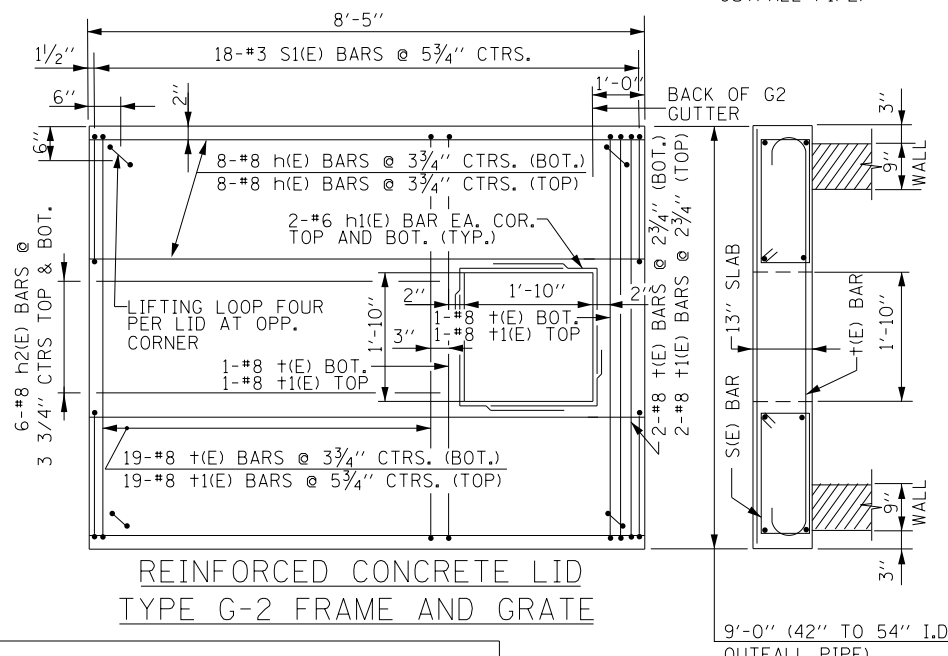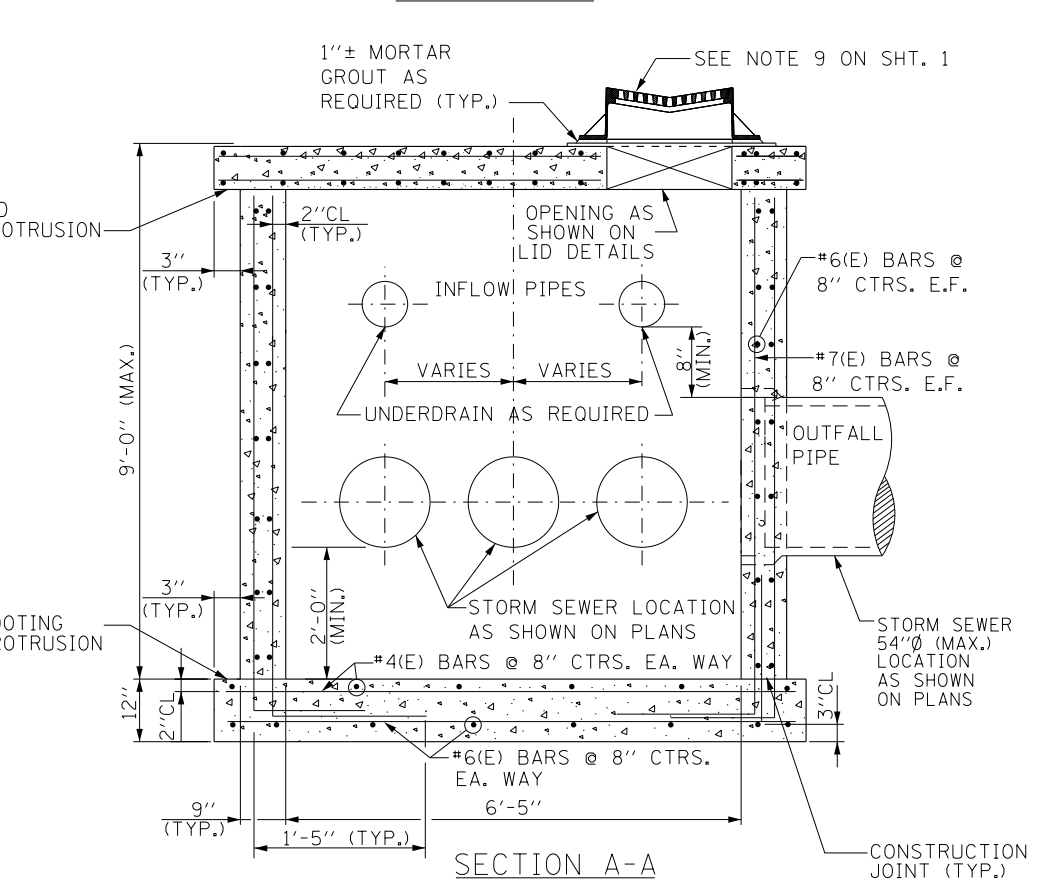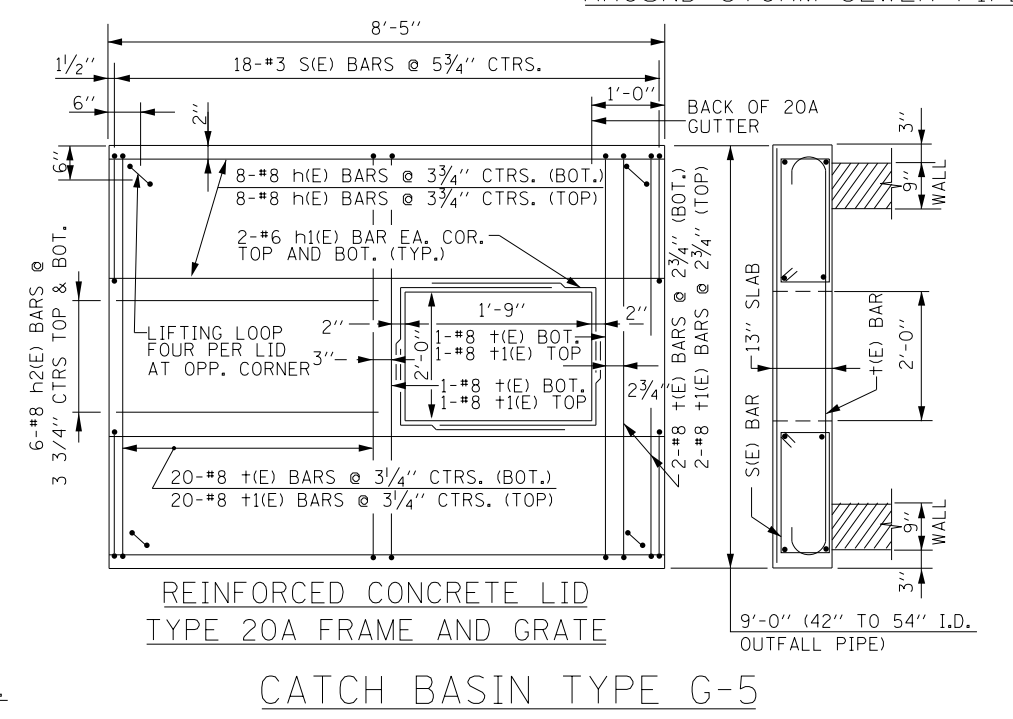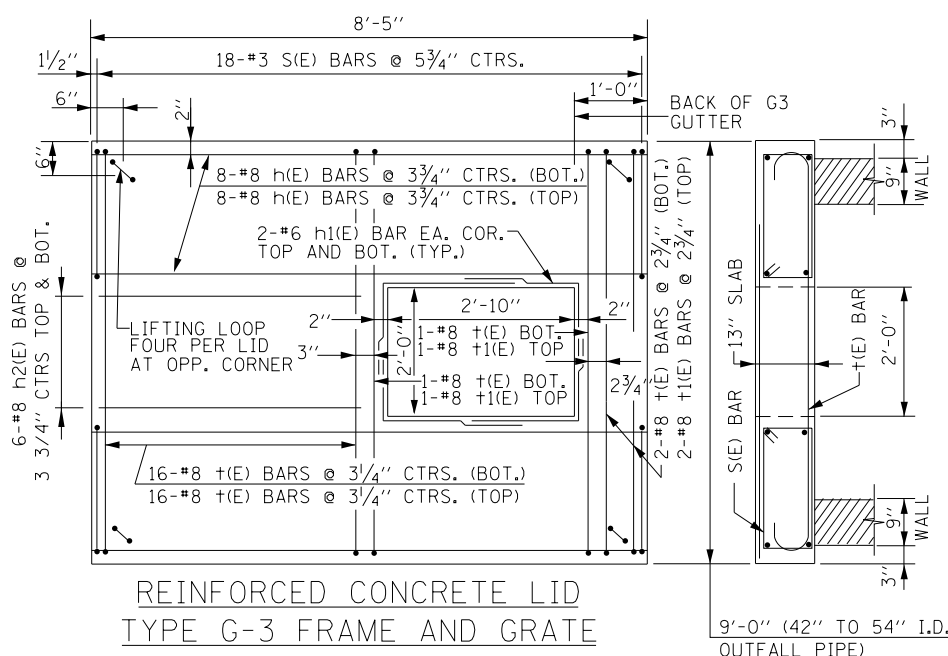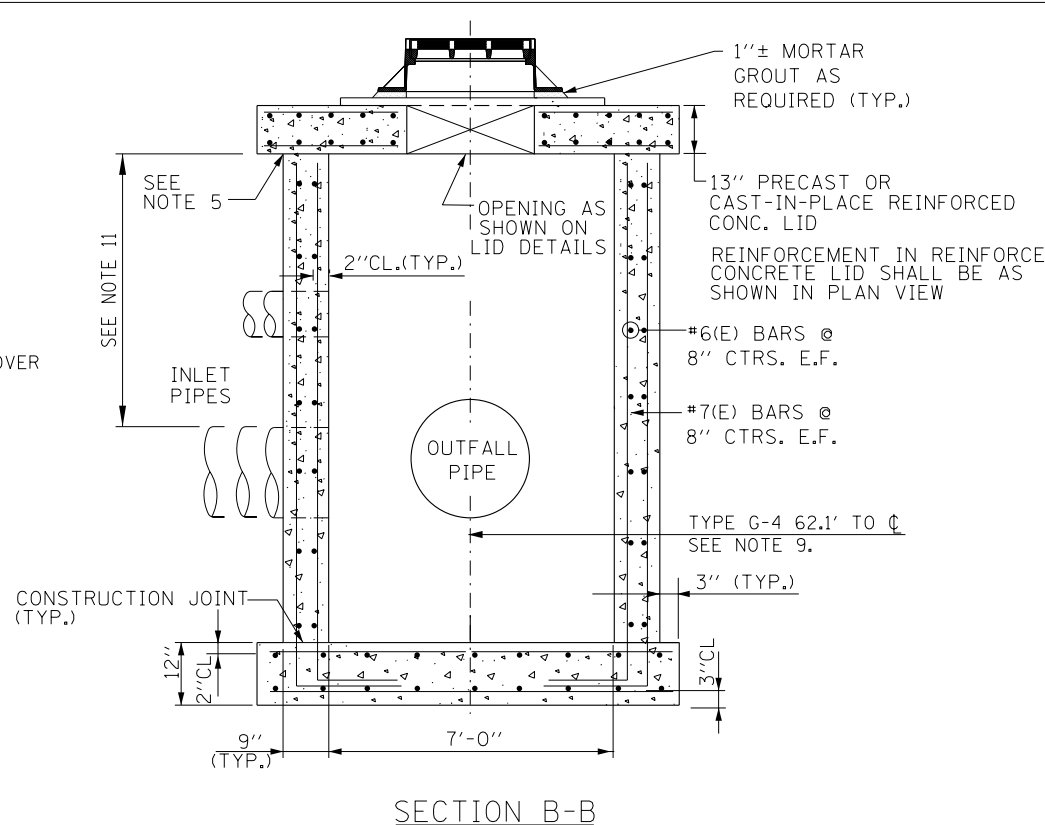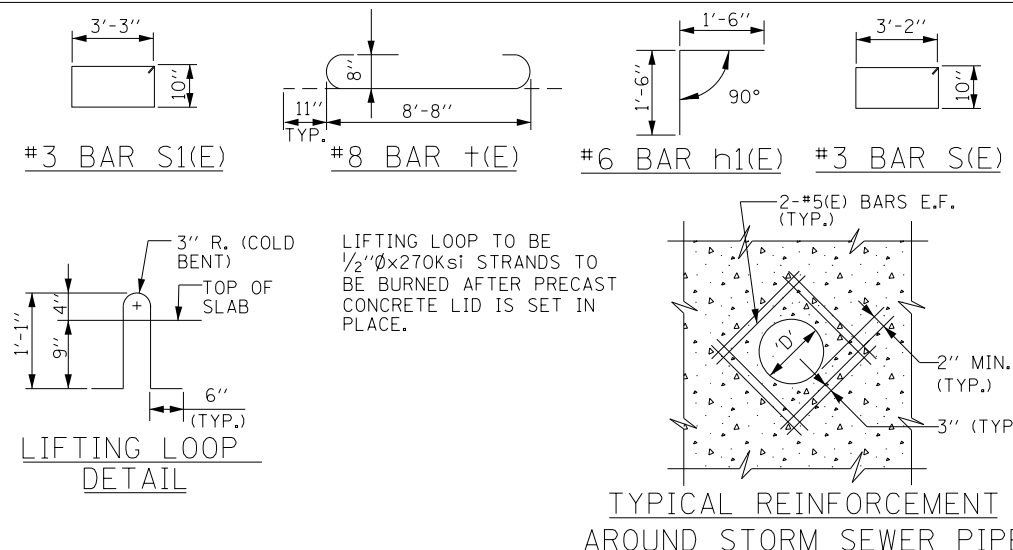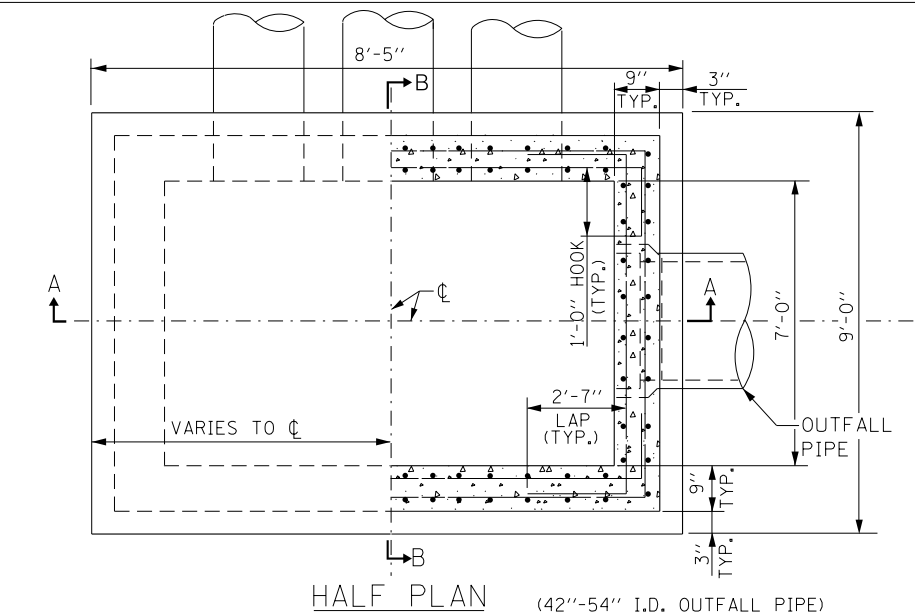


- NOTES:**
- SEE SHEET 1 OF THIS SERIES FOR ADDITIONAL NOTES.
 - CATCH BASINS TYPE G-5 SHALL BE USED IN TANGENT SECTIONS AND ON THE LOW SIDE OF SUPERELEVATED PAVEMENT.
 - CATCH BASINS TYPE G-5 SHALL BE PROVIDED WITH A REINFORCED CONCRETE SLAB TOP AS DETAILED ON THIS DRAWING.
 - CATCH BASINS TYPE G-5 SHALL BE USED WHEN GUTTER, TYPE G-3 IS PROVIDED.
 - MORTAR OR SEALER SHALL BE USED WHEN A PRECAST REINFORCED CONCRETE LID IS USED.
 - FRAME AND GRATE RIM ELEVATION AND OFFSET MEASURED AT THE EDGE OF SHOULDER.
 - 54"Ø MAX. OUTFALL PIPE FOR TYPE G-5 CATCH BASIN.
 - ALL CONCRETE SHALL BE CLASS SI CONCRETE.
 - DISTANCE FROM C OUTFALL PIPE TO C ROADWAY TO BE VERIFIED BY ENGINEER.
 - THE CONTRACTOR SHALL CLEARLY MARK EACH CATCH BASIN WITH "ILLINOIS TOLLWAY", CONTRACT NUMBER, STRUCTURE NUMBER, PRODUCER NAME AND DATE OF MANUFACTURE. THIS INFORMATION SHALL BE MARKED ON THE OUTSIDE FACE OF THE STRUCTURE IN A VISIBLE SURFACE AS DESIGNATED BY THE ENGINEER. THE MARKING SHALL BE PAINTED/STAMPED IN THE STRUCTURE WITH WATERPROOF PAINT/INK OR RECESSED IN THE STRUCTURE BY 1/2". THE LETTERS SHALL BE CAPITALS, NOT LESS THAN 2 IN. AND NOT MORE THAN 3 IN. IN HEIGHT.
 - A MINIMUM OF 9" OF MONOLITHIC REINFORCED CONCRETE SHALL BE MAINTAINED ABOVE PIPE PENETRATION HOLES >15".

APPROVED: *Paul Kovacs* CHIEF ENGINEERING OFFICER DATE 6-1-2009


SHEET 3 OF 4

CATCH BASINS TYPE G AND TYPE G-3 MODIFIED, FRAMES AND GRATES


STANDARD B8-08

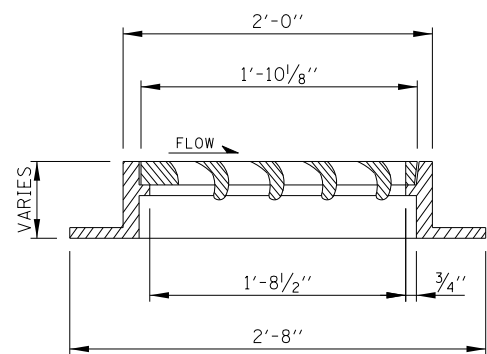


SECTION T-T

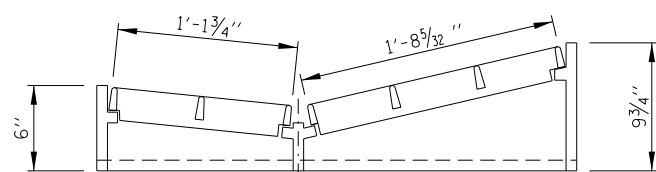


SECTION U-U

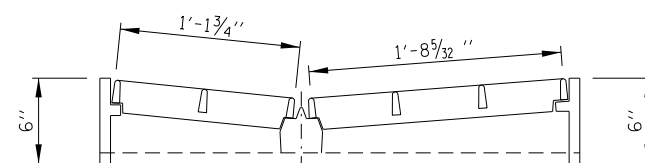


SECTION W-W

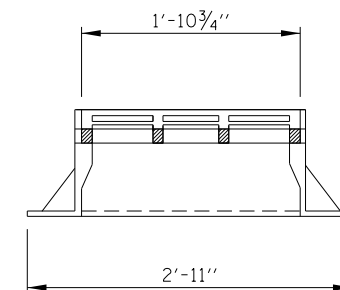


SECTION Y-Y

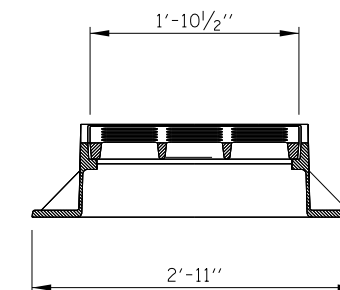


SECTION S-S

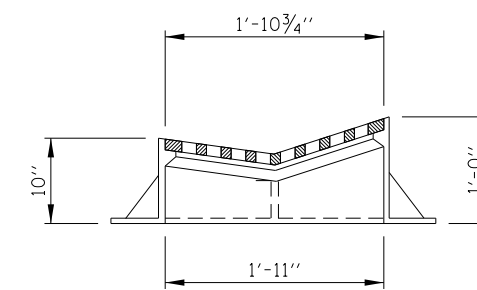


SECTION Z-Z

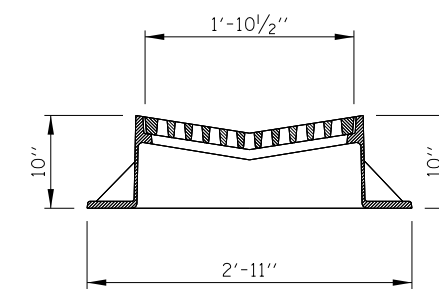


SECTION V-V

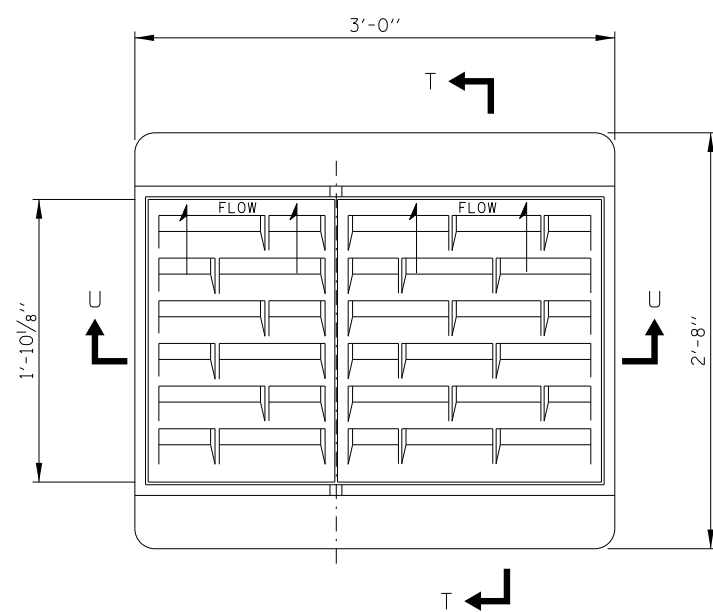


TYPE G-3 FRAME & GRATE

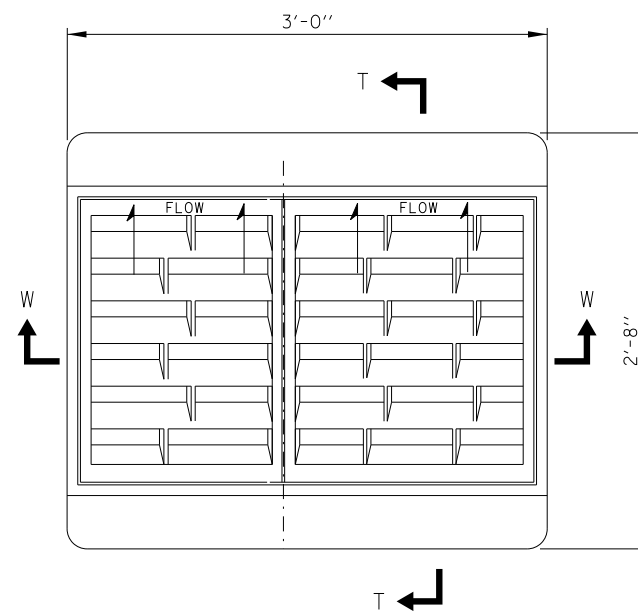

TYPE G-3, MODIFIED
FRAME & GRATE

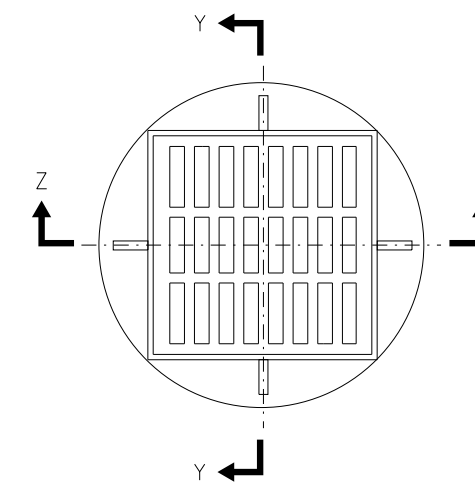

TYPE G-2 FRAME & GRATE

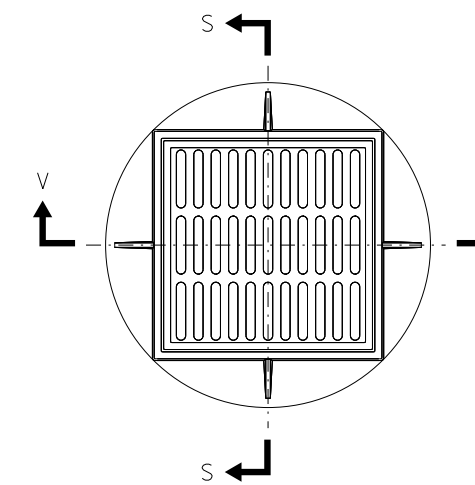

TYPE G-2 MODIFIED
FRAME & GRATE


APPROVED *Paul Kovacs* DATE 6-1-2009
CHIEF ENGINEERING OFFICER

NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES.




CATCH BASINS TYPE G AND
TYPE G-3 MODIFIED, FRAMES
AND GRATES



STANDARD B8-08

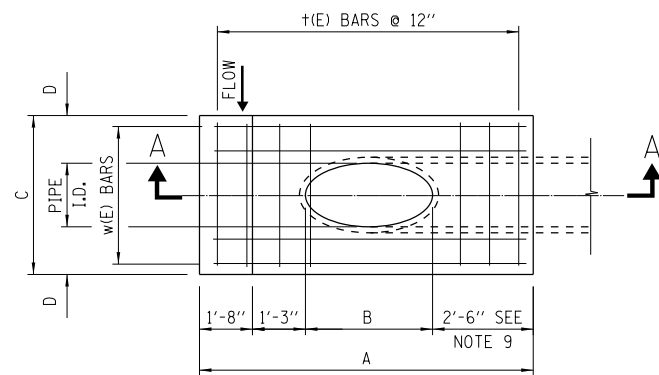


PLAN I

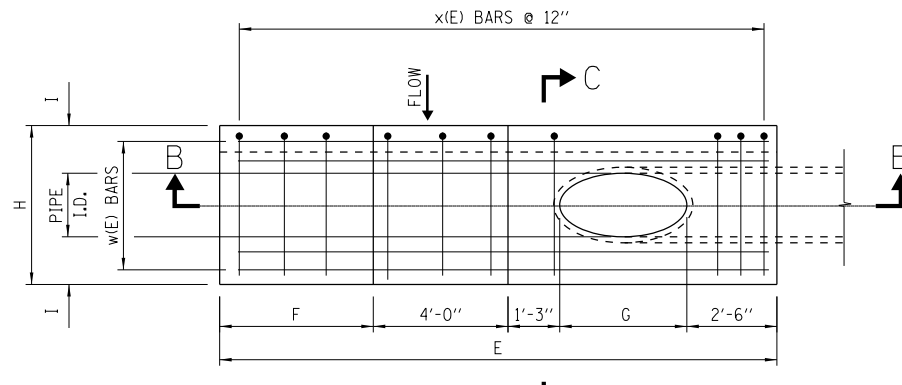


PLAN II

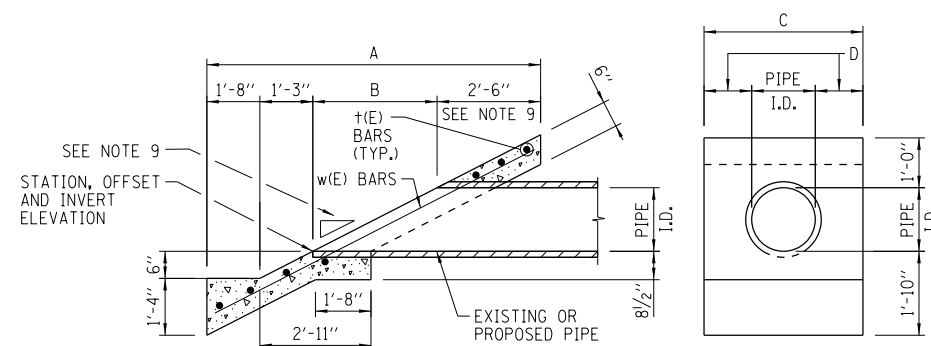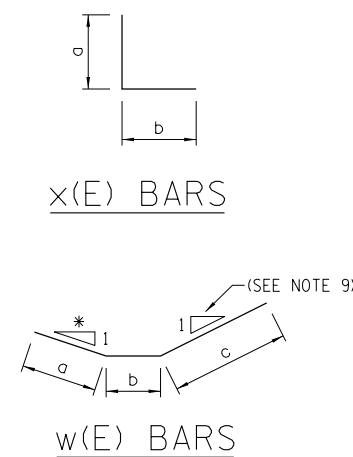


SECTION A-A

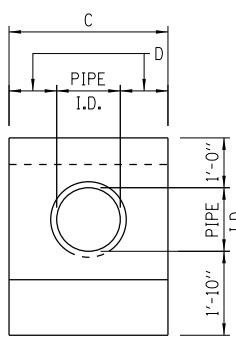

ELEVATION

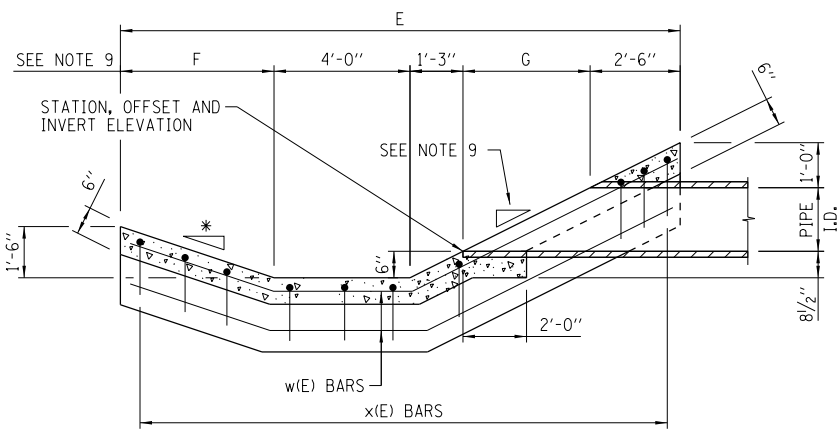

SECTION B-B

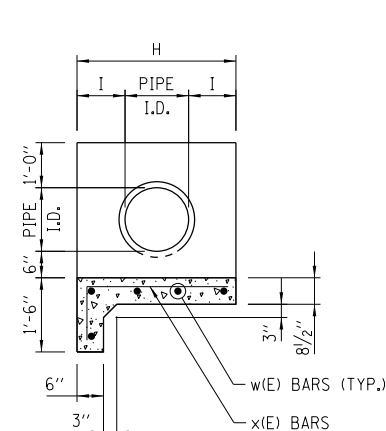

SECTION C-C

* MATCH EXISTING OR PROPOSED SLOPE, SEE NOTE 9

- NOTES:
1. SLOPED HEADWALL TYPES I AND II SHALL BE CONSTRUCTED FLUSH WITH EXISTING OR PROPOSED SLOPE.
 2. CLASS SI CONCRETE SHALL BE USED THROUGHOUT.
 3. ALL REINFORCEMENT BARS SHOWN SHALL BE EPOXY COATED (E).
 4. BAR BENDING DETAILS ARE DIMENSIONED OUT TO OUT OF BARS.
 5. ALL EXPOSED EDGES SHALL HAVE A 3/4" CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW THE FINISHED GROUND LINE.
 6. COVER FROM THE FACE OF CONCRETE TO FACE OF REINFORCEMENT BARS SHALL BE 3" FOR SURFACES FORMED AGAINST EARTH AND 2" FOR ALL OTHER SURFACES UNLESS OTHERWISE SHOWN.
 7. CARE SHALL BE EXERCISED IN REMOVING ANY LENGTH OF EXISTING PIPE SO THE REMAINING PIPE IS UNDAMAGED AND FULLY FUNCTIONING.
 8. ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
 9. SLOPED HEADWALLS, TYPES I AND II TO BE USED ONLY FOR SLOPES STEEPER THAN 1:3. DIMENSIONS AND QUANTITIES SHOWN ARE BASED ON A 1:2.5 SLOPE (EXISTING AND PROPOSED).
 10. I.D. DENOTES INSIDE DIAMETER OF PIPE. O.D. DENOTES OUTSIDE DIAMETER OF PIPE.

TABLES FOR DIMENSIONS, REINFORCEMENT AND QUANTITIES FOR ONE SLOPED HEADWALL TYPE I

SLOPED HEADWALL DIMENSION TABLE - TYPE I				
PIPE I.D.	A	B	C	D
6"	6'-8"	1'-3"	2'-6"	1'-0"
12"	7'-11"	2'-6"	3'-0"	1'-0"
15"	8'-7"	3'-2"	3'-9"	1'-3"
18"	9'-2"	3'-9"	4'-6"	1'-6"

PIPE I.D.	REINFORCEMENT BARS		
	MARK(E)	NO. & SIZE	LENGTH
6"	+6	7-#4	2'-2"
	w6	4-#4	6'-8"
12"	+12	7-#4	2'-8"
	w12	4-#4	8'-2"
15"	+15	7-#4	3'-5"
	w15	4-#4	8'-11"
18"	+18	7-#4	4'-2"
	w18	4-#4	9'-6"

DESIGN NO.	INSIDE DIA. OF PIPE	CONC. 1 HDWL. (CU. YD.)	REINF. BARS. 1 HDWL. (POUND)
F-6-2	6"	0.5	29
F-12-2	12"	0.6	35
F-15-2	15"	0.8	40
F-18-2	18"	1.0	45

TABLES FOR DIMENSIONS, REINFORCEMENT AND QUANTITIES FOR ONE SLOPED HEADWALL TYPE II

SLOPED HEADWALL DIMENSION TABLE - TYPE II					
PIPE I.D.	E	F	G	H	I
12"	14'-0"	3'-9"	2'-6"	3'-0"	1'-0"
15"	14'-8"	3'-9"	3'-2"	3'-9"	1'-3"
18"	15'-3"	3'-9"	3'-9"	4'-6"	1'-6"

PIPE I.D.	REINFORCEMENT BARS					
	MARK(E)	NO. & SIZE	LENGTH	a	b	c
12"	x12	10-#4	3'-6"	2'-6"	1'-0"	---
	w12	5-#4	14'-4"	3'-10"	4'-0"	6'-6"
15"	x15	10-#4	4'-3"	3'-3"	1'-0"	---
	w15	5-#4	15'-1"	3'-10"	4'-0"	7'-3"
18"	x18	10-#4	5'-0"	4'-0"	1'-0"	---
	w18	5-#4	15'-8"	3'-10"	4'-0"	7'-10"


DESIGN NO.	INSIDE DIA. OF PIPE	CONC. 1 HDWL. (CU. YD.)	REINF. BARS. 1 HDWL. (POUND)
E-12-2	12"	1.2	75
E-15-2	15"	1.6	82
E-18-2	18"	1.7	89

SLOPED HEADWALL TYPE I

SLOPED HEADWALL TYPE II

APPROVED: *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEERING OFFICER


DATE	REVISIONS
3-31-2017	REVISED REINFORCEMENT BARS, TABLES
3-11-2015	REVISED REINFORCEMENT BARS, TABLES
3-31-2014	REVISED CONCRETE QUANTITIES
	REINFORCEMENT STEEL
2-7-2012	REVISED REINFORCEMENT BARS, TABLES



SLOPED HEADWALLS TYPE I AND TYPE II

STANDARD B9-04

DIMENSIONS AND QUANTITIES FOR ONE SLOPED HEADWALL TYPE III

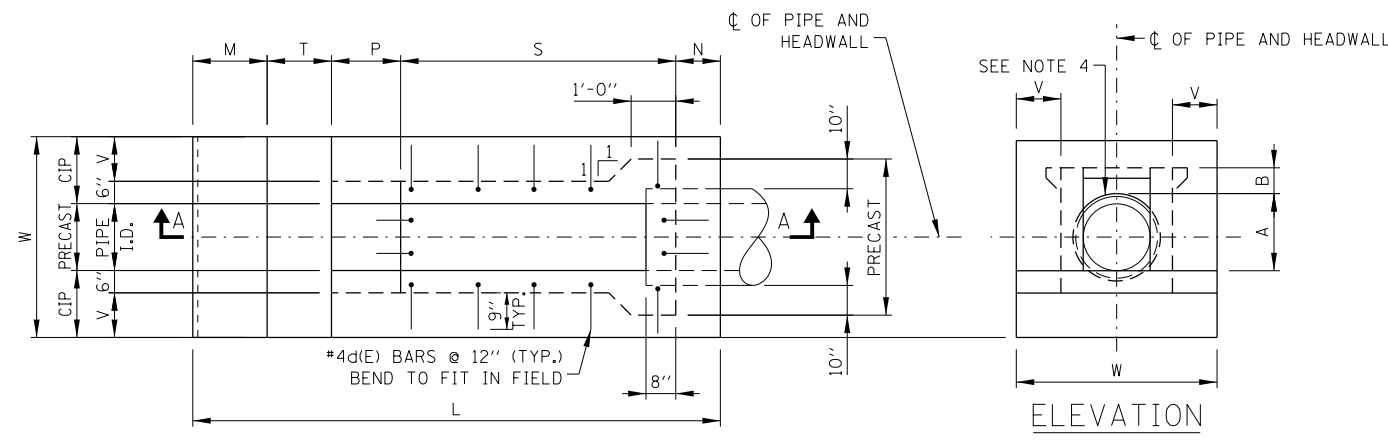


PLAN - SLOPED HEADWALL

ELEVATION


NOTES:

EACH #4d(E) BAR SHALL BE PLACED SUCH THAT IT WILL PROJECT 9" INTO THE CAST IN PLACE (CIP) CONCRETE AND IT SHALL BE 3" BELOW THE TOP SURFACE. HOOKS IN THE PRECAST SECTION SHALL BE TIPPED TO CLEAR ALL CONCRETE SURFACES A MIN. OF 2".

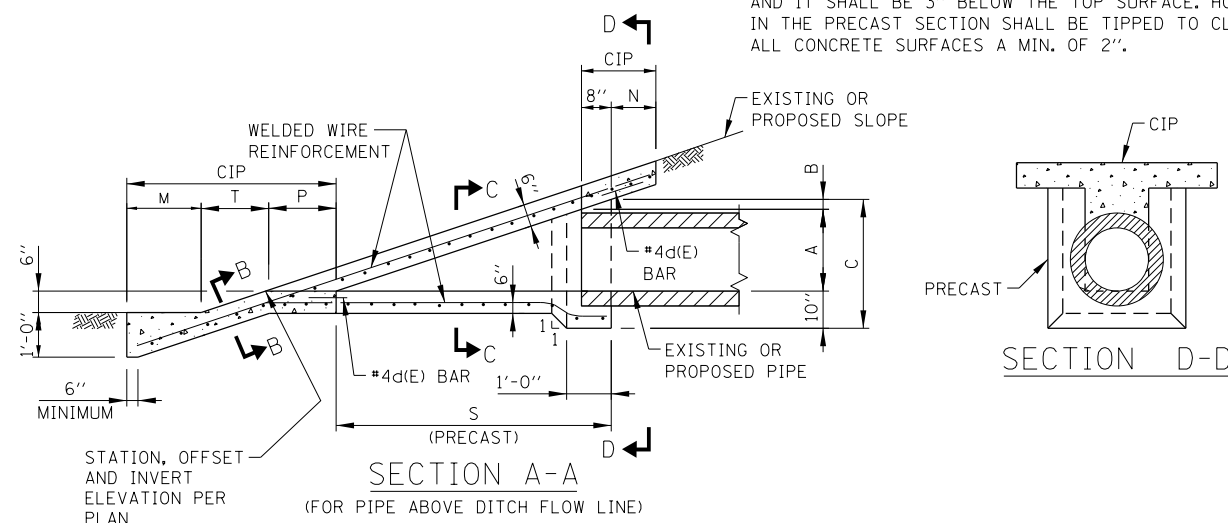

SECTION A-A
(FOR PIPE ABOVE DITCH FLOW LINE)

SECTION D-D

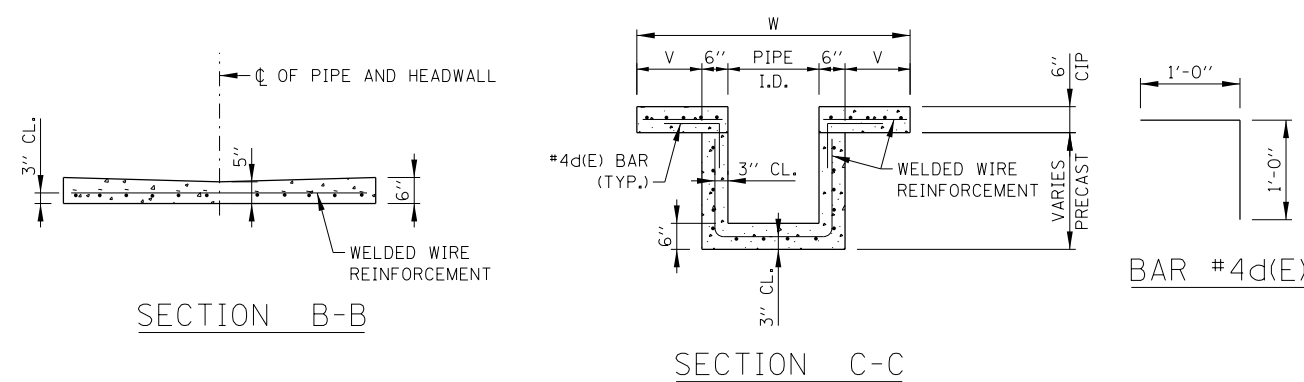

SECTION B-B

SECTION C-C

NOTES:

- THE CAST IN PLACE (CIP) SLOPED HEADWALL SHALL BE CONSTRUCTED FLUSH WITH EXISTING OR PROPOSED SLOPE.
- CLASS SI CONCRETE SHALL BE USED THROUGHOUT.
- WELDED WIRE REINFORCEMENT SHALL BE EPOXY COATED 4x4-W4xW4, 58 LBS. PER 100 SQ.FT.
- ALL REINFORCEMENT BARS SHOWN SHALL BE EPOXY COATED (E).
- BAR BENDING DETAILS ARE DIMENSIONED OUT TO OUT OF BARS.
- COVER FROM FACE OF CONCRETE TO FACE OF REINFORCEMENT BAR SHALL BE 3" FOR SURFACES FORMED AGAINST EARTH AND 2" FOR ALL OTHER SURFACES UNLESS OTHERWISE SHOWN.
- PRECAST UNIT USE IS OPTIONAL. THE ENTIRE STRUCTURE MAY BE CAST IN PLACE.

PIPE I.D.	DIMENSIONS											PRE CAST CONC. CU. YD.	CAST-IN-PLACE CU. YD.	WELDED WIRE REINFORCEMENT SQ. YD.	REINFORCEMENT BARS				
	A	B	C	N	M	T	P	S	L	V	W				MARK(E)	SIZE	NO.	LENGTH	LB.
6"	9"	2 3/4"	1'-9 3/4"	1'-0"	1'-8"	1'-6"	1'-6 3/4"	2'-11 1/4"	8'-8"	1'-0"	3'-6"	0.15	0.72	3.28	d6	#4	12	2'-0"	16
8"	11"	2 3/4"	1'-11 3/4"	1'-0"	1'-8"	1'-6"	1'-6 3/4"	3'-5 1/4"	9'-2"	1'-0"	3'-8"	0.22	0.75	3.89	d8	#4	12	2'-0"	16
12"	1'-3 1/2"	2 3/4"	2'-4 1/4"	1'-0"	1'-8"	1'-6"	1'-6 3/4"	4'-6 3/4"	10'-3 1/2"	1'-0"	4'-0"	0.34	0.92	4.50	d12	#4	14	2'-0"	19
15"	1'-6 1/2"	2 3/4"	2'-7 1/4"	1'-0"	1'-8"	1'-6"	1'-6 3/4"	5'-3 3/4"	11'-1/2"	1'-0"	4'-3"	0.45	1.01	5.88	d15	#4	16	2'-0"	21
18"	1'-10"	2 3/4"	2'-10 3/4"	1'-0"	1'-8"	1'-6"	1'-6 3/4"	6'-2 1/4"	11'-11"	1'-0"	4'-6"	0.61	1.13	6.44	d18	#4	18	2'-0"	24
21"	2'-1"	2 3/4"	3'-1 3/4"	1'-0"	1'-9"	1'-6"	1'-6 3/4"	6'-11 1/4"	12'-9"	1'-3"	5'-3"	0.76	1.39	8.34	d21	#4	22	2'-0"	29
24"	2'-4 1/2"	2 3/4"	3'-5 1/4"	1'-0"	2'-0"	1'-6"	1'-6 3/4"	7'-9 3/4"	13'-10 1/2"	1'-6"	6'-0"	0.95	1.72	9.85	d24	#4	24	2'-0"	32
27"	2'-7 1/2"	2 3/4"	3'-8 1/4"	1'-1 1/2"	2'-3"	1'-6"	1'-6 3/4"	8'-6 3/4"	15'-0"	1'-9"	6'-9"	1.14	2.07	13.54	d27	#4	24	2'-0"	32
30"	2'-11"	2 3/4"	3'-11 3/4"	1'-3"	2'-6"	1'-6"	1'-6 3/4"	9'-5 1/4"	16'-3"	2'-0"	7'-6"	1.38	2.46	16.40	d30	#4	26	2'-0"	35

PIPE I.D.	DIMENSIONS											PRE CAST CONC. CU. YD.	CAST-IN-PLACE CU. YD.	WELDED WIRE REINFORCEMENT SQ. YD.	REINFORCEMENT BARS				
	A	B	C	N	M	T	P	S	L	V	W				MARK(E)	SIZE	NO.	LENGTH	LB.
6"	9"	2"	1'-9"	1'-0"	1'-8"	2'-0"	2'-1"	3'-8"	10'-5"	1'-0"	3'-6"	0.17	0.83	4.07	d6	#4	12	2'-0"	16
8"	11"	2"	1'-11"	1'-0"	1'-8"	2'-0"	2'-1"	4'-4"	11'-1"	1'-0"	3'-8"	0.28	0.87	4.97	d8	#4	14	2'-0"	19
12"	1'-3 1/2"	2"	2'-3 1/2"	1'-0"	1'-8"	2'-0"	2'-1"	5'-10"	12'-7"	1'-0"	4'-0"	0.41	1.07	5.50	d12	#4	16	2'-0"	21
15"	1'-6 1/2"	2"	2'-6 1/2"	1'-0"	1'-8"	2'-0"	2'-1"	6'-10"	13'-7"	1'-0"	4'-3"	0.55	1.18	6.63	d15	#4	18	2'-0"	24
18"	1'-10"	2"	2'-10"	1'-0"	1'-8"	2'-0"	2'-1"	8'-0"	14'-9"	1'-0"	4'-6"	0.74	1.32	8.60	d18	#4	22	2'-0"	29
21"	2'-1"	2"	3'-1"	1'-0"	1'-9"	2'-0"	2'-1"	9'-0"	15'-10"	1'-3"	5'-3"	0.93	1.63	11.03	d21	#4	24	2'-0"	32
24"	2'-4 1/2"	2"	3'-4 1/2"	1'-0"	2'-0"	2'-0"	2'-1"	10'-2"	17'-3"	1'-6"	6'-0"	1.18	2.00	13.88	d24	#4	28	2'-0"	37
27"	2'-7 1/2"	2"	3'-7 1/2"	1'-1 1/2"	2'-3"	2'-0"	2'-1"	11'-2"	18'-7 1/2"	1'-9"	6'-9"	1.42	2.41	14.83	d27	#4	30	2'-0"	40
30"	2'-11"	2"	3'-11"	1'-3"	2'-6"	2'-0"	2'-1"	12'-4"	20'-2"	2'-0"	7'-6"	1.71	2.87	20.49	d30	#4	32	2'-0"	43

PIPE I.D.	DIMENSIONS											PRE CAST CONC. CU. YD.	CAST-IN-PLACE CU. YD.	WELDED WIRE REINFORCEMENT SQ. YD.	REINFORCEMENT BARS				
	A	B	C	N	M	T	P	S	L	V	W				MARK(E)	SIZE	NO.	LENGTH	LB.
6"	9"	1 1/2"	1'-8 1/2"	1'-0"	1'-8"	3'-0"	3'-0"	5'-3"	13'-11"	1'-0"	3'-6"	0.23	1.07	5.29	d6	#4	16	2'-0"	21
8"	11"	1 1/2"	1'-10 1/2"	1'-0"	1'-8"	3'-0"	3'-0"	6'-3"	14'-11"	1'-0"	3'-8"	0.43	1.13	7.13	d8	#4	18	2'-0"	24
12"	1'-3 1/2"	1 1/2"	2'-3"	1'-0"	1'-8"	3'-0"	3'-0"	8'-6"	17'-2"	1'-0"	4'-0"	0.57	1.38	8.62	d12	#4	22	2'-0"	29
15"	1'-6 1/2"	1 1/2"	2'-6"	1'-0"	1'-8"	3'-0"	3'-0"	10'-0"	18'-8"	1'-0"	4'-3"	0.77	1.53	10.35	d15	#4	26	2'-0"	35
18"	1'-10"	1 1/2"	2'-9 1/2"	1'-0"	1'-8"	3'-0"	3'-0"	11'-9"	20'-5"	1'-0"	4'-6"	1.04	1.70	12.47	d18	#4	28	2'-0"	37
21"	2'-1"	1 1/2"	3'-0 1/2"	1'-0"	1'-9"	3'-0"	3'-0"	13'-3"	22'-0"	1'-3"	5'-3"	1.31	2.11	15.77	d21	#4	34	2'-0"	45
24"	2'-4 1/2"	1 1/2"	3'-4"	1'-0"	2'-0"	3'-0"	3'-0"	15'-0"	24'-0"	1'-6"	6'-0"	1.66	2.59	17.62	d24	#4	38	2'-0"	51
27"	2'-7 1/2"	1 1/2"	3'-7"	1'-1 1/2"	2'-3"	3'-0"	3'-0"	16'-6"	25'-10 1/2"	1'-9"	6'-9"	1.99	3.11	24.10	d27	#4	40	2'-0"	53
30"	2'-11"	1 1/2"	3'-10 1/2"	1'-3"	2'-6"	3'-0"	3'-0"	18'-3"	28'-0"	2'-0"	7'-6"	2.41	3.70	29.13	d30	#4	44	2'-0"	59

- AFTER THE PRECAST SLOPED HEADWALL HAS BEEN PLACED, THE SPACE BETWEEN THE HEADWALL AND PIPE SHALL BE COMPLETELY FILLED WITH AN APPROVED NON-SHRINK GROUT WITH A MINIMUM COMPRESSIVE STRENGTH IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.
- THE SLOPED HEADWALL DETAILS SHOWN ON THIS DRAWING ARE FOR USE ONLY WITH PIPES HAVING DIAMETER OR SPAN OF 30" OR LESS.
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- I.D. DENOTES INSIDE DIAMETER OF PIPE. O.D. DENOTES OUTSIDE DIAMETER OF PIPE.
- REBAR REINFORCEMENT MAY BE USED AS AN OPTION TO WELDED WIRE REINFORCEMENT, DRAWINGS SHALL BE SUBMITTED FOR APPROVAL BY THE ENGINEER.




SLOPED HEADWALLS
TYPE III DETAILS


STANDARD B10-13

DATE	REVISIONS
3-01-2022	REVISED WELDED WIRE NOTE
3-01-2021	ADDED 8" SLOPED HEADWALL TYPE III
3-01-2020	REVISED NOTES
3-01-2019	ADDED DOUBLE SLOPED HEADWALL TYPE III
3-31-2017	REVISED TABLE (L)


APPROVED: *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEERING OFFICER

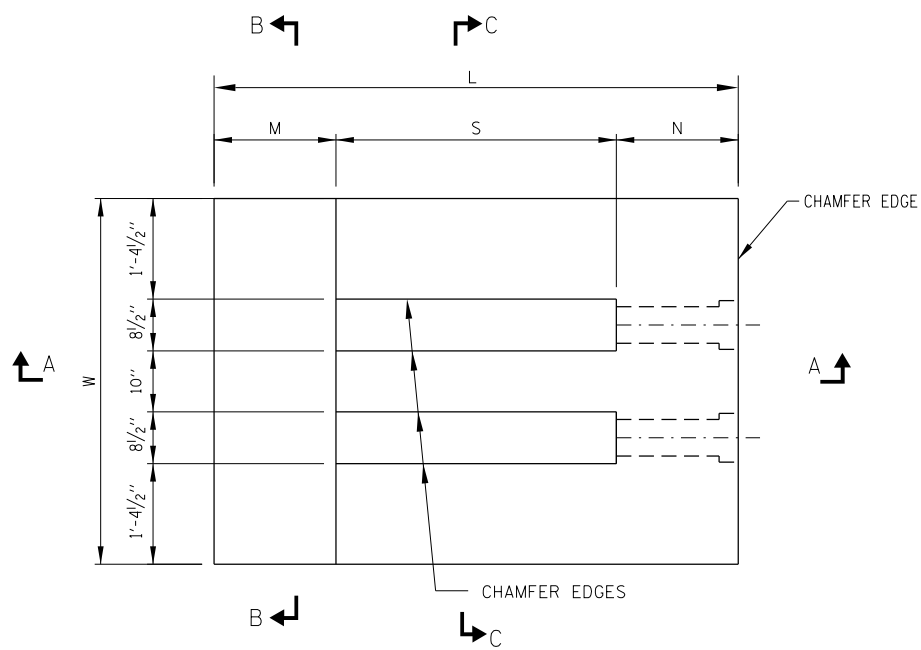


PLAN - DOUBLE SLOPED HEADWALL

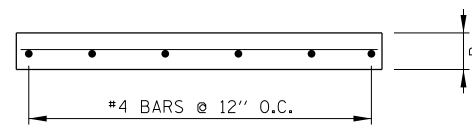


SECTION B-B

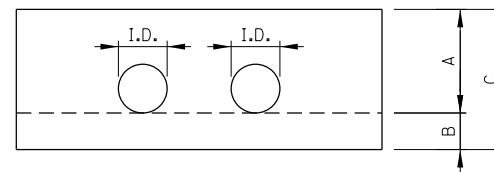

ELEVATION

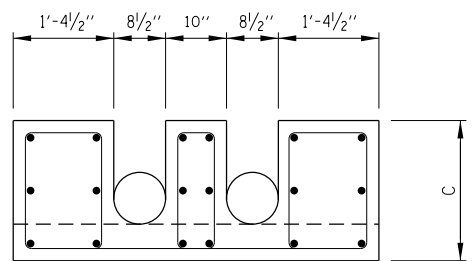

SECTION C-C

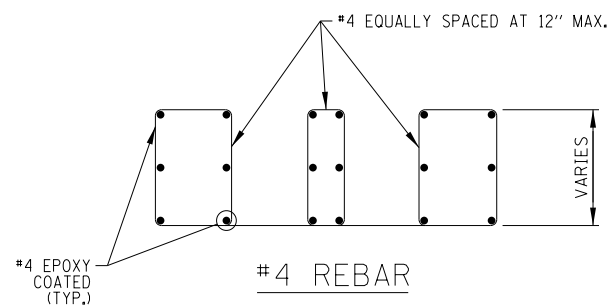


NOTES:

1. THE DOUBLE SLOPED HEADWALL SHALL BE CONSTRUCTED FLUSH WITH EXISTING OR PROPOSED SLOPE.
2. CLASS SI CONCRETE SHALL BE USED THROUGHOUT.
3. ALL REINFORCEMENT BARS SHOWN SHALL BE EPOXY COATED (E).
4. BAR BENDING DETAILS ARE DIMENSIONED OUT TO OUT OF BARS.
5. COVER FROM FACE OF CONCRETE TO FACE OF REINFORCEMENT BAR SHALL BE 3" FOR SURFACES FORMED AGAINST EARTH AND 2" FOR ALL OTHER SURFACES UNLESS OTHERWISE SHOWN.
6. PRECAST UNIT USE IS OPTIONAL. THE ENTIRE STRUCTURE MAY BE CAST IN PLACE.
7. AFTER THE PRECAST SLOPED HEADWALL HAS BEEN PLACED, THE SPACE BETWEEN THE HEADWALL AND PIPE SHALL BE COMPLETELY FILLED WITH AN APPROVED NON-SHRINK GROUT WITH A MINIMUM COMPRESSIVE STRENGTH IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.
8. THE DOUBLE SLOPED HEADWALL DETAILS SHOWN ON THIS DRAWING ARE FOR USE ONLY WITH PIPES HAVING DIAMETER OR SPAN OF 8" OR LESS.
9. ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
10. I.D. DENOTES INSIDE DIAMETER OF PIPE.
11. WELDED WIRE REINFORCEMENT MAY BE USED AS AN OPTION TO REBAR REINFORCEMENT, DRAWINGS SHALL BE SUBMITTED FOR APPROVAL BY THE ENGINEER.


STIRRUP HEIGHT TABLE
FOR DOUBLE SLOPED HEADWALL TYPE III

1 TO 3 SLOPE AND C=1'-11"		1 TO 4 SLOPE AND C=1'-11"		1 TO 6 SLOPE AND C=1'-11"	
	STIRRUP HEIGHT, H		STIRRUP HEIGHT, H		STIRRUP HEIGHT, H
d1 E	17'-6"	d1 E	17'-7"	d1 E	17'-8 1/4"
d2 E	14'-4 3/4"	d2 E	15'-3/4"	d2 E	15'-10 1/2"
d3 E	11'-3 3/4"	d3 E	12'-6 3/4"	d3 E	14'-1/4"
d4 E	8'-2 3/4"	d4 E	10'-1/2"	d4 E	12'-2 1/4"
d5 E	5'-1 1/2"	d5 E	7'-6"	d5 E	10'-4 1/4"
		d6 E	5'-0"	d6 E	8'-6"
				d7 E	6'-8 1/4"
				d8 E	4'-10"

1 TO 3 SLOPE AND C=2'-1"		1 TO 4 SLOPE AND C=2'-1"		1 TO 6 SLOPE AND C=2'-1"	
	STIRRUP HEIGHT, H		STIRRUP HEIGHT, H		STIRRUP HEIGHT, H
d1 E	19'-6"	d1 E	19'-7"	d1 E	19'-8 1/4"
d2 E	16'-4 3/4"	d2 E	17'-3/4"	d2 E	17'-10 1/2"
d3 E	13'-3 3/4"	d3 E	14'-6 3/4"	d3 E	16'-1/4"
d4 E	10'-2 3/4"	d4 E	12'-1/2"	d4 E	14'-2 1/4"
d5 E	7'-1 1/2"	d5 E	9'-6"	d5 E	12'-4 1/4"
d6 E	4'-1/2"	d6 E	7'-0"	d6 E	10'-6"
		d7 E	4'-5 3/4"	d7 E	8'-8 1/4"
				d8 E	6'-10"
				d9 E	5'-0"

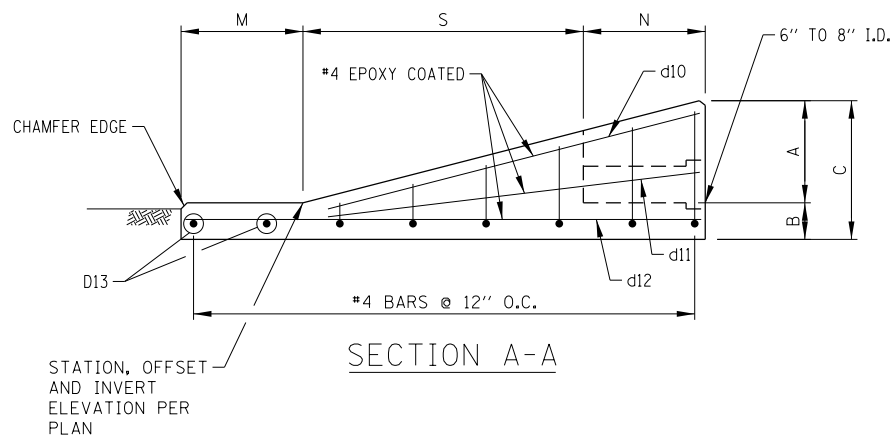

SECTION A-A

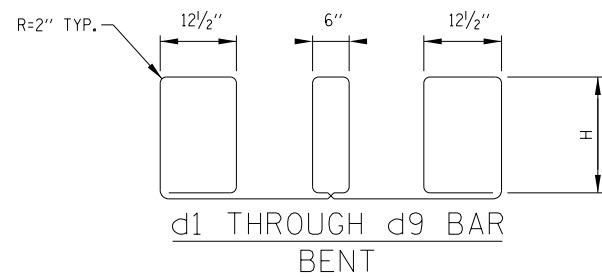

d1 THROUGH d9 BAR
BENT

APPROVED: *Paul Kovacs* DATE: 2-7-2012
CHIEF ENGINEERING OFFICER




	PIPE I.D.	DIMENSIONS								PRECAST CONCRETE CU YD	MARK	SIZE	NO	LENGTH	LB
		A	B	C	N	S	M	L	W						
1 TO 3 SLOPE	(2) - 6" PIPE	1'-5"	6"	1'-11"	1'-8"	3'-10"	1'-8"	7'-2"	5'-0"	1.29	d1 E	#4	1	17'-4 3/4"	12
											d2 E	#4	1	15'-10 1/4"	11
											d3 E	#4	1	14'-3 1/2"	10
											d4 E	#4	1	12'-9 1/4"	9
											d5 E	#4	1	11'-2 1/2"	7
											d10 E	#4	6	4'-8"	19
											d11 E	#4	6	3'-10 3/4"	16
											d12 E	#4	6	6'-10"	27
	d13 E	#4	2	4'-8"	6										
	(2) - 8" PIPE OR (1) - 6" PIPE & (1) - 8" PIPE	1'-5"	8"	2'-1"	1'-8"	3'-10"	1'-8"	7'-2"	5'-0"	1.51	d1 E	#4	1	18'-4 3/4"	12
											d2 E	#4	1	16'-10 1/4"	11
											d3 E	#4	1	15'-3 1/2"	10
											d4 E	#4	1	13'-9 1/4"	9
d5 E											#4	1	12'-2 1/2"	8	
d6 E	#4	1	10'-8"	7											
d10 E	#4	6	5'-4"	21											
d11 E	#4	6	4'-6 1/2"	18											
d12 E	#4	6	6'-10"	27											
d13 E	#4	2	4'-8"	6											

	PIPE I.D.	DIMENSIONS								PRECAST CONCRETE CU YD	MARK	SIZE	NO	LENGTH	LB
		A	B	C	N	S	M	L	W						
1 TO 6 SLOPE	(2) - 6" PIPE	1'-5"	6"	1'-11"	1'-8"	7'-7"	1'-8"	10'-11"	5'-0"	2.00	d1 E	#4	1	17'-6"	12
											d2 E	#4	1	16'-7"	11
											d3 E	#4	1	15'-8"	10
											d4 E	#4	1	14'-9"	10
											d5 E	#4	1	13'-10"	9
											d6 E	#4	1	12'-10 3/4"	9
											d7 E	#4	1	12'-0"	8
											d8 E	#4	1	11'-3/4"	7
											d10 E	#4	6	7'-9 3/4"	31
											d11 E	#4	6	6'-7 3/4"	27
											d12 E	#4	6	10'-7 1/4"	42
											d13 E	#4	2	4'-8"	6
											(2) - 8" PIPE OR (1) - 6" PIPE & (1) - 8" PIPE	1'-5"	8"	2'-1"	1'-8"
	d2 E	#4	1	17'-7"	12										
	d3 E	#4	1	16'-8"	11										
	d4 E	#4	1	15'-9"	11										
	d5 E	#4	1	14'-10"	10										
	d6 E	#4	1	13'-10 3/4"	9										
	d7 E	#4	1	13'-0"	9										
	d8 E	#4	1	12'-3/4"	8										
	d9 E	#4	1	11'-1 3/4"	7										
	d10 E	#4	6	8'-11"	36										
	d11 E	#4	6	7'-9"	31										
	d12 E	#4	6	10'-7 1/4"	42										
	d13 E	#4	2	4'-8"	6										


	PIPE I.D.	DIMENSIONS								PRECAST CONCRETE CU YD	MARK	SIZE	NO	LENGTH	LB
		A	B	C	N	S	M	L	W						
1 TO 4 SLOPE	(2) - 6" PIPE	1'-5"	6"	1'-11"	1'-8"	5'-1"	1'-8"	8'-5"	5'-0"	1.53	d1 E	#4	1	17'-5 1/4"	12
											d2 E	#4	1	16'-2 1/4"	11
											d3 E	#4	1	14'-11"	10
											d4 E	#4	1	13'-8"	9
											d5 E	#4	1	12'-4 3/4"	8
											d6 E	#4	1	11'-1 3/4"	7
											d10 E	#4	6	5'-8 1/2"	23
											d11 E	#4	6	4'-9 3/4"	19
	d12 E	#4	6	8'-1 1/4"	32										
	d13 E	#4	2	4'-8"	6										
	(2) - 8" PIPE OR (1) - 6" PIPE & (1) - 8" PIPE	1'-5"	8"	2'-1"	1'-8"	5'-1"	1'-8"	8'-5"	5'-0"	1.79	d1 E	#4	1	18'-5 1/4"	12
											d2 E	#4	1	17'-2 1/4"	11
											d3 E	#4	1	15'-11"	11
d4 E											#4	1	14'-8"	10	
d5 E											#4	1	13'-4 3/4"	9	
d6 E	#4	1	12'-1 3/4"	8											
d7 E	#4	1	10'-10 3/4"	7											
d10 E	#4	6	6'-6 1/4"	26											
d11 E	#4	6	5'-7 1/4"	22											
d12 E	#4	6	8'-1 1/4"	32											
d13 E	#4	2	4'-8"	6											

DIMENSIONS AND QUANTITIES
FOR DOUBLE SLOPED HEADWALL TYPE III

APPROVED: *Paul Kovacs* DATE: 2-7-2012
CHIEF ENGINEERING OFFICER

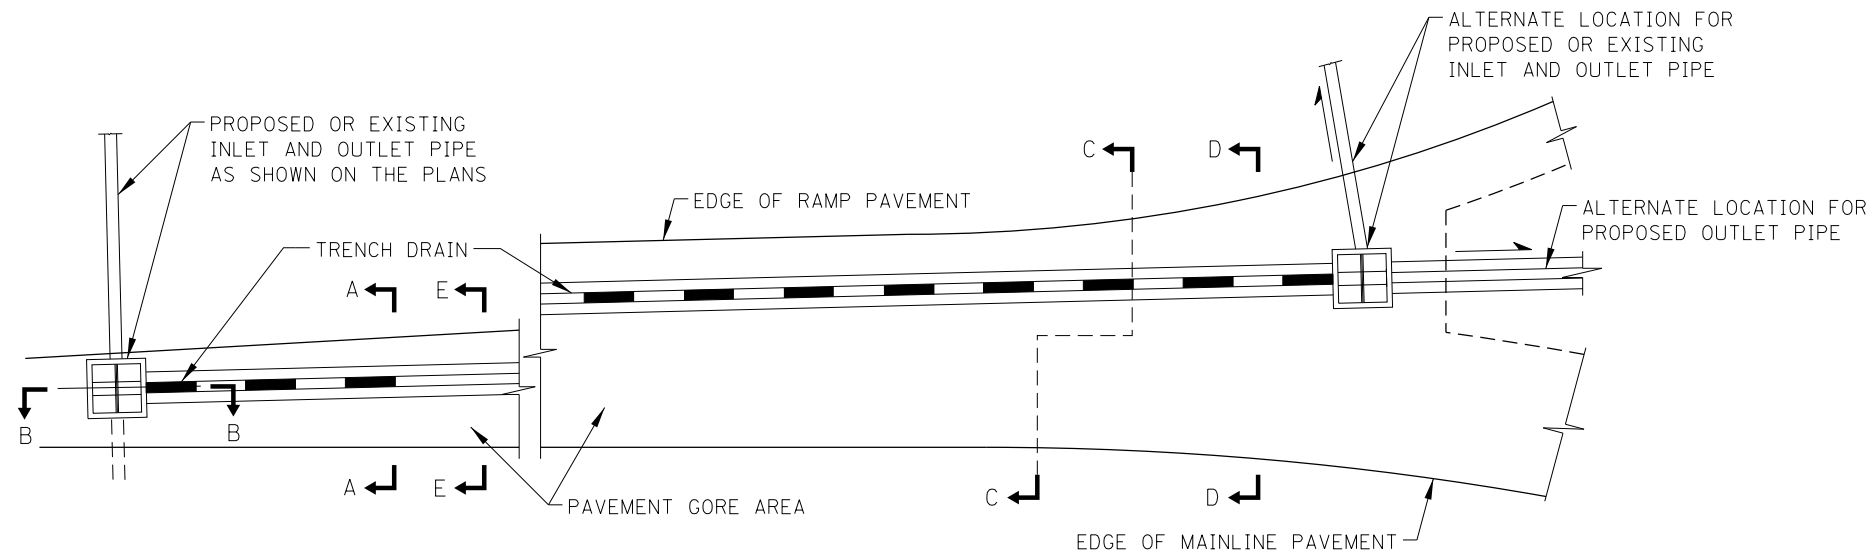

PLAN

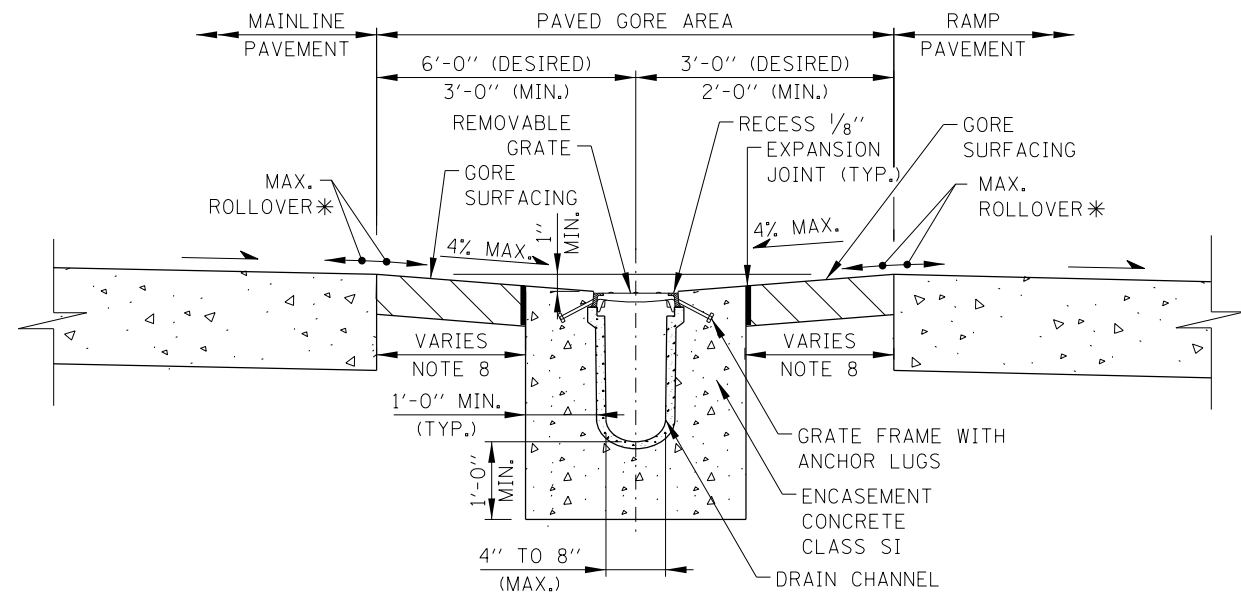

SECTION A-A
TRENCH DRAIN INSTALLATION

NOTES:

1. OUTLET PIPES AND PREFORMED CHANNEL INVERTS SHALL BE SLOPED AT 0.6% OR STEEPER TOWARD OUTLET REGARDLESS OF THE SURFACE SLOPE.
2. TRENCH DRAIN MAY BE STUBBED DIRECTLY INTO DRAINAGE STRUCTURES OR OUTLET PIPES MAY BE USED TO CONNECT TRENCH DRAIN TO DRAINAGE STRUCTURES.
3. TRENCH EXCAVATION MUST ALLOW FOR A MINIMUM OF 12 INCHES OF CONCRETE TO BE PLACED UNDER AND ALONGSIDE THE TRENCH DRAIN CHANNEL SYSTEM.
4. THE FINISHED LEVEL OF CONCRETE MUST BE APPROXIMATELY 1/8" ABOVE THE TOP OF THE DRAIN CHANNEL.
5. TRENCH DRAINS SHALL BE IN ACCORDANCE WITH THE MANUFACTURERS DETAILS AND SPECIFICATIONS.
6. PROVIDE 1" EXPANSION JOINT WITH PREFORMED JOINT FILLER BETWEEN PAVED SHOULDER AND TRENCH DRAIN ENCASEMENT.
7. ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL PLACEMENT (V:H).
8. WHEN THE CONCRETE ENCASEMENT FOR TRENCH DRAIN IS WITHIN 6' OF THE PAVEMENT, REPLACE THE GORE SURFACING WITH CLASS SI CONCRETE 9" DEPTH; PAY ITEM: PORTLAND CEMENT CONCRETE SHOULDERS (JOINTED) 9".

* MAXIMUM ROLLOVER AND * MAXIMUM SLOPE FROM EDGE OF SHOULDER VARIES FROM THE PHYSICAL NOSE TO THE GORE NOSE ACCORDING TO THE FOLLOWING:

FOR EXIT RAMPS: * 5% MAX. ROLLOVER AND ** 9% MAX. SLOPE FROM EDGE OF SHOULDER


FOR ENTRANCE RAMPS: * 7% MAX. ROLLOVER AND ** 10% MAX. SLOPE FROM EDGE OF SHOULDER




TRENCH DRAIN DETAIL


STANDARD B12-07

DATE	REVISIONS
3-01-2018	UPDATED MAX. ROLLOVER REQUIREMENTS. REVISED SECTION E-E HATCHING.
3-31-2016	REVISED PIPING BEND
3-11-2015	REVISED ROLLOVER. ADDED CATCH BASIN, TYPE B
3-31-2014	REVISED NOTES
2-01-2013	REVISED MAINLINE SHOULDER GRADE



 APPROVED CHIEF ENGINEERING OFFICER DATE 1-1-2011

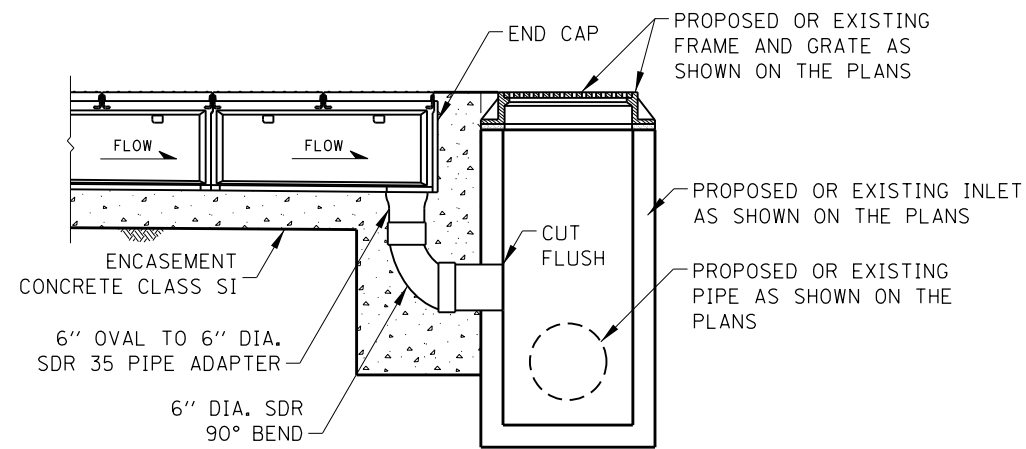


SECTION B-B
PIPE OUTLET TO DRAINAGE STRUCTURE

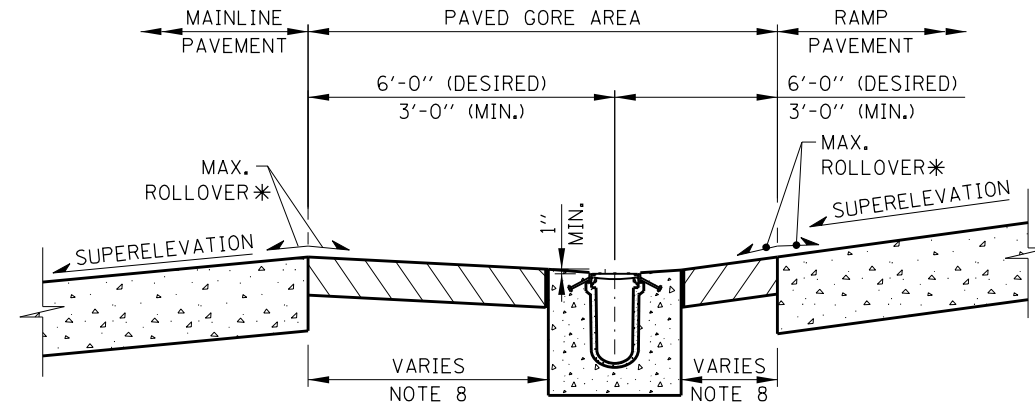

SECTION E-E
RAMP ON OUTSIDE OF
SUPERELEVATED MAINLINE SECTION

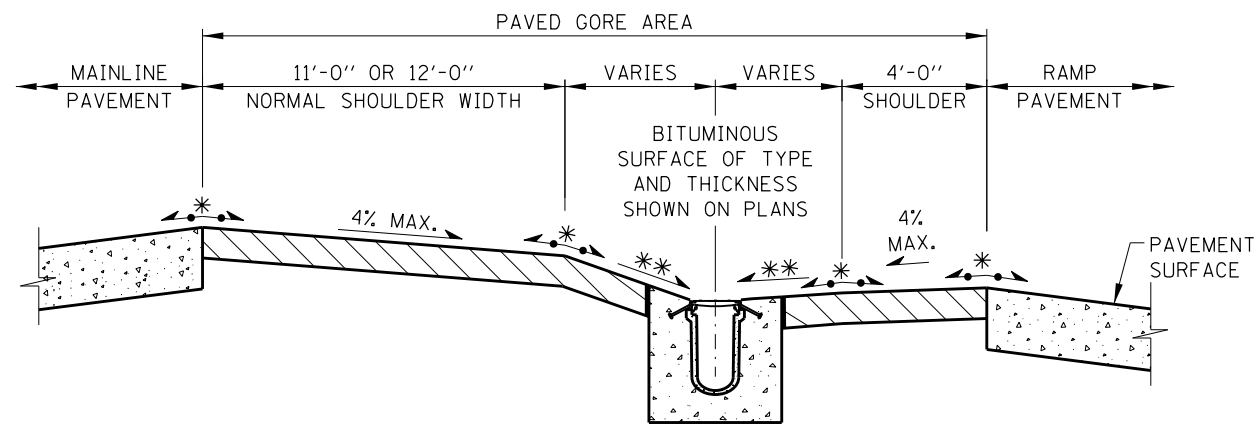


SECTION D-D

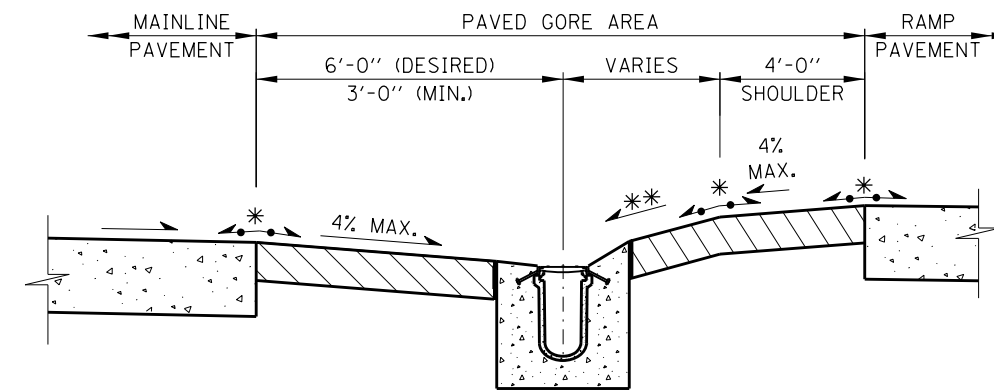


SECTION C-C

NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES.

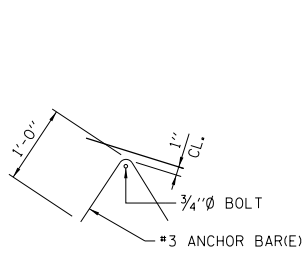


ANCHOR BARS
CONTRACTOR SHALL PROVIDE 2-#3 ANCHOR BARS (E) PER SIDEWALL BOLT.


DETAIL B

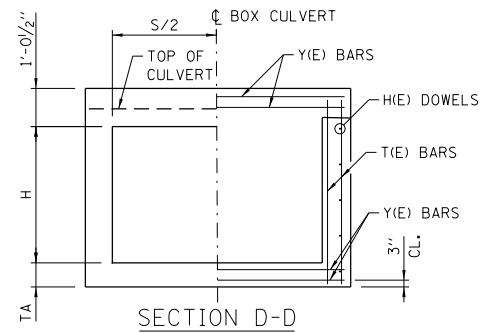


SECTION D-D

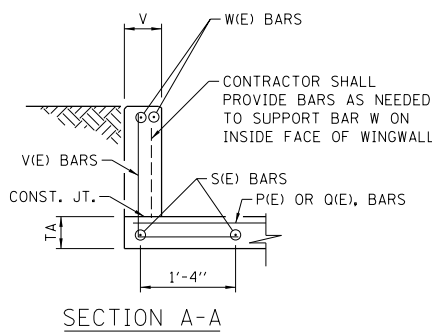


SECTION A-A

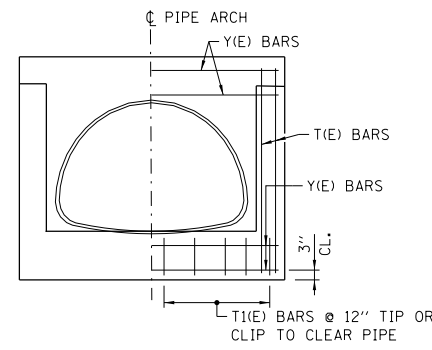

SECTION B-B

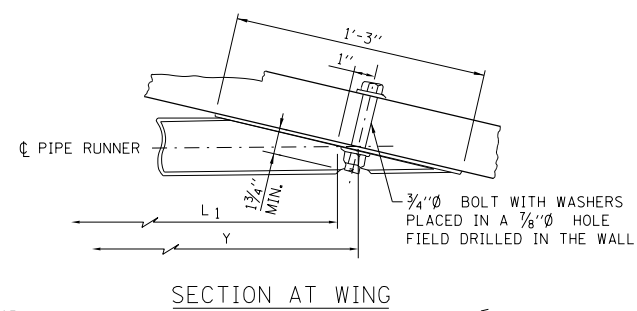


SECTION AT WING

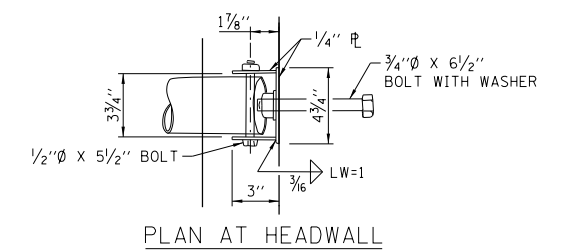

PLAN AT HEADWALL

NOTE:
A 3/4" x 9 1/2" BOLT WITH ADDITIONAL W WASHER PLACED IN A 7/8" HOLE DRILLED THROUGH THE HEADWALL OR A 3/4" x 8" THREADED ROD EPOXY GROUTED IN A 7/8" HOLE WITH A MINIMUM EMBEDMENT OF 6 5/8" MAY BE USED IN LIEU OF CAST-IN-PLACE BOLT SHOWN.

NOTE:
Q(E) BARS ARE TO BE FIELD CUT PER CUTTING DIAGRAM. PLACE BARS WITH DIMENSIONS C4-C6 BEGINNING AT HEADWALL AND BARS WITH DIMENSIONS C3-C6 BEGINNING AT THE TOEWALL END.

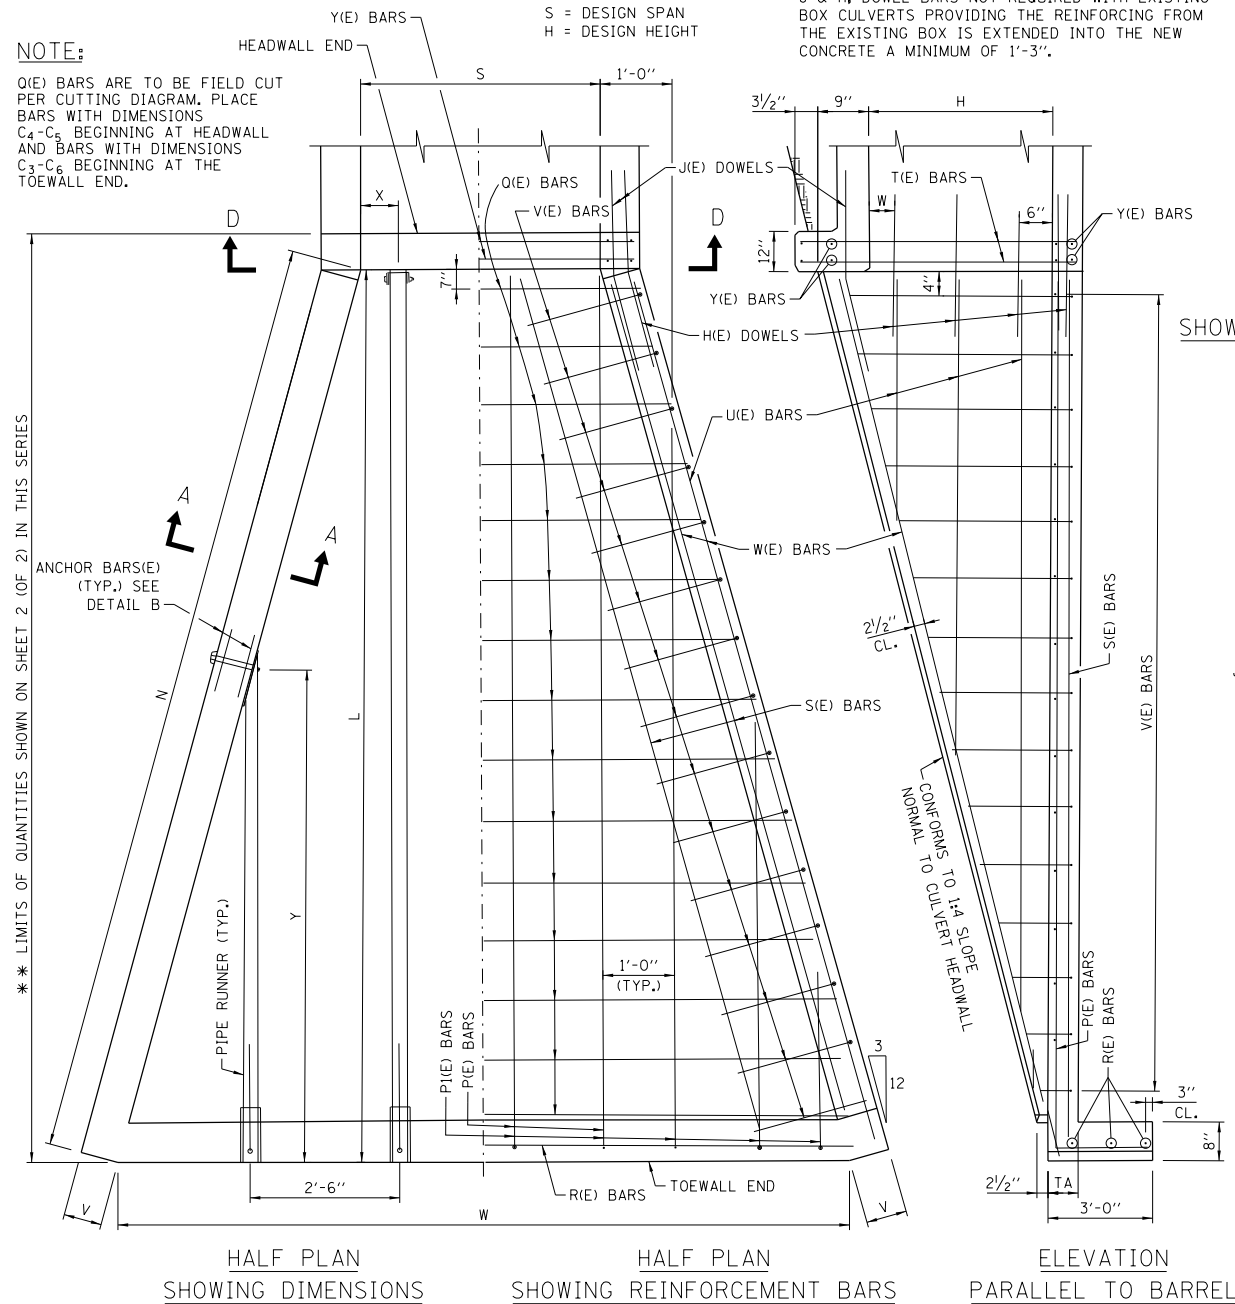

HALF PLAN SHOWING DIMENSIONS

HALF PLAN SHOWING REINFORCEMENT BARS


ELEVATION PARALLEL TO BARREL

BOX CULVERT DETAILS


** DOWEL BARS EXTENDING INTO THE CONCRETE BOX CULVERT ARE INCLUDED IN THE QUANTITIES

NOTE:
J & H, DOWEL BARS NOT REQUIRED WITH EXISTING BOX CULVERTS PROVIDING THE REINFORCING FROM THE EXISTING BOX IS EXTENDED INTO THE NEW CONCRETE A MINIMUM OF 1'-3".


S = DESIGN SPAN
H = DESIGN HEIGHT

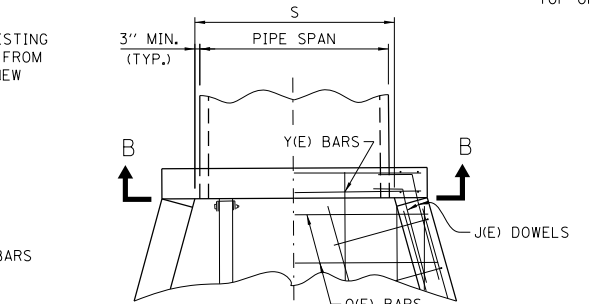


HALF PLAN SHOWING DIMENSIONS HALF PLAN SHOWING REINFORCEMENT BARS

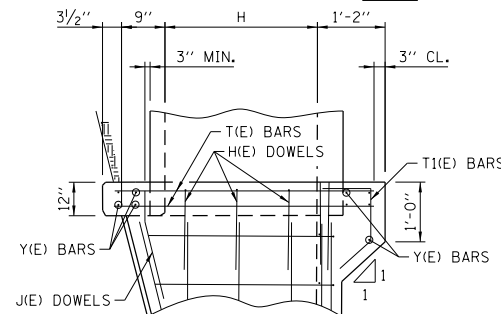

ELEVATION PIPE ARCH DETAILS

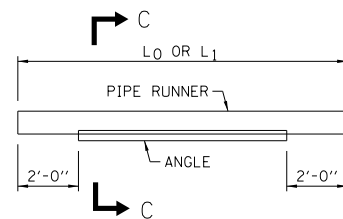


DETAIL A PIPE RUNNER DETAILS

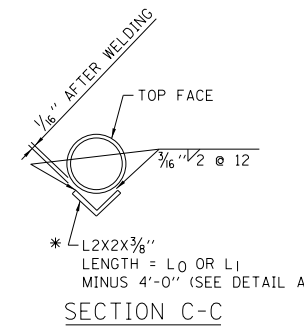


SECTION C-C

*** NOTE:**
WHERE L0 OR L1 EXCEEDS THE FOLLOWING LENGTH, THE PIPE RUNNER SHALL BE STRENGTHENED OVER THE MIDSPAN AS SHOWN.

PIPE	LENGTH
3"Ø, SCH. 40	12'-8"

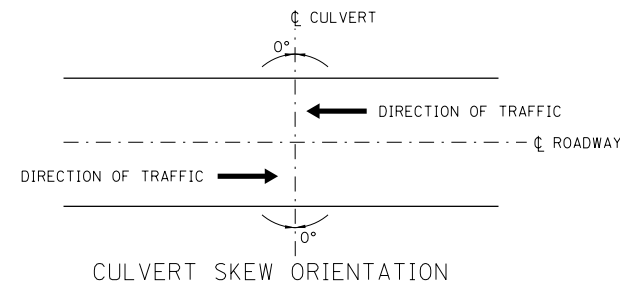


CULVERT SKEW ORIENTATION

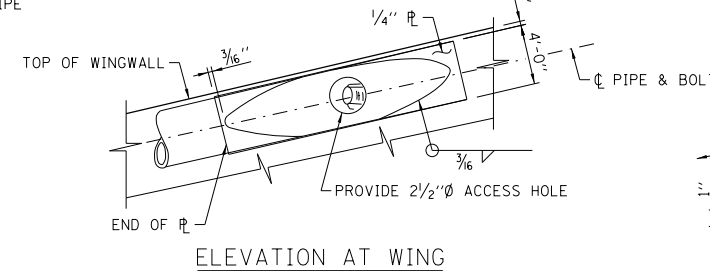


ELEVATION AT WING

NOTE:
PIPE O.D. IS THE PIPE RUNNER OUTSIDE DIAMETER.

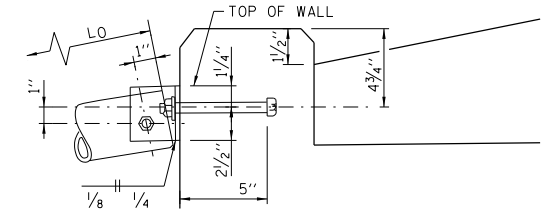

ELEVATION AT HEADWALL

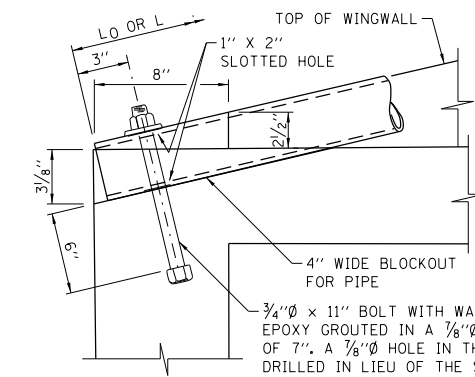

SECTION THRU TOEWALL

NOTE:
V, P1 AND U BARS ARE TO BE FIELD CUT PER CUTTING DIAGRAM. PLACE ONE-HALF THE BARS IN OR NEAR EACH WINGWALL BEGINNING WITH THE SHORTEST V BARS AND P1 BARS AT THE TOEWALL END AND LONGEST U BARS AT THE BOTTOM OF THE WALL.

GENERAL NOTES:

- ALL CONCRETE SHALL BE CLASS SI.
- ALL EXPOSED CONCRETE EDGES SHALL HAVE A 3/4" x 45° CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW FINISHED GROUND LEVEL. COVER FROM THE FACE OF CONCRETE TO THE FACE OF REINFORCEMENT BARS SHALL BE 2", UNLESS OTHERWISE SHOWN.
- CONCRETE QUANTITIES SHOWN ON SHEET 2 (OF 2) IN THIS SERIES ARE FOR REINFORCED CONCRETE BOX CULVERT SECTIONS AND ADDITIONAL CONCRETE REQUIRED IN HEADWALLS FOR PIPE OR ARCH CULVERT SECTIONS SHALL BE ADDED TO THESE QUANTITIES.
- THIS STANDARD MAY BE USED FOR CULVERTS WITH SKEW OF 0° ± 7.5°, AS SHOWN PER CULVERT SKEW ORIENTATION ON THIS SHEET.
- DESIGN: SAFETY PIPE RUNNERS ARE DESIGNED FOR A TRANSVERSING LOAD OF 1,800 POUNDS AT YIELD AS RECOMMENDED BY RESEARCH REPORT 280-1, SAFETY TREATMENT OF ROADSIDE CROSS DRAINAGE STRUCTURES, TEXAS TRANSPORTATION INSTITUTE, MARCH 1981.
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- FOR EROSION PROTECTION SEE STANDARD B19.
- ALL REINFORCEMENT BARS SHOWN SHALL BE EPOXY COATED (E).



DATE	REVISIONS
03-01-22	REVISED HEADWALL THICKNESS AND REBAR TABLE
03-11-15	REVISED NOTES
03-31-14	TABLE QUANTITIES REVISED
02-07-12	TABLE QUANTITIES REVISED


END TREATMENT WITH PIPE RUNNERS, FOR SINGLE CULVERTS 0° SKEW, 1:4 SLOPE, H ≤ 4'

CULVERT SIZE	TABLE OF DIMENSIONS							TOTAL QUANTITIES ONE END			PIPE RUNNERS FOR ONE END - SIZE 3" O.D.			
								CONC.	REINF. BARS	PIPE RUNNER	HEADWALL PIPE		WINGWALL PIPE	
	S x H	L	N	V	W	TA	X	Y	CU. YD.	POUND	FT.	NO.	L ₀	NO.
3 x 2	10'-10"	11'-2"	7"	8'-5"	6"	0'-3"	--	3.2	346	22.16	2	11'-1"	0	--
3 x 3	14'-10"	15'-3 1/2"	7"	10'-5"	6"	1'-6"	10'-10"	5.2	489	37.50	1	15'-2"	2	11'-2"
4 x 2	10'-10"	11'-2"	7"	9'-5"	6"	0'-9"	--	3.4	372	22.16	2	11'-1"	0	--
4 x 3	14'-10"	15'-3 1/2"	7"	11'-5"	6"	2'-0"	12'-10"	6.5	521	41.50	1	15'-2"	2	13'-2"
4 x 4	18'-10"	19'-5"	7"	13'-5"	6"	0'-9"	11'-10"	8.1	727	63.00	2	19'-4"	2	12'-2"
5 x 2	10'-10"	11'-2"	7"	10'-5"	6"	1'-3"	5'-10"	3.7	397	34.16	2	11'-1"	2	6'-0"
5 x 3	14'-10"	15'-3 1/2"	7"	12'-5"	6"	1'-3"	9'-10"	5.9	554	50.50	2	15'-2"	2	10'-1"
5 x 4	18'-10"	19'-5"	7"	14'-5"	6"	1'-3"	13'-10"	8.5	765	67.17	2	19'-4"	2	14'-3"
6 x 3	14'-10"	15'-3 1/2"	7"	13'-5"	6"	1'-9"	11'-10"	6.2	583	54.67	2	15'-2"	2	12'-2"
6 x 4	18'-10"	19'-5"	7"	15'-5"	6"	0'-6"	10'-10"	8.9	800	80.33	3	19'-4"	2	11'-2"
7 x 3	14'-10"	15'-3 1/2"	7"	14'-5"	6 1/2"	2'-3"	13'-10"	6.5	614	58.83	2	15'-2"	2	14'-3"
7 x 4	18'-10"	19'-5"	7"	16'-5"	6 1/2"	1'-0"	12'-10"	9.3	835	84.33	3	19'-4"	2	13'-2"
8 x 4	18'-10"	19'-5"	7"	17'-5"	7"	0'-3"	9'-10"	9.7	871	97.50	4	19'-4"	2	10'-1"

PIPE ARCH AND ELLIPTICAL PIPE CULVERTS

FOR PIPE ARCH OR ELLIPTICAL PIPE CULVERTS SELECT APPROPRIATE "S" & "H" FROM SIZES SHOWN. ADD THE FOLLOWING ADDITIONAL BARS:

- (a) 1 ADDITIONAL (Y) BAR
- (b) #4 - T1(E) BARS @ APPROX. 12" CTS. (NO. = S + 2)




T1(E) BARS

THE WEIGHT OF THE ADDITIONAL BARS AND THE ADDITIONAL QUANTITY OF CONCRETE IN THE HEADWALL SHALL BE ADDED TO THE QUANTITIES SHOWN.


CULVERT SIZE	TABLE OF REINFORCING STEEL FOR ONE END																														
	H(E) DOWEL #4 @ 12"		J(E) DOWEL #6		P(E) BARS #4 @ 12"		P1(E) BARS #4 @ 12"			Q(E) BARS #4 @ 12"						R(E) BARS 3-#4	S(E) BARS 4-#4	U(E) BARS #4 @ 12"			V(E) BARS #4 @ 10.5"			4 W(E) BARS		Y(E) BARS 8-#5	T(E) BARS 8-#5 BOX CULVERT	T(E) BARS 8-#5 PIPE ARCH			
	NO.	LENGTH.	NO.	LENGTH.	NO.	LENGTH.	NO.	C ₁	C ₂	LENGTH.	NO.	C ₃	C ₄	C ₅	C ₆	LENGTH.	LENGTH.	LENGTH.	NO.	C ₇	C ₈	LENGTH.	NO.	C ₉	C ₁₀	LENGTH.	SIZE	LENGTH.	LENGTH.	LENGTH.	LENGTH.
3 x 2	6	2'-6"	4	4'-0"	4	13'-1"	2	8'-4"	4'-4"	17'-10"	5	8'-8"	4'-2"	6'-2"	6'-8"	12'-10"	8'-9"	10'-10"	2	8'-7"	4'-5"	13'-0"	11	2'-9"	6"	6'-3"	#5	10'-4"	3'-8"	3'-2"	3'-8"
3 x 3	8	2'-6"	4	4'-0"	4	17'-1"	3	12'-4"	4'-4"	21'-10"	7	10'-8"	4'-2"	7'-2"	7'-8"	14'-10"	10'-9"	15'-0"	3	12'-8"	4'-5"	17'-1"	16	3'-9"	6"	7'-3"	#5	14'-6"	3'-8"	4'-2"	4'-8"
4 x 2	6	2'-6"	4	4'-0"	5	13'-1"	2	8'-4"	4'-4"	17'-10"	5	9'-8"	5'-2"	7'-2"	7'-8"	14'-10"	9'-9"	10'-10"	2	8'-7"	4'-5"	13'-0"	11	2'-9"	6"	6'-3"	#5	10'-4"	4'-8"	3'-2"	3'-8"
4 x 3	8	2'-6"	4	4'-0"	5	17'-1"	3	12'-4"	4'-4"	21'-10"	7	11'-8"	5'-2"	8'-2"	8'-8"	16'-10"	11'-9"	15'-0"	3	12'-8"	4'-5"	17'-1"	16	3'-9"	6"	7'-3"	#5	14'-6"	4'-8"	4'-2"	4'-8"
4 x 4	10	2'-6"	4	4'-0"	5	21'-1"	4	16'-4"	4'-4"	25'-10"	9	13'-8"	5'-2"	9'-2"	9'-8"	18'-10"	13'-9"	19'-1"	4	16'-9"	4'-5"	21'-2"	21	4'-9"	6"	8'-3"	#6	18'-7"	4'-8"	5'-2"	5'-8"
5 x 2	6	2'-6"	4	4'-0"	6	13'-1"	2	8'-4"	4'-4"	17'-10"	5	10'-8"	6'-2"	8'-2"	8'-8"	16'-10"	10'-9"	10'-10"	2	8'-7"	4'-5"	13'-0"	11	2'-9"	6"	6'-3"	#5	10'-4"	5'-8"	3'-2"	3'-8"
5 x 3	8	2'-6"	4	4'-0"	6	17'-1"	3	12'-4"	4'-4"	21'-10"	7	12'-8"	6'-2"	9'-2"	9'-8"	18'-10"	12'-9"	15'-0"	3	12'-8"	4'-5"	17'-1"	16	3'-9"	6"	7'-3"	#5	14'-6"	5'-8"	4'-2"	4'-8"
5 x 4	10	2'-6"	4	4'-0"	6	21'-1"	4	16'-4"	4'-4"	25'-10"	9	14'-8"	6'-2"	10'-2"	10'-8"	20'-10"	14'-9"	19'-1"	4	16'-9"	4'-5"	21'-2"	21	4'-9"	6"	8'-3"	#6	18'-7"	5'-8"	5'-2"	5'-8"
6 x 3	8	2'-6"	4	4'-0"	7	17'-1"	3	12'-4"	4'-4"	21'-10"	7	13'-8"	7'-2"	10'-2"	10'-8"	20'-10"	13'-9"	15'-0"	3	12'-8"	4'-5"	17'-1"	16	3'-9"	6"	7'-3"	#5	14'-6"	6'-8"	4'-2"	4'-8"
6 x 4	10	2'-6"	4	4'-0"	7	21'-1"	4	16'-4"	4'-4"	25'-10"	9	15'-8"	7'-2"	11'-2"	11'-8"	22'-10"	15'-9"	19'-1"	4	16'-9"	4'-5"	21'-2"	21	4'-9"	6"	8'-3"	#6	18'-7"	6'-8"	5'-2"	5'-8"
7 x 3	8	2'-6"	4	4'-0"	8	17'-1"	3	12'-4"	4'-4"	21'-10"	7	14'-8"	8'-2"	11'-2"	11'-8"	22'-10"	14'-9"	15'-0"	3	12'-8"	4'-5"	17'-1"	16	3'-9"	6"	7'-3"	#5	14'-6"	7'-8"	4'-2"	4'-8"
7 x 4	10	2'-6"	4	4'-0"	8	21'-1"	4	16'-4"	4'-4"	25'-10"	9	16'-8"	8'-2"	12'-2"	12'-8"	24'-10"	16'-9"	19'-1"	4	16'-9"	4'-5"	21'-2"	21	4'-9"	6"	8'-3"	#6	18'-7"	7'-8"	5'-2"	5'-8"
8 x 4	10	2'-6"	4	4'-0"	9	21'-1"	4	16'-4"	4'-4"	25'-10"	9	17'-8"	9'-2"	13'-2"	13'-8"	26'-10"	17'-9"	19'-1"	4	16'-9"	4'-5"	21'-2"	21	4'-9"	6"	8'-3"	#6	18'-7"	8'-8"	5'-3"	5'-8"

NOTE:

REINFORCEMENT BARS BENDING DIMENSIONS ARE OUT TO OUT.

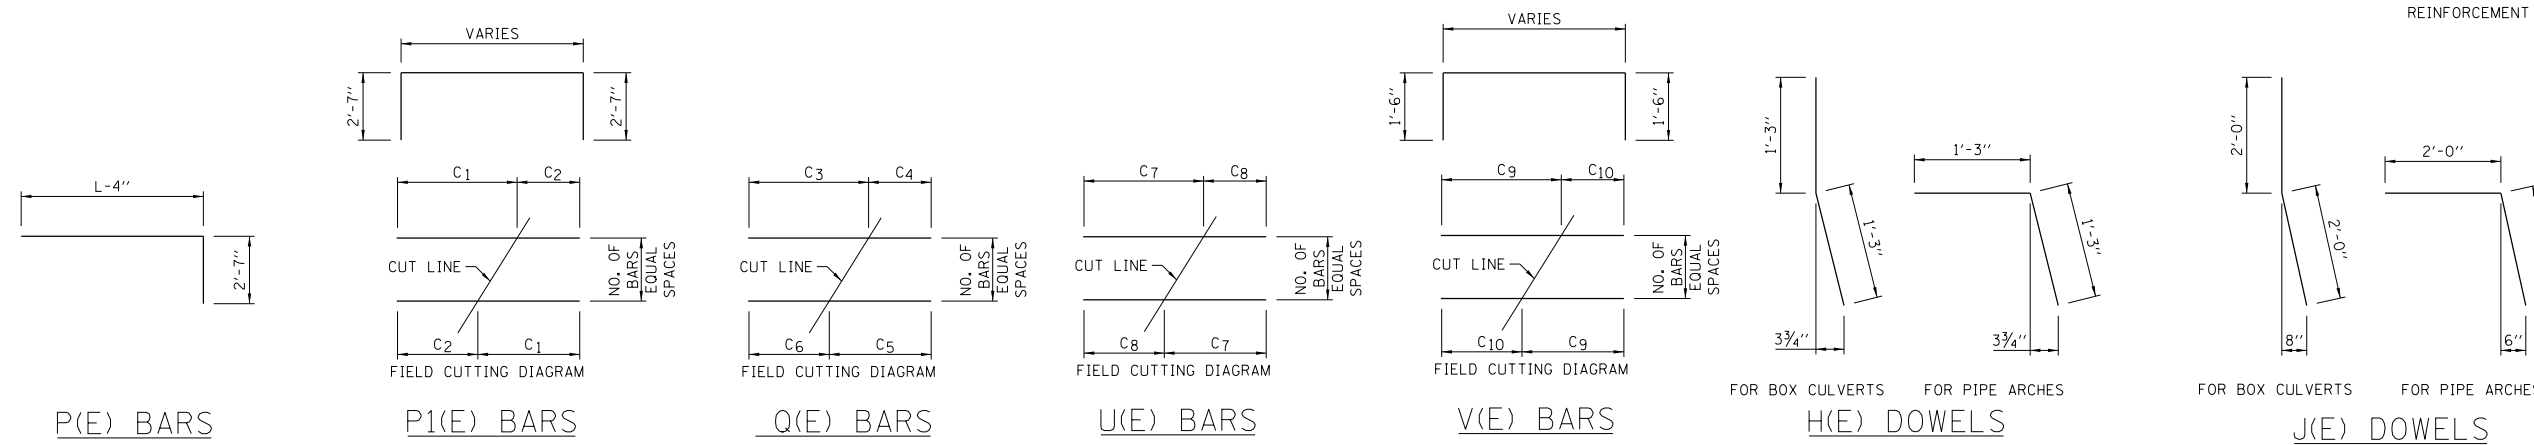

END TREATMENT WITH PIPE RUNNERS, FOR SINGLE CULVERTS
0° SKEW, 1:4 SLOPE, H ≤ 4'




ANCHOR BARS

CONTRACTOR SHALL PROVIDE 2-#3 ANCHOR BARS(E) PER SIDEWALL BOLT.

DETAIL B


NOTE:

F & V BAR TO BE FIELD CUT PER CUTTING DIAGRAM. PLACE BARS WITH DIMENSIONS C2, C6 BEGINNING AT HEADWALL & BARS WITH DIMENSIONS C1, C5 BEGINNING AT THE TOEWALL END.

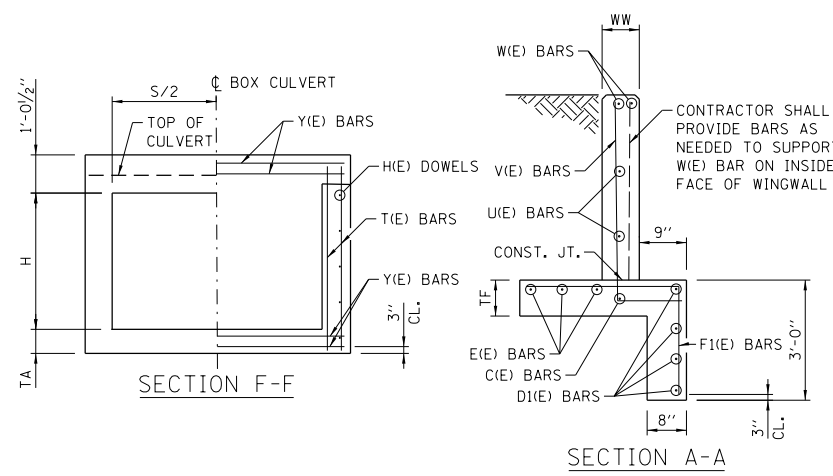


NOTE:

J & H, DOWEL BARS NOT REQUIRED WITH EXISTING BOX CULVERTS PROVIDING THE REINFORCING FROM THE EXISTING BOX IS EXTENDED INTO THE NEW CONCRETE A MINIMUM OF 1'-3".

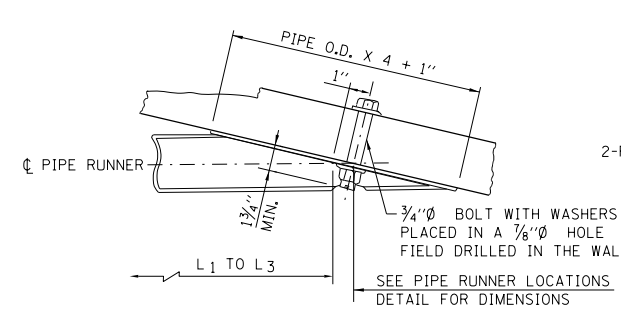


SECTION AT WING

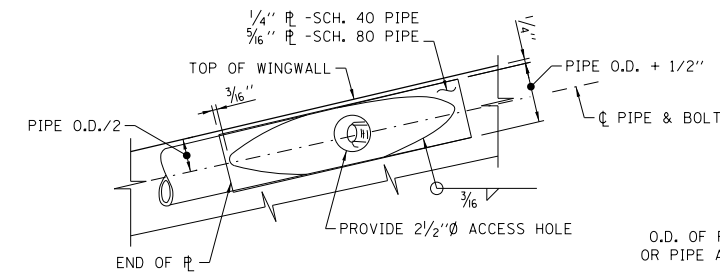


ELEVATION AT WING


NOTE:
PIPE O.D. IS THE PIPE RUNNER OUTSIDE DIAMETER.

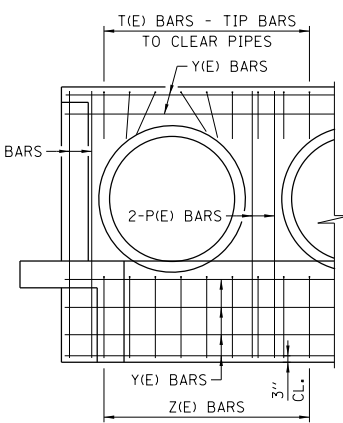

SECTION C-C

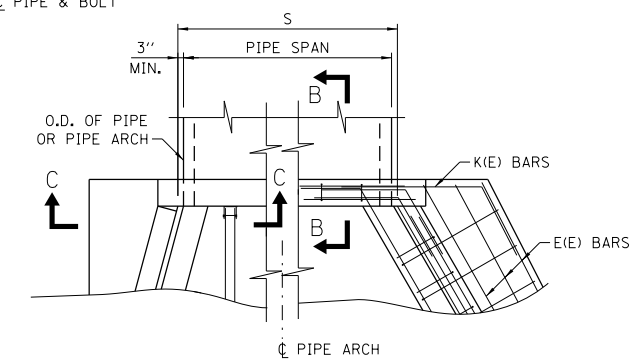


HALF PLAN SHOWING DIMENSIONS
HALF PLAN SHOWING REINFORCEMENT BARS

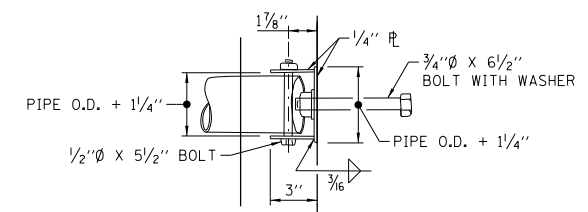


PLAN AT HEADWALL


NOTE:
A 3/4" x 9 1/2" BOLT WITH ADDITIONAL W WASHER PLACED IN A 1/8" HOLE DRILLED THROUGH THE HEADWALL OR A 3/4" x 8" THREADED ROD EPOXY GROUTED IN A 7/8" HOLE WITH A MINIMUM EMBEDMENT OF 6 5/8" MAY BE USED IN LIEU OF CAST-IN-PLACE BOLT SHOWN.

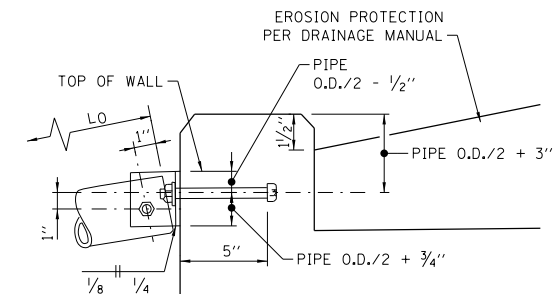

ELEVATION AT HEADWALL

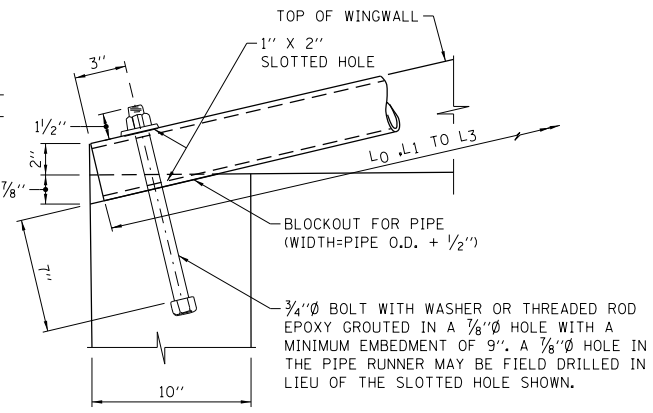


SECTION THRU TOEWALL

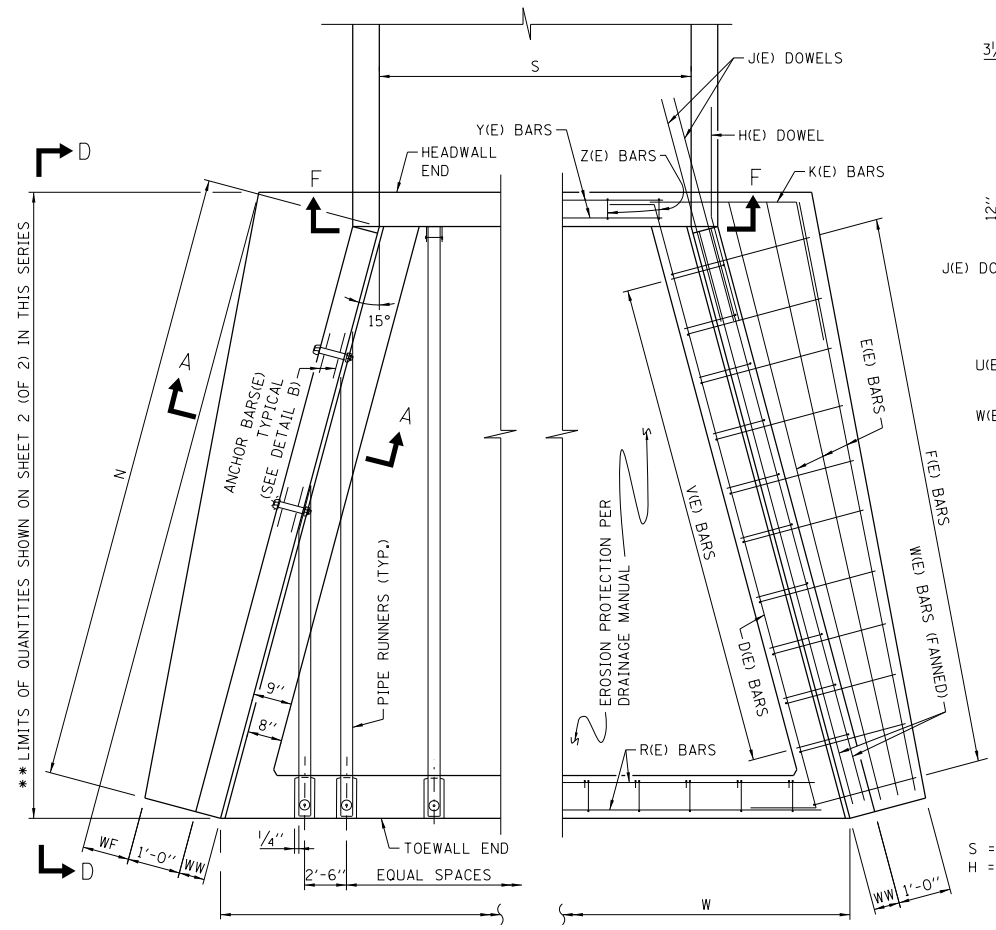


HALF PLAN SHOWING DIMENSIONS
HALF PLAN SHOWING REINFORCEMENT BARS

FOR BOX CULVERTS


** DOWEL BARS EXTENDING INTO THE CONCRETE BOX CULVERT ARE INCLUDED IN THE QUANTITIES.

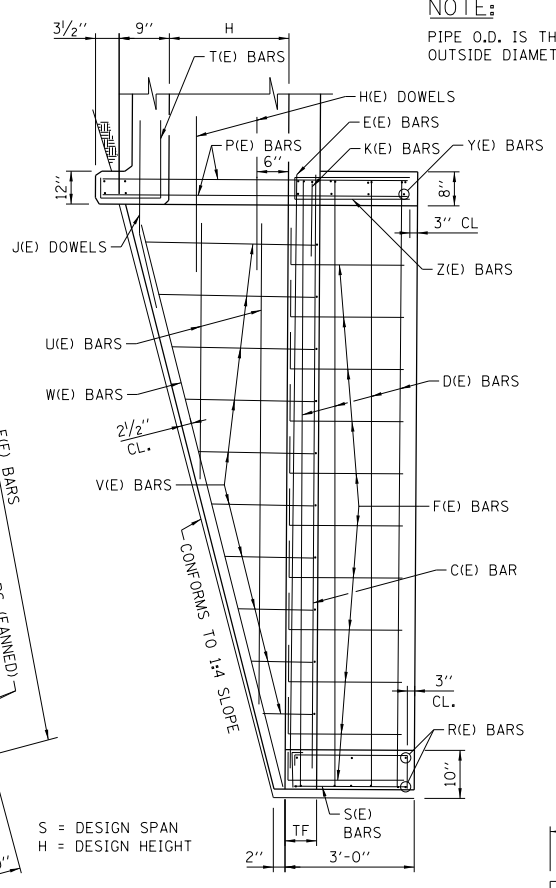

ELEVATION D-D

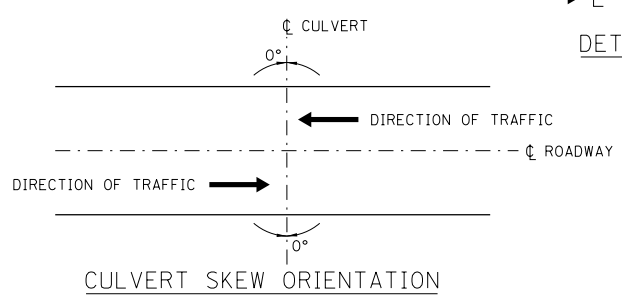


CULVERT SKEW ORIENTATION

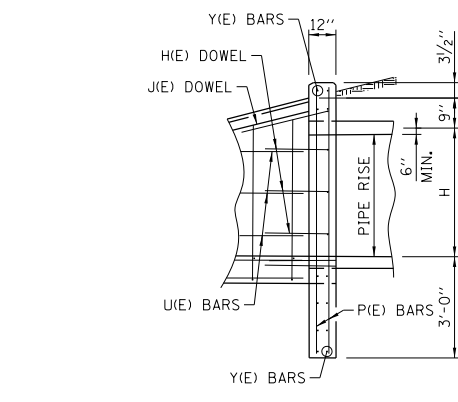


SECTION B-B

FOR PIPE AND PIPE-ARCH CULVERTS

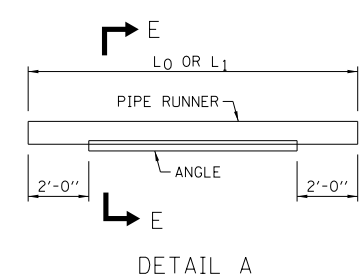

DETAIL A

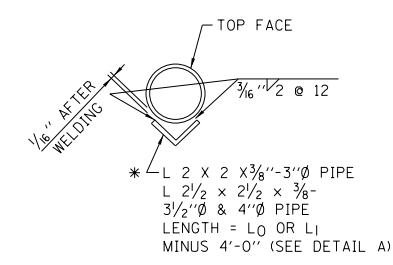

SECTION E-E

***NOTE:**

WHERE L0 OR L1 EXCEEDS THE FOLLOWING LENGTH, THE PIPE RUNNER SHALL BE STRENGTHENED OVER THE MIDSPAN AS SHOWN.

PIPE	LENGTH
3"Ø, SCH. 40	12'-8"
3 1/2"Ø, SCH. 40	17'-3"
3 1/2"Ø, SCH. 80	22'-1"
4"Ø, SCH. 40	22'-6"
4"Ø, SCH. 80	29'-4"

PIPE RUNNER DETAILS

GENERAL NOTES:

- ALL CONCRETE SHALL BE CLASS S1.
- ALL EXPOSED CONCRETE EDGES SHALL HAVE A 3/4" x 45° CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW FINISHED GROUND LEVEL. COVER FROM THE FACE OF CONCRETE TO THE FACE OF REINFORCEMENT BARS SHALL BE 2", UNLESS OTHERWISE SHOWN.
- CONCRETE QUANTITIES SHOWN ON SHEET 2 (OF 2) IN THIS SERIES ARE FOR REINFORCED CONCRETE BOX CULVERT SECTIONS AND ADDITIONAL CONCRETE REQUIRED IN HEADWALLS FOR PIPE OR ARCH CULVERT SECTIONS SHALL BE ADDED TO THESE QUANTITIES.
- THIS STANDARD MAY BE USED FOR CULVERTS WITH SKEW OF 0° ± 7.5°. AS SHOWN PER CULVERT SKEW ORIENTATION ON THIS SHEET.
- DESIGN: SAFETY PIPE RUNNERS ARE DESIGNED FOR A TRANSVERSING LOAD OF 1,800 POUNDS AT YIELD AS RECOMMENDED BY RESEARCH REPORT 280-1, SAFETY TREATMENT OF ROADSIDE CROSS DRAINAGE STRUCTURES, TEXAS TRANSPORTATION INSTITUTE, MARCH 1981.
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- FOR EROSION PROTECTION SEE STANDARD B19.
- ALL REINFORCEMENT BARS SHALL BE EPOXY COATED (E).




DATE	REVISIONS
3-01-2022	REVISED HEADWALL THICKNESS AND REBAR TABLE
3-11-2015	REVISED NOTES
3-31-2014	TABLE QUANTITIES REVISED
2-07-2012	TABLE QUANTITIES REVISED


END TREATMENT WITH PIPE RUNNERS, FOR SINGLE AND MULTIPLE CULVERTS
0° SKEW, 1:4 SLOPE, H ≤ 8'
STANDARD B14-06

APPROVED: *Paul Kovacs* DATE 6-1-2009
CHIEF ENGINEERING OFFICER


TABLE OF DIMENSIONS												TABLE OF REINFORCEMENT BARS FOR ONE END																			
S	H	L	WF	WW	TF	N	C(E) BARS 2 REQ'D.		D(E) BARS 8-#4		E(E) BARS #4 ⑤		F(E) BARS			H(E) DOWEL #5 @ 12"		J(E) DOWEL 4-#6		K(E) DOWEL 2-#5		U(E) BARS #4 @ 12"			V(E) BARS #5 @ 6" CTS.				W(E) BARS 4 REQ'D.		
							SIZE	LENGTH	LENGTH	NO.	LENGTH	SIZE	NO.	C ₁	C ₂	LENGTH	NO.	LENGTH	LENGTH	LENGTH	NO.	C ₃	C ₄	LENGTH	NO.	C ₅	C ₆	C ₇	LENGTH	SIZE	LENGTH
9'	3'	14'-4"	3"	7"	7"	14'-10 7/8"	#4	15'-2"	17'-2"	4	16'-8"	#4	15	2'-0"	2'-2"	9'-4"	6	3'-0"	4'-6"	4'-0"	3	12'-8"	4'-5"	17'-1"	28	9"	3'-10"	1'-0"	6'-7"	#5	14'-11"
9'	4'	18'-4"	9"	7"	8"	18'-11 3/4"	#4	19'-4"	21'-4"	4	20'-10"	#4	19	2'-0"	2'-8"	9'-10"	8	3'-0"	4'-6"	4'-6"	4	16'-10"	4'-5"	21'-3"	36	10"	4'-11"	1'-0"	7'-9"	#6	19'-2"
5'	5'	22'-4"	1'-3"	7"	8"	23'-1 1/2"	#4	23'-6"	25'-6"	4	25'-0"	#4	23	2'-0"	3'-2"	10'-4"	10	3'-0"	4'-6"	5'-0"	5	20'-11"	4'-5"	25'-4"	44	10"	5'-11"	1'-0"	8'-9"	#6	23'-5"
6'	6'	26'-4"	1'-9"	7"	8 1/2"	27'-3 3/8"	#4	27'-7"	29'-7"	6	29'-1"	#5	27	2'-0"	3'-8"	10'-10"	12	3'-0"	4'-6"	5'-6"	6	25'-1"	4'-5"	29'-6"	52	10"	6'-11"	1'-0"	9'-9"	#6	27'-8"
7'	7'	30'-4"	2'-3"	7"	9"	31'-4 7/8"	#5	31'-9"	33'-9"	6	33'-3"	#5	31	2'-1"	4'-3"	11'-6"	14	3'-0"	4'-6"	6'-0"	7	29'-2"	4'-5"	33'-7"	60	11"	8'-0"	1'-0"	10'-11"	#6	31'-11"
8'	8'	34'-4"	2'-9"	8 1/2"	9 1/2"	35'-6 1/2"	#5	35'-10"	37'-10"	6	37'-4"	#6	35	2'-2"	4'-10"	12'-2"	16	3'-0"	4'-6"	6'-6"	8	33'-4"	4'-5"	37'-9"	68	11"	9'-0"	1'-1"	12'-1"	#6	36'-2"

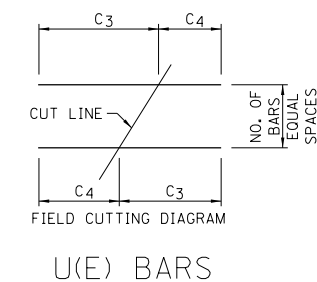

PIPE RUNNERS FOR ONE END								
S	H	SIZE (DIA.)	SCHEDULE	NO. WINGWALL PIPES	L1	L2	L3	LENGTH (FT.)
9'	3'	3"	40	2	9'-11"	--	--	19.84
9'	4'	3"	40	2	14'-0"	--	--	28.00
5'	5'	3 1/2"	40	4	18'-1"	8'-6"	--	53.16
6'	6'	3 1/2"	80	4	22'-3"	12'-7"	--	69.66
7'	7'	4"	40	6	26'-4"	16'-9"	7'-2"	100.50
8'	8'	4"	80	6	30'-6"	20'-10"	11'-7"	125.83

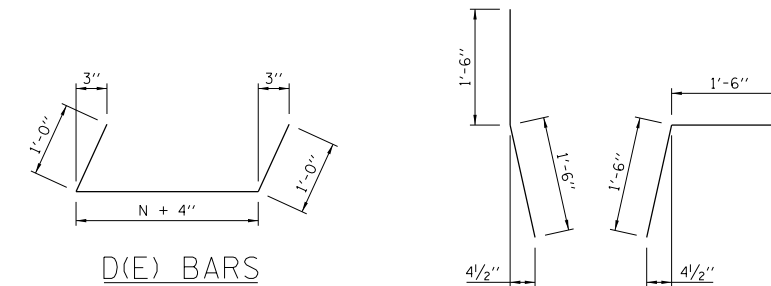






S	H	W ④	TABLE OF REINFORCEMENT BARS FOR MINIMUM "S"						HEADWALL PIPE RUNNERS FOR MINIMUM "S"					QUANTITIES FOR MIN. "S" (SINGLE PIPE OR CONC. BOX CULVERT)		INCREASE IN QUANTITIES FOR 1' INCREASE IN "S"				
			② Y(E) BARS 12-#5		① Z(E) BARS #4 @ 12"		② R(E) BARS 6-#5		① S(E) BARS #4 @ 12"		① T(E) BARS #4 @ 12"		③ P(E) BARS 8-#5		SIZE (DIA.)	SCHEDULE	NO.	L ₀	LENGTH (FT.)	CONCRETE CU. YD.
IV 9'	3'	16'-8"	9'-10"	9	5'-4"	15'-10"	16	6'-10"	9	3'-0"	6'-8"	3"	40	4	14'-9"	59.00	7.24	863	0.35	13
IV 9'	4'	18'-9"	9'-10"	9	5'-4"	17'-11"	18	6'-10"	9	3'-0"	7'-8"	3"	40	4	18'-10"	75.33	10.44	1078	0.35	13
IV 5'	5'	16'-11"	5'-10"	5	5'-4"	16'-1"	16	6'-10"	5	3'-0"	8'-8"	3 1/2"	40	2	23'-0"	46.00	10.87	1162	0.35	13
IV 6'	6'	20'-1"	6'-10"	6	5'-4"	19'-3"	19	6'-10"	6	3'-0"	9'-8"	3 1/2"	80	3	27'-2"	81.51	14.77	1553	0.35	13
IV 7'	7'	23'-3"	7'-10"	7	5'-4"	22'-5"	22	6'-10"	7	3'-0"	10'-8"	4"	40	3	31'-3"	93.75	19.47	1869	0.35	13
IV 8'	8'	26'-4"	9'-0"	8	5'-4"	25'-6"	25	6'-10"	8	3'-0"	11'-8"	4"	80	4	35'-4"	141.33	25.01	2379	0.35	13

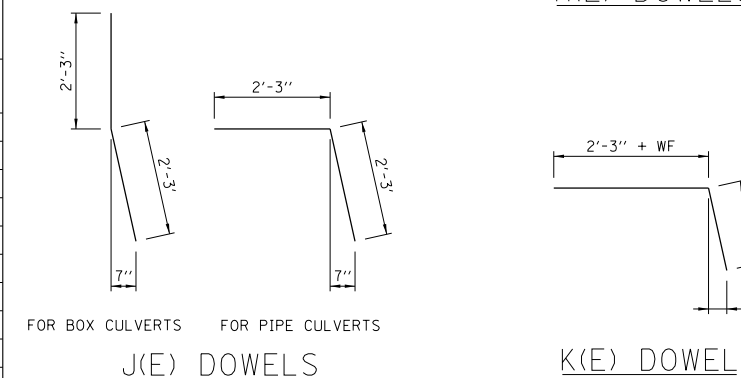


NUMBER OF HDWL PIPE RUNNERS FOR ONE END			
S	No	S	No
10'	4	23'	10
11'	5	24'	10
12'	5	25'	10
13'	6	26'	11
14'	6	27'	11
15'	6	28'	12
16'	7	29'	12
17'	7	30'	12
18'	8	31'	13
19'	8	32'	13
20'	8	33'	14
21'	9	34'	14
22'	9	35'	14


NOTE:
REINFORCEMENT BARS BENDING DIMENSIONS ARE OUT TO OUT.

- NOTES FOR TABLE OF DIMENSIONS:
- ① THE NUMBER OF S, T AND Z BARS SHALL BE INCREASED BY 1 FOR EACH 1 FOOT OF INCREASE IN DIMENSION "S".
 - ② THE LENGTH OF R AND Y BARS SHALL BE INCREASED BY 1 FOOT FOR EACH 1 FOOT OF INCREASE IN DIMENSION "S".
 - ③ THE NUMBER OF P BARS SHOWN ARE FOR SINGLE SPAN PIPES OR BOX CULVERTS. THIS NUMBER SHALL BE INCREASED BY 4 FOR EACH MULTIPLE OF PIPE OR BOX ADDED.
 - ④ THIS DIMENSION SHALL BE INCREASED BY 1 FOOT FOR EACH 1 FOOT INCREASE IN DIMENSION "S".
 - ⑤ THE LENGTH OF THIS BAR INCLUDES ONE 1'-6" MINIMUM LAP.

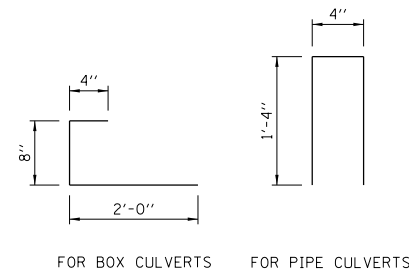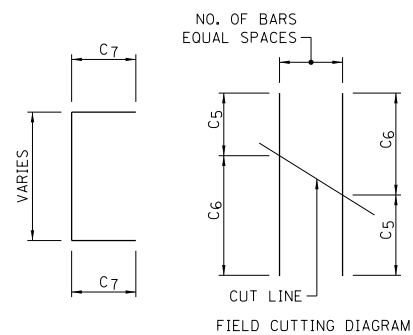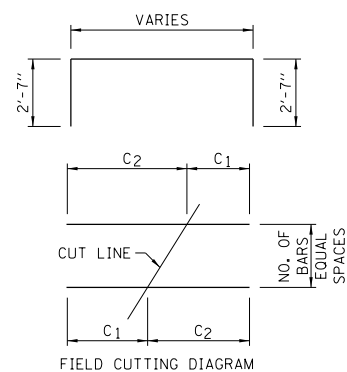

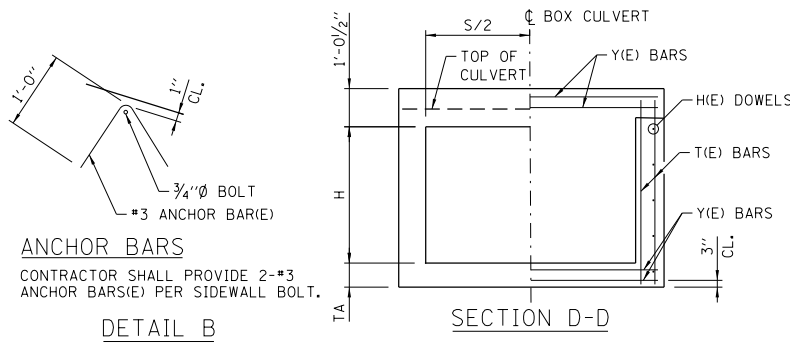


ANCHOR BARS
CONTRACTOR SHALL PROVIDE 2-#3 ANCHOR BARS(E) PER SIDEWALL BOLT.

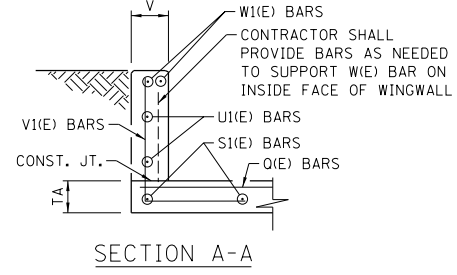



NOTE:
Q, V, AND V1 BARS ARE TO BE FIELD CUT PER CUTTING DIAGRAM. PLACE BARS WITH DIMENSIONS C2-C3, C9-C12 BEGINNING AT HEADWALL AND BARS WITH DIMENSIONS C1-C4, C10-C11 BEGINNING AT THE TOEWALL END.

NOTE:
P1 BARS ARE TO BE FIELD CUT PER CUTTING DIAGRAM. PLACE BARS WITH DIMENSIONS C6-C7 BEGINNING AT TOEWALL END OF 30° WING AND BARS WITH DIMENSIONS C5-C8 BEGINNING PARALLEL THE P1(E) BARS.




NOTE:
J & H DOWEL BAR NOT REQUIRED WITH EXISTING BOX CULVERTS PROVIDING THE REINFORCING FROM THE EXIST. BOX IS EXTENDED INTO THE NEW CONCRETE A MIN. OF 1'-3".

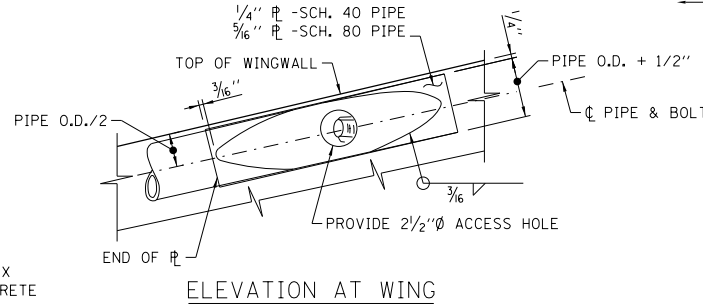


NOTE:
PIPE O.D. IS THE PIPE RUNNER OUTSIDE DIAMETER.

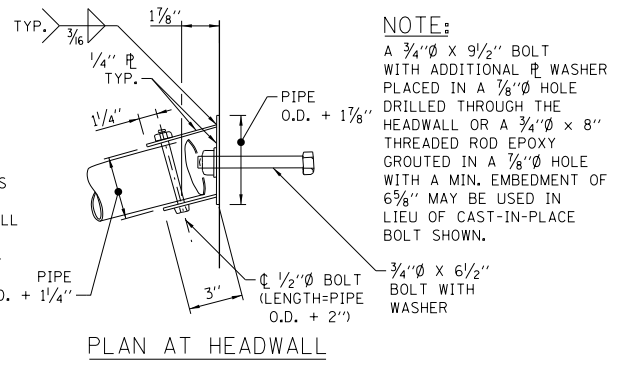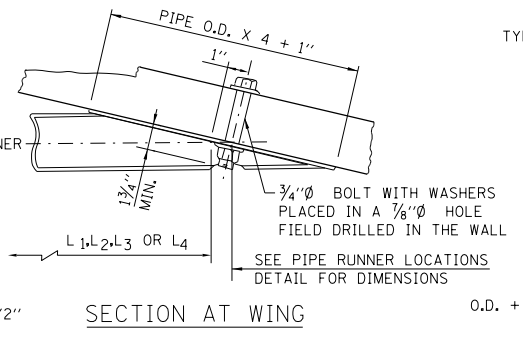


NOTE:
A 3/4" x 9/2" BOLT WITH ADDITIONAL W WASHER PLACED IN A 1/8" HOLE DRILLED THROUGH THE HEADWALL OR A 3/4" x 8" THREADED ROD EPOXY GROUTED IN A 1/8" HOLE WITH A MIN. EMBEDMENT OF 6 1/2" MAY BE USED IN LIEU OF CAST-IN-PLACE BOLT SHOWN.

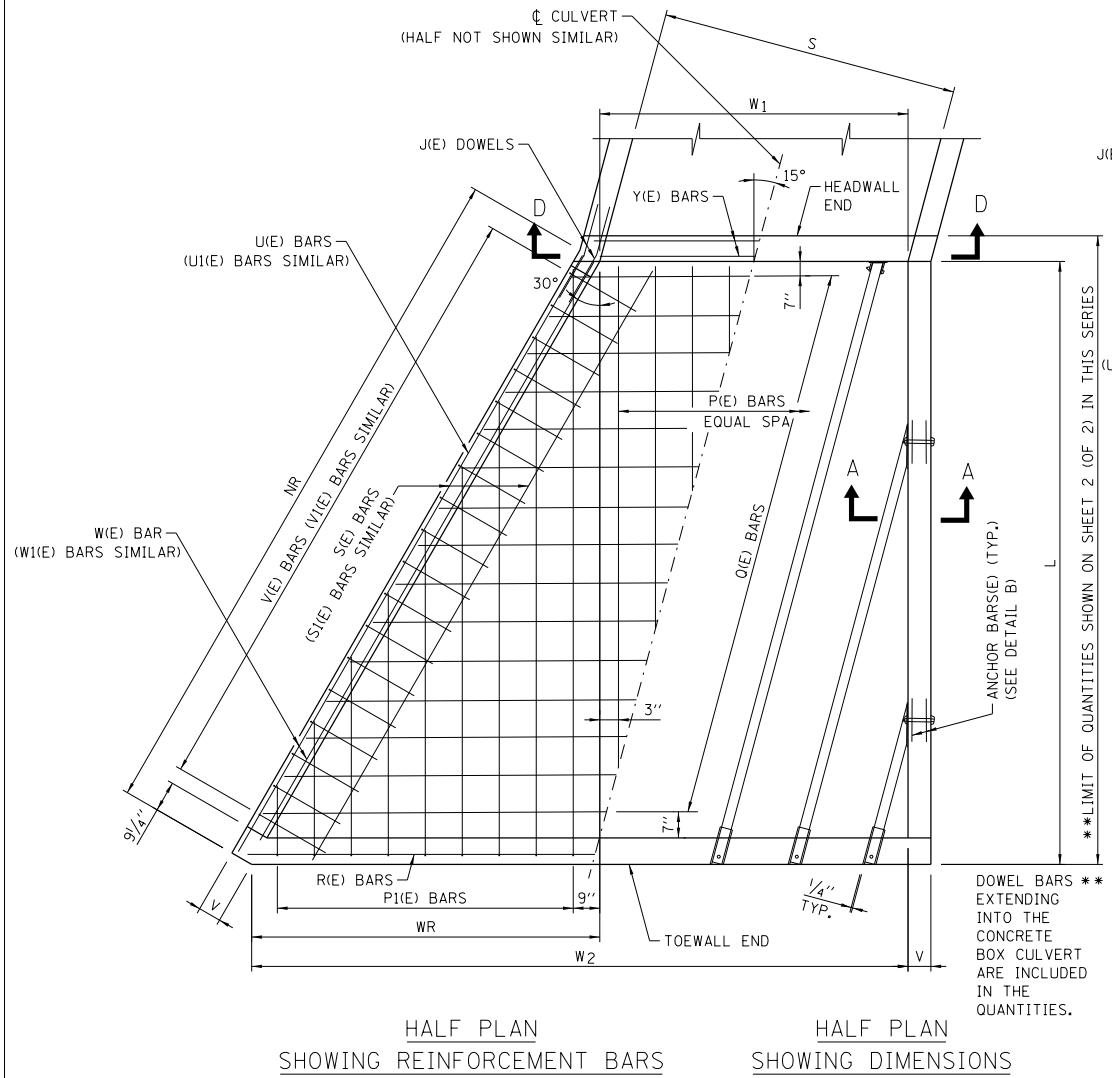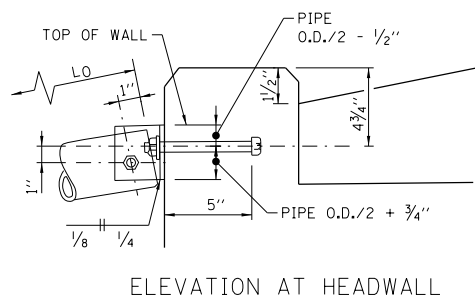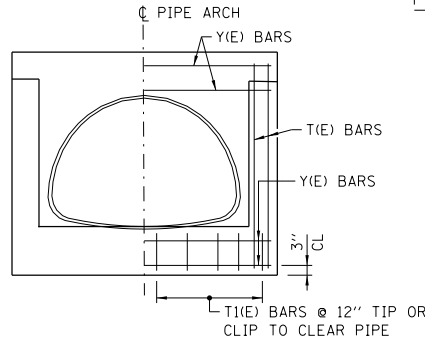


BOX CULVERT DETAILS

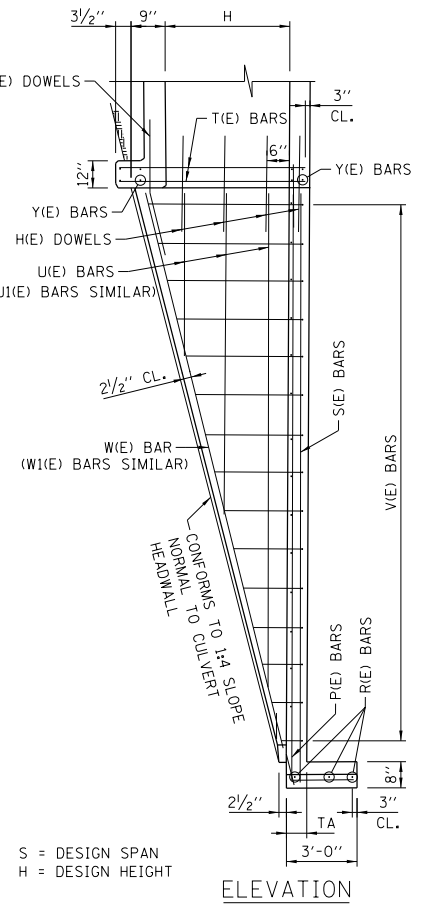


ELEVATION

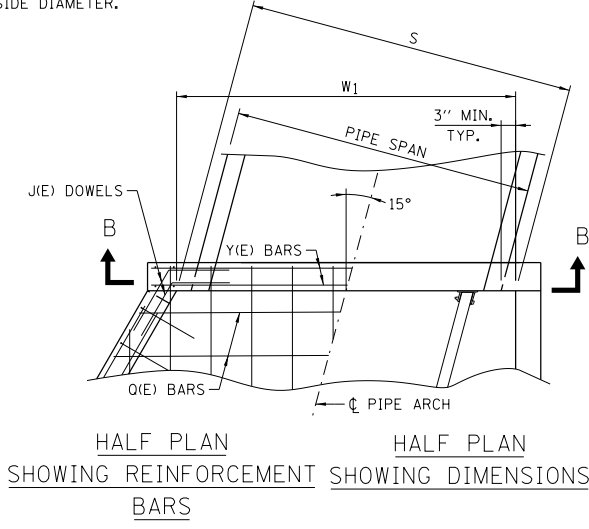


PIPE ARCH DETAILS

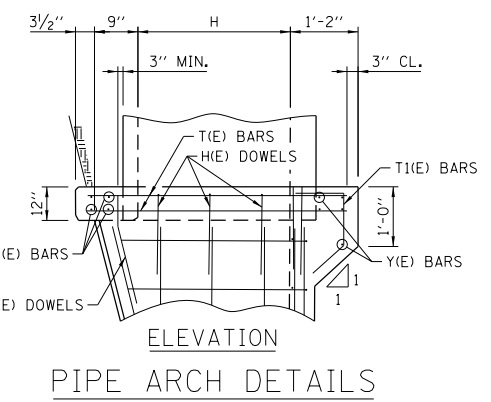


ELEVATION

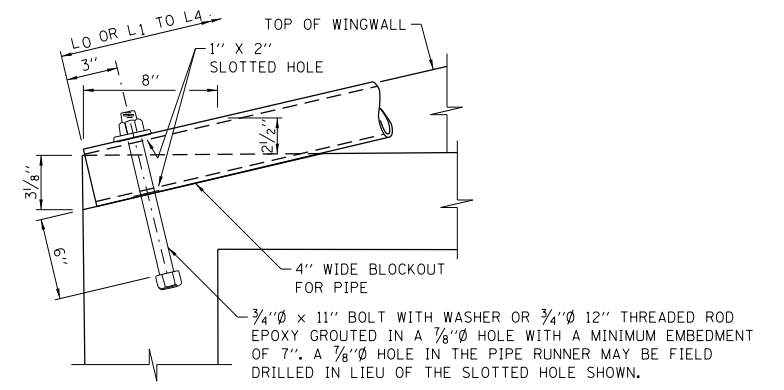


PIPE RUNNER DETAILS

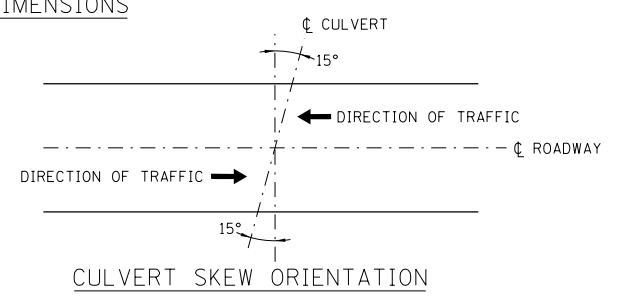

CULVERT SKEW ORIENTATION

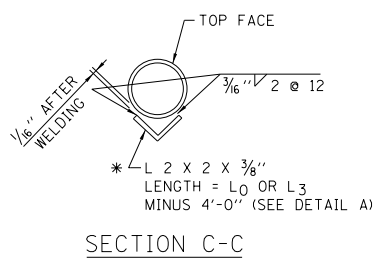

SECTION C-C

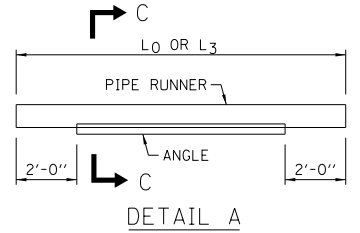

DETAIL A

NOTE:
WHERE L0 OR L3 EXCEEDS THE FOLLOWING LENGTH, THE PIPE RUNNER SHALL BE STRENGTHENED OVER THE MIDSPAN AS SHOWN.

PIPE	LENGTH
3" Ø, SCH. 40	12'-8"
3" Ø, SCH. 80	15'-4"

- GENERAL NOTES:**
- ALL CONCRETE SHALL BE CLASS S1.
 - ALL EXPOSED CONCRETE EDGES SHALL HAVE A 3/4" x 45° CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW FINISHED GROUND LEVEL. COVER FROM THE FACE OF CONCRETE TO THE FACE OF REINFORCEMENT BARS SHALL BE 2", UNLESS OTHERWISE SHOWN.
 - CONCRETE QUANTITIES SHOWN ON SHEET 2 (OF 2) IN THIS SERIES ARE FOR REINFORCED CONCRETE BOX CULVERT SECTIONS AND ADDITIONAL CONCRETE REQUIRED IN HEADWALLS FOR PIPE OR ARCH CULVERT SECTIONS SHALL BE ADDED TO THESE QUANTITIES.
 - THIS STANDARD MAY BE USED FOR CULVERTS WITH SKEW OF 15° ± 7.5°. AS SHOWN PER CULVERT SKEW ORIENTATION ON THIS SHEET.
 - DESIGN: SAFETY PIPE RUNNERS ARE DESIGNED FOR A TRANSVERSING LOAD OF 1,800 POUNDS AT YIELD AS RECOMMENDED BY RESEARCH REPORT 280-1, SAFETY TREATMENT OF ROADSIDE CROSS DRAINAGE STRUCTURES, TEXAS TRANSPORTATION INSTITUTE, MARCH 1981.
 - ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (v:h).
 - FOR EROSION PROTECTION SEE STANDARD B19.
 - ALL REINFORCEMENT BARS SHALL BE EPOXY COATED (E).




DATE	REVISIONS
3-01-2022	REVISED HEADWALL THICKNESS
3-11-2015	REVISED NOTES
02-07-12	TABLE QUANTITIES REVISED
03-01-10	MODIFIED CULVERT SKEW
03-01-10	DETAIL, REVISED EROSION PROTECTION AND NOTES

END TREATMENT WITH PIPE RUNNERS, FOR SINGLE CULVERTS 15° SKEW, 1:4 SLOPE, H ≤ 4'


STANDARD B15-05

APPROVED: *Paul Kovacs* DATE 6-1-2009
CHIEF ENGINEERING OFFICER

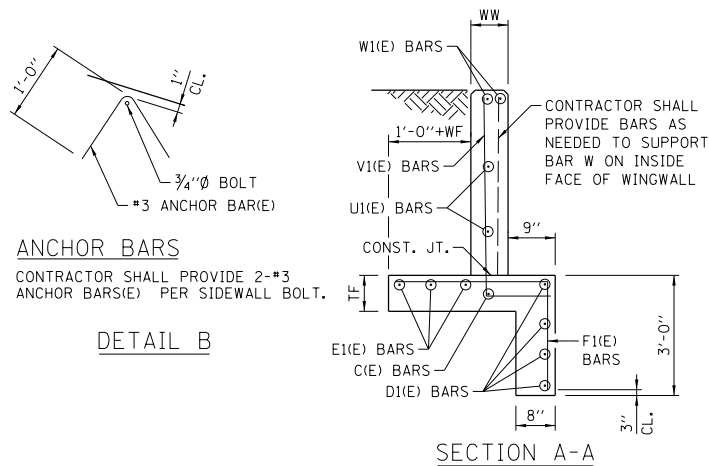


ANCHOR BARS
CONTRACTOR SHALL PROVIDE 2-#3 ANCHOR BARS(E) PER SIDEWALL BOLT.

DETAIL B

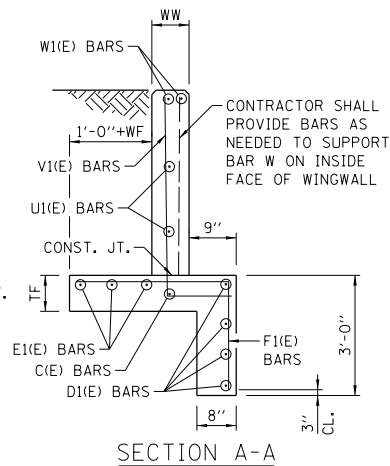


SECTION A-A

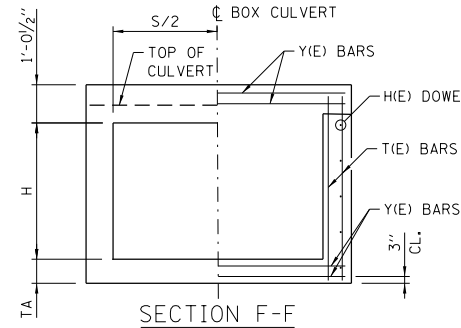


SECTION F-F

NOTE:
J & H DOWEL BARS NOT REQUIRED WITH EXISTING BOX CULVERTS PROVIDING THE REINFORCING FROM THE EXISTING BOX IS EXTENDED INTO THE NEW CONCRETE A MINIMUM OF 1'-3".

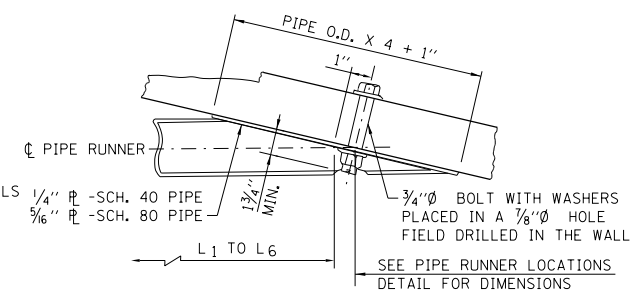


SECTION AT WING

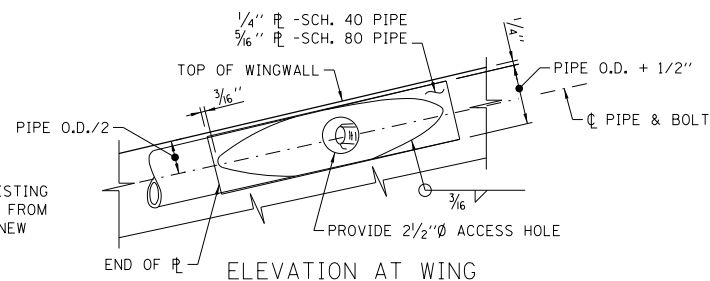


ELEVATION AT WING


NOTE:
PIPE O.D. IS THE PIPE RUNNER OUTSIDE DIAMETER.

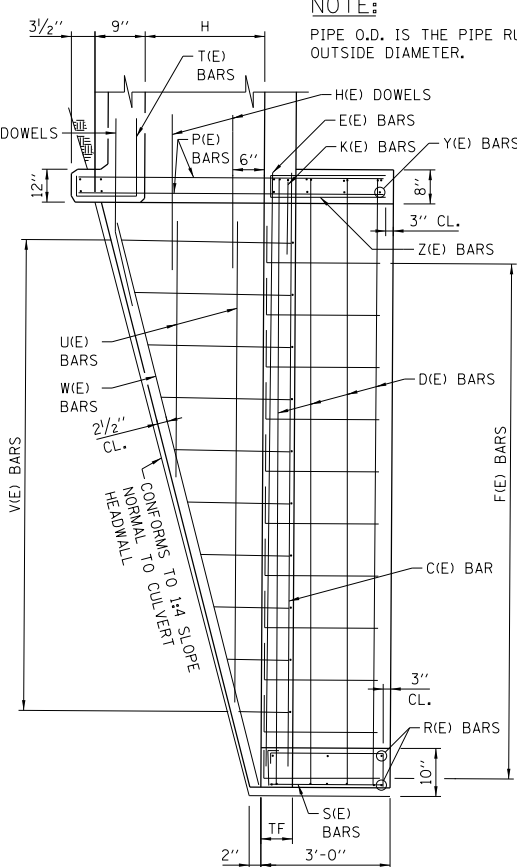


SECTION D-D

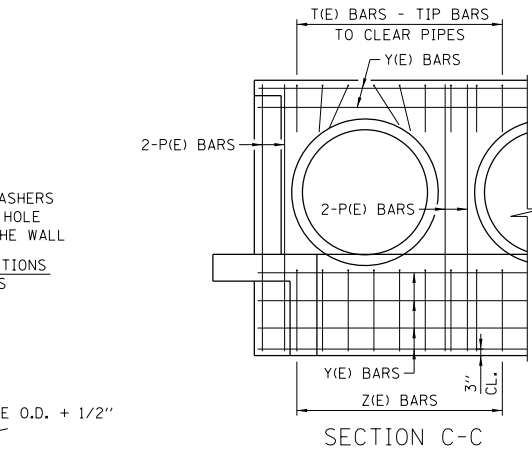


SECTION C-C

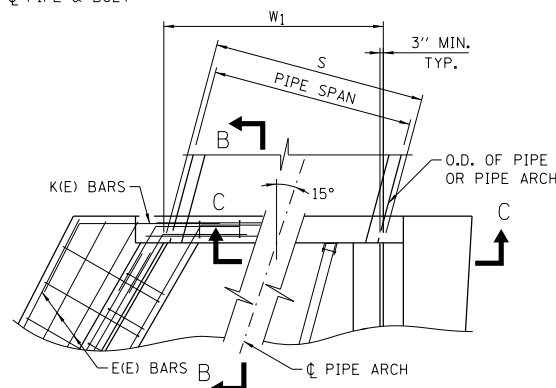

HALF PLAN SHOWING REINFORCEMENT BARS

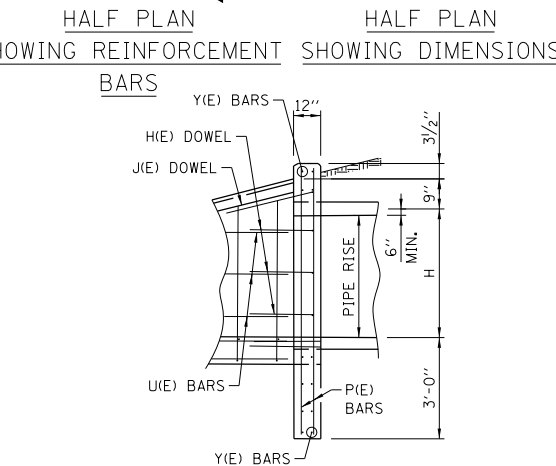

HALF PLAN SHOWING DIMENSIONS FOR PIPE AND PIPE-ARCH CULVERTS

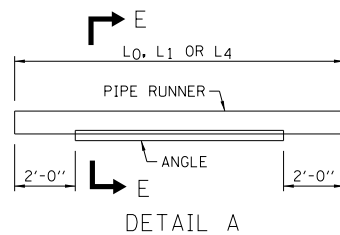


DETAIL A

*** NOTE:**
WHERE L0, L1 OR L4 EXCEEDS THE FOLLOWING LENGTH, THE PIPE RUNNER SHALL BE STRENGTHENED OVER THE MIDSPAN AS SHOWN.


PIPE	LENGTH
3"Ø, SCH. 40	12'-8"
3 1/2"Ø, SCH. 40	17'-3"
3 1/2"Ø, SCH. 80	22'-1"
4"Ø, SCH. 40	22'-6"
4"Ø, SCH. 80	29'-4"

PIPE RUNNER DETAILS

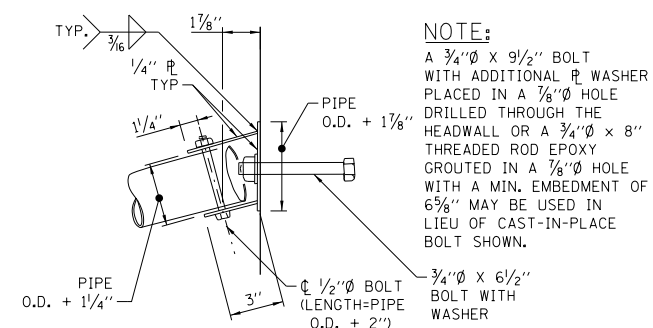


PLAN AT HEADWALL


NOTE:
A 3/4"Ø X 9/16" BOLT WITH ADDITIONAL P WASHER PLACED IN A 1/8"Ø HOLE DRILLED THROUGH THE HEADWALL OR A 3/4"Ø X 8" TREADED ROD EPOXY GROUTED IN A 1/8"Ø HOLE WITH A MIN. EMBEDMENT OF 6" MAY BE USED IN LIEU OF CAST-IN-PLACE BOLT SHOWN.

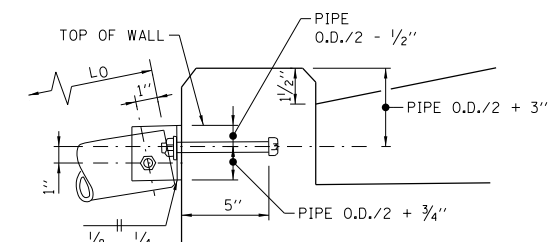


ELEVATION AT HEADWALL

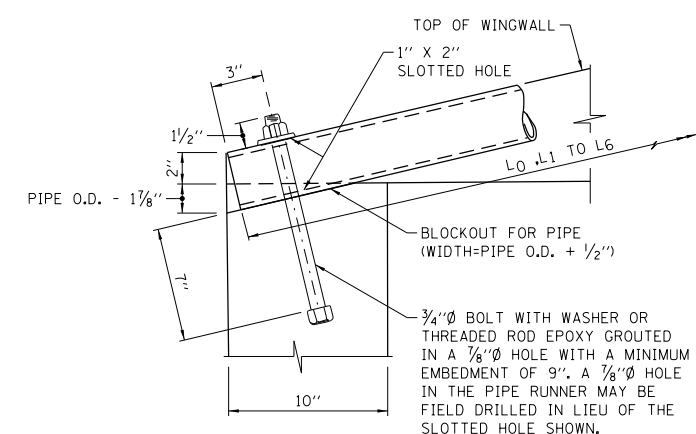

SECTION THRU TOEWALL

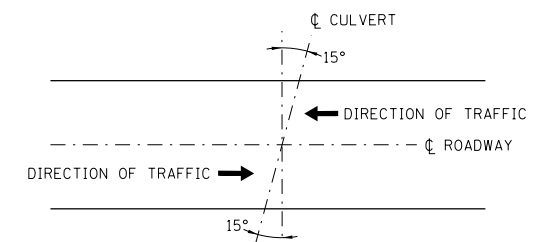

CULVERT SKEW ORIENTATION

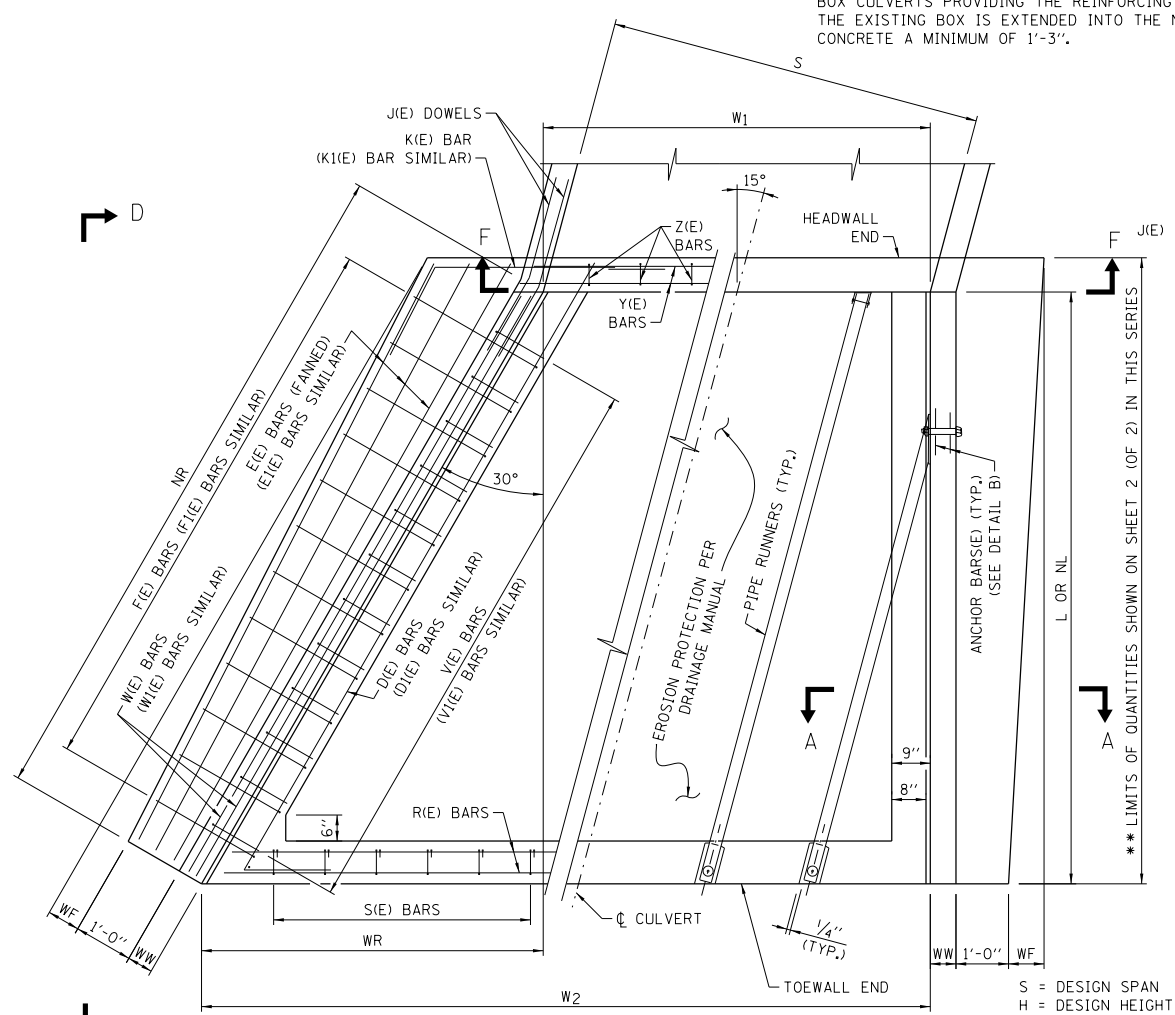

HALF PLAN SHOWING REINFORCEMENT BARS

HALF PLAN SHOWING DIMENSIONS


**** DOWEL BARS EXTENDING INTO THE CONCRETE BOX CULVERT ARE INCLUDED IN THE QUANTITIES.**

FOR BOX CULVERTS

GENERAL NOTES:

- ALL CONCRETE SHALL BE CLASS S1.
- ALL EXPOSED CONCRETE EDGES SHALL HAVE A 3/4" X 45° CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW FINISHED GROUND LEVEL. COVER FROM THE FACE OF CONCRETE TO THE FACE OF REINFORCEMENT BARS SHALL BE 2", UNLESS OTHERWISE SHOWN.
- CONCRETE QUANTITIES SHOWN ON SHEET 2 (OF 2) IN THIS SERIES ARE FOR REINFORCED CONCRETE BOX CULVERT SECTIONS AND ADDITIONAL CONCRETE REQUIRED IN HEADWALLS FOR PIPE OR ARCH CULVERT SECTIONS SHALL BE ADDED TO THESE QUANTITIES.
- THIS STANDARD MAY BE USED FOR CULVERTS WITH SKEW OF 15° ± 7.5°. AS SHOWN PER CULVERT SKEW ORIENTATION ON THIS SHEET.

- DESIGN: SAFETY PIPE RUNNERS ARE DESIGNED FOR A TRANSVERSING LOAD OF 1,800 POUNDS AT YIELD AS RECOMMENDED BY RESEARCH REPORT 280-1, SAFETY TREATMENT OF ROADSIDE CROSS DRAINAGE STRUCTURES, TEXAS TRANSPORTATION INSTITUTE, MARCH 1981.
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- FOR EROSION PROTECTION SEE STANDARD B19.
- ALL REINFORCEMENT BARS SHALL BE EPOXY COATED (E).

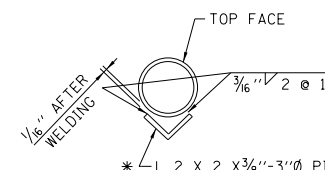


SECTION E-E

DATE	REVISIONS
03-01-22	REVISED HEADWALL THICKNESS AND REBAR TABLE
03-31-14	TABLE QUANTITIES REVISED
02-07-12	TABLE QUANTITIES REVISED


END TREATMENT WITH PIPE RUNNERS, FOR SINGLE AND MULTIPLE CULVERTS 15° SKEW, 1:4 SLOPE, H ≤ 8' STANDARD B16-06

APPROVED: *Paul Kovacs* DATE 6-1-2009
CHIEF ENGINEERING OFFICER







ANCHOR BARS(E)
CONTRACTOR SHALL PROVIDE 2-#3 ANCHOR BARS(E) PER SIDEWALL BOLT.

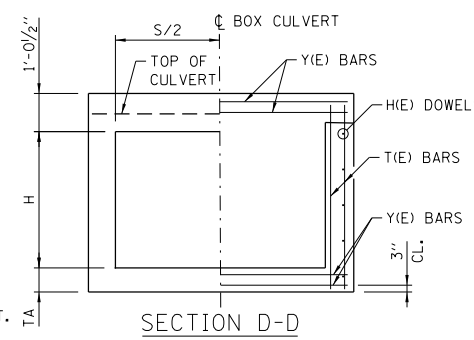


SECTION D-D

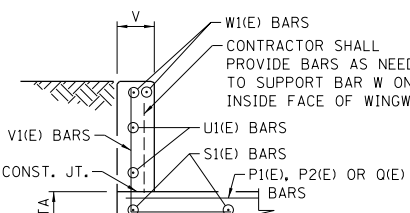


SECTION A-A

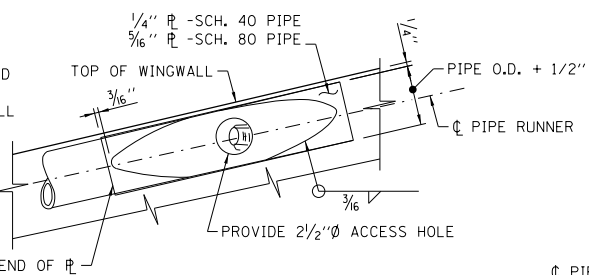

ELEVATION AT WING

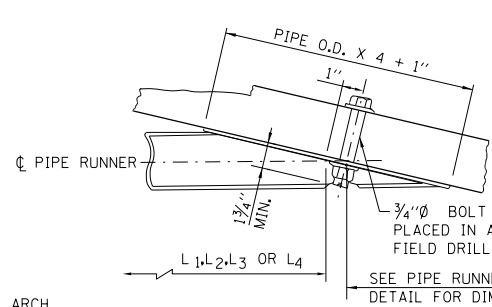

SECTION AT WING

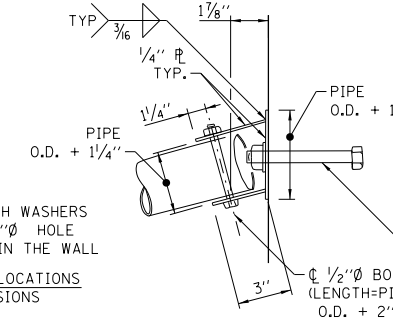


PLAN AT HEADWALL


NOTE:
Q(E), V(E), AND V1(E) BARS ARE TO BE FIELD CUT PER CUTTING DIAGRAM. PLACE BARS WITH DIMENSIONS C2-C3, C9-C12 BEGINNING AT HEADWALL AND BARS WITH DIMENSIONS C1-C4, C10-C11 BEGINNING AT THE TOEWALL END.

NOTE:
P1(E) BARS ARE TO BE FIELD CUT PER CUTTING DIAGRAM. PLACE BARS WITH DIMENSIONS C6-C7 BEGINNING AT THE TOEWALL END OF 45° WINGWALL AND BARS WITH DIMENSIONS C5-C8 BEGINNING PARALLEL TO THE P1(E) BARS. PLACE P2(E) BARS PARALLEL TO THE P1(E) BARS BEGINNING WITH THE SHORTEST BARS AT THE HEADWALL END OF THE 15° WINGWALL.


NOTE:
PIPE O.D. IS THE PIPE RUNNER OUTSIDE DIAMETER.
J(E) & H(E) DOWEL BARS NOT REQUIRED WITH EXISTING BOX CULVERTS PROVIDING THE REINFORCING FROM THE EXIST. BOX IS EXTENDED INTO THE NEW CONCRETE A MIN. OF 1'-3".

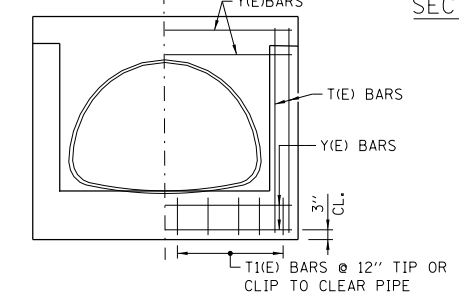

SECTION B-B

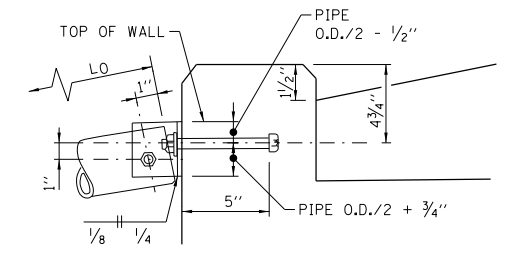


ELEVATION AT HEADWALL

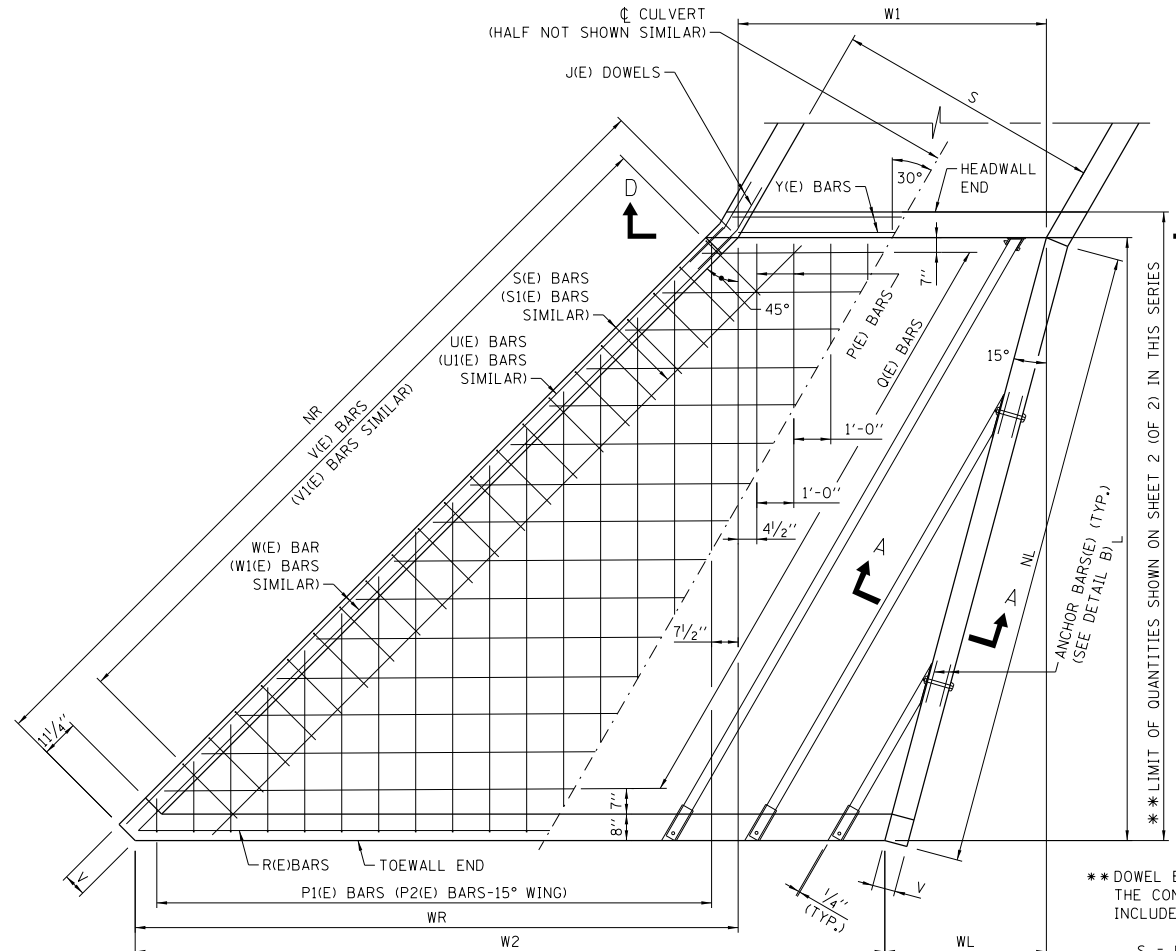


HALF PLAN SHOWING REINFORCEMENT BARS **HALF PLAN SHOWING DIMENSIONS**


BOX CULVERT DETAILS

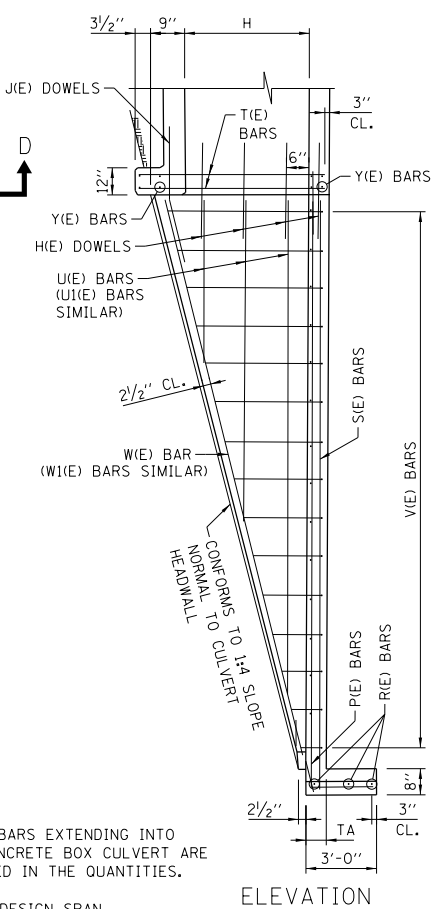


ELEVATION

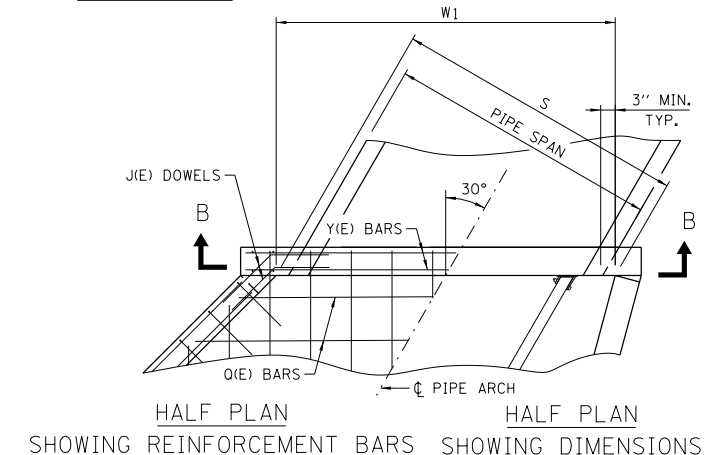


HALF PLAN SHOWING DIMENSIONS

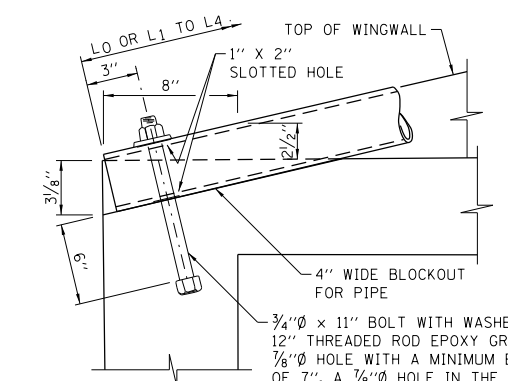


SECTION THRU TOEWALL

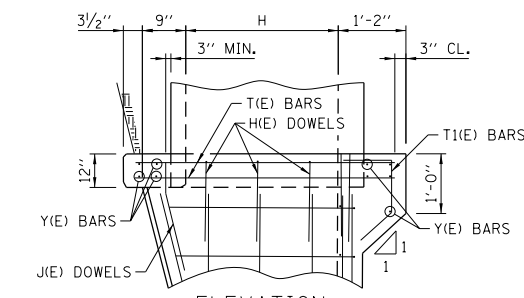


ELEVATION PIPE ARCH DETAILS

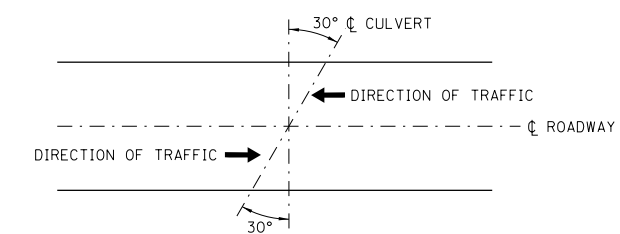

CULVERT SKEW ORIENTATION

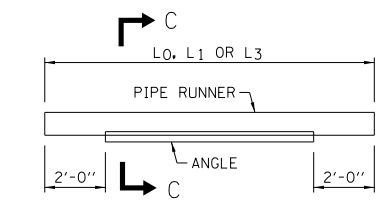

DETAIL A

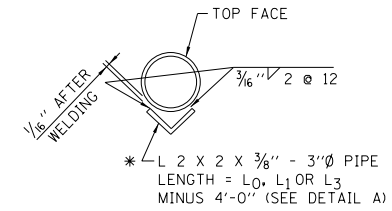

SECTION C-C

***NOTE:**
WHERE L0, L1 OR L3 EXCEEDS THE FOLLOWING LENGTH, THE PIPE RUNNER SHALL BE STRENGTHENED OVER THE MIDSPAN AS SHOWN.

PIPE	LENGTH
3"Ø, SCH. 40	12'-8"
3"Ø, SCH. 80	15'-4"

PIPE RUNNER DETAILS

- DESIGN: SAFETY PIPE RUNNERS ARE DESIGNED FOR A TRANSVERSING LOAD OF 1,800 POUNDS AT YIELD AS RECOMMENDED BY RESEARCH REPORT 280-1, SAFETY TREATMENT OF ROADSIDE CROSS DRAINAGE STRUCTURES, TEXAS TRANSPORTATION INSTITUTE, MARCH 1981.
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- FOR EROSION PROTECTION SEE STANDARD B19.
- ALL REINFORCEMENT BARS SHALL BE EPOXY COATED (E).

GENERAL NOTES:

- ALL CONCRETE SHALL BE CLASS SI.
- ALL EXPOSED CONCRETE EDGES SHALL HAVE A 3/4" x 45° CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW FINISHED GROUND LEVEL. COVER FROM THE FACE OF CONCRETE TO THE FACE OF REINFORCEMENT BARS SHALL BE 2", UNLESS OTHERWISE SHOWN.
- CONCRETE QUANTITIES SHOWN ON SHEET 2 (OF 2) IN THIS SERIES ARE FOR REINFORCED CONCRETE BOX CULVERT SECTIONS AND ADDITIONAL CONCRETE REQUIRED IN HEADWALLS FOR PIPE OR ARCH CULVERT SECTIONS SHALL BE ADDED TO THESE QUANTITIES.
- THIS STANDARD MAY BE USED FOR CULVERTS WITH SKEW OF 30° ± 7.5°, AS SHOWN PER CULVERT SKEW ORIENTATION ON THIS SHEET.






APPROVED: *Paul Kovacs* DATE 6-1-2009
CHIEF ENGINEERING OFFICER

DATE	REVISIONS
3-01-2022	REVISED HEADWALL THICKNESS AND REBAR TABLE
3-11-2015	REVISED NOTES
2-07-2012	TABLE QUANTITIES REVISED

SHEET 1 OF 2

END TREATMENT WITH PIPE RUNNERS, FOR SINGLE CULVERTS 30° SKEW, 1:4 SLOPE, H ≤ 4'


STANDARD B17-05

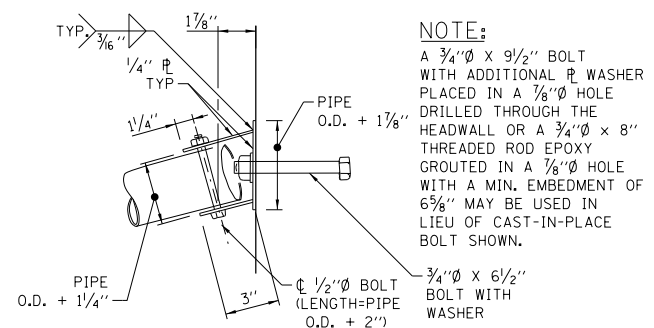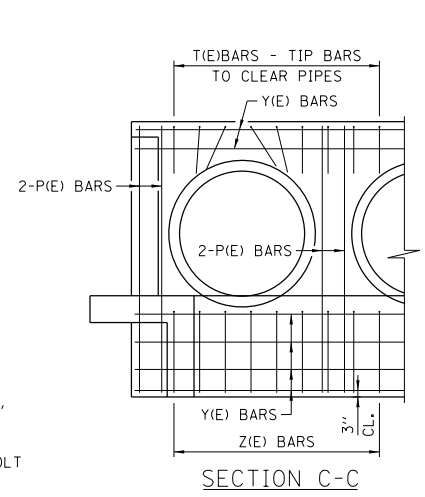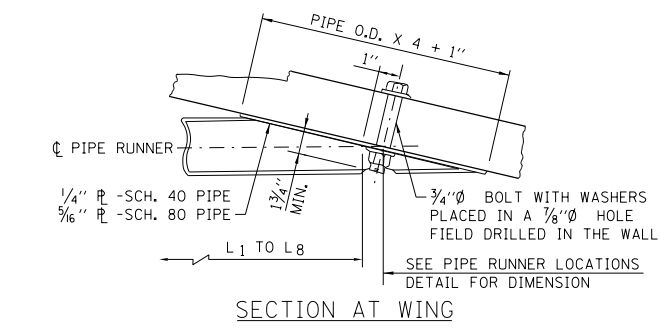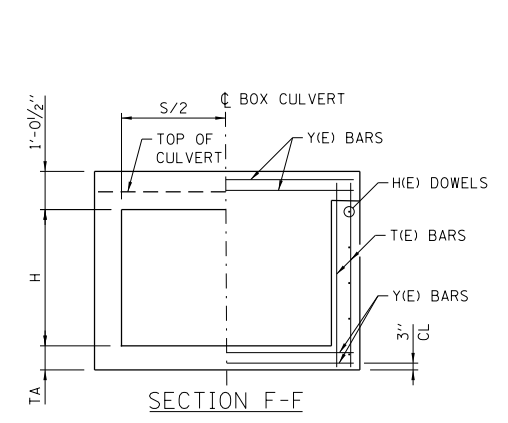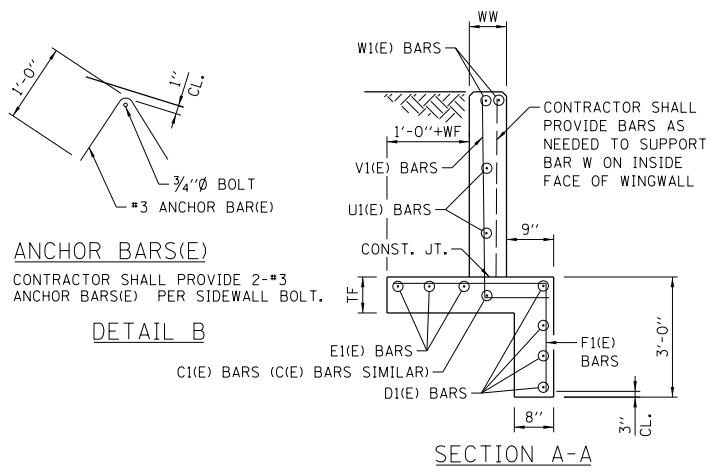



NOTE:
A 3/4"Ø x 9/2" BOLT WITH ADDITIONAL P WASHER PLACED IN A 1/8"Ø HOLE DRILLED THROUGH THE HEADWALL OR A 3/4"Ø x 8" THREADED ROD EPOXY GROUTED IN A 1/8"Ø HOLE WITH A MIN. EMBEDMENT OF 6 3/8" MAY BE USED IN LIEU OF CAST-IN-PLACE BOLT SHOWN.

NOTE:
F(E), F1(E), V(E) & V1(E) BARS ARE TO BE FIELD CUT PER CUTTING DIAGRAM. PLACE BARS WITH DIMENSIONS C₂-C₄, C₁₅-C₁₈ BEGINNING AT HEADWALL AND BARS WITH DIMENSIONS C₁-C₃, C₁₆-C₁₇ BEGINNING AT THE TOEWALL END.

NOTE:
J(E) & H(E) DOWEL BAR NOT REQUIRED WITH EXISTING BOX CULVERTS PROVIDING THE REINFORCING FROM THE EXISTING BOX IS EXTENDED INTO THE NEW CONCRETE A MINIMUM OF 1'-3".


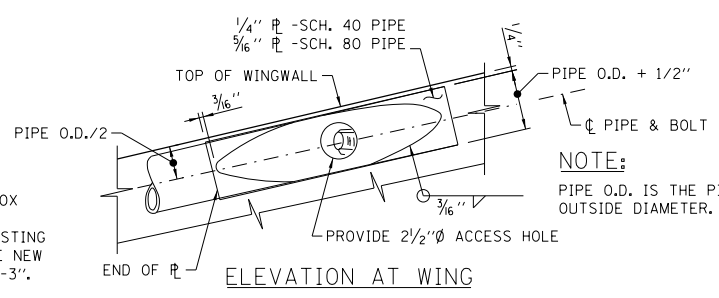


NOTE:
PIPE O.D. IS THE PIPE RUNNER OUTSIDE DIAMETER.


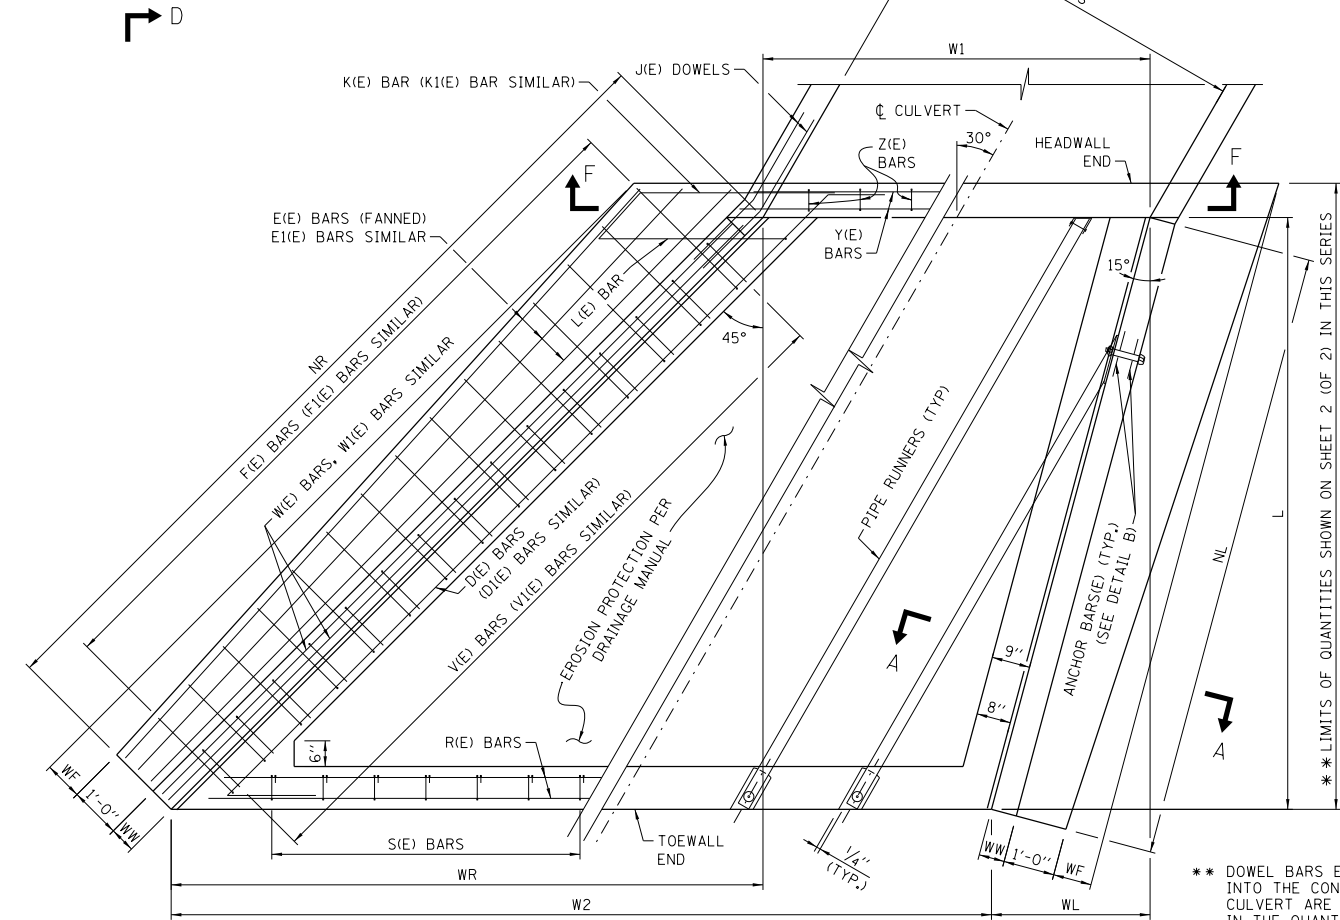
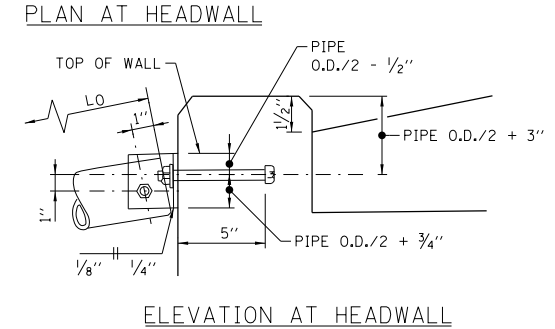


** DOWEL BARS EXTENDING INTO THE CONCRETE BOX CULVERT ARE INCLUDED IN THE QUANTITIES.

S = DESIGN SPAN
H = DESIGN HEIGHT

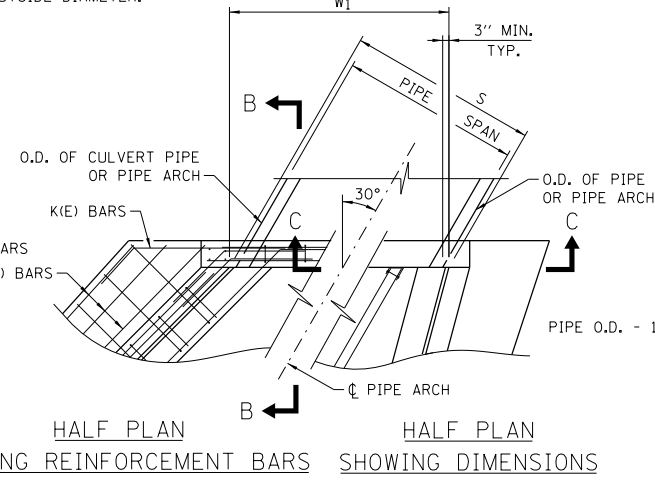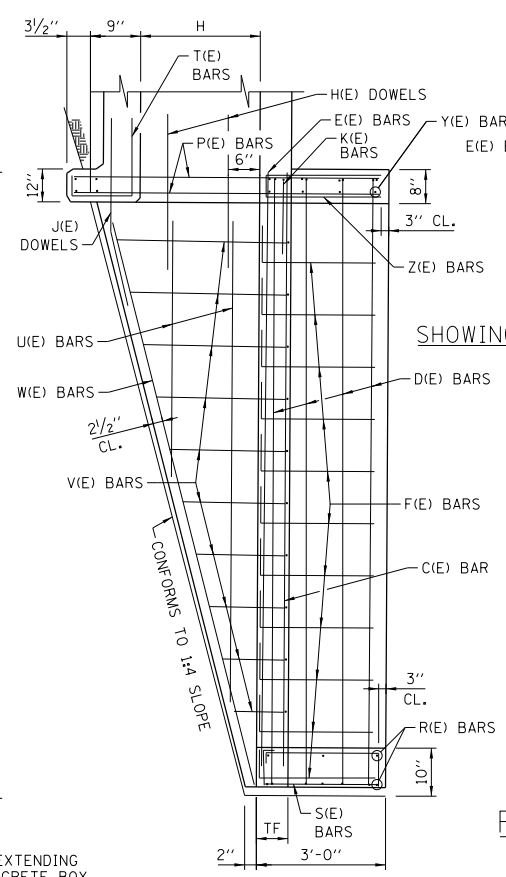

FOR PIPE AND PIPE-ARCH CULVERTS

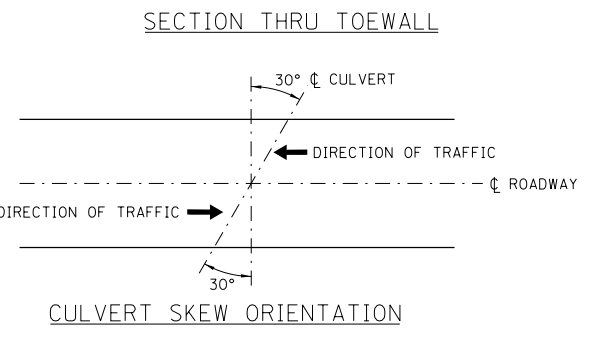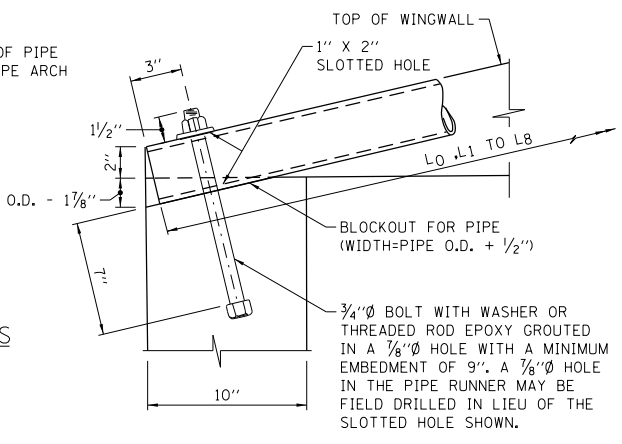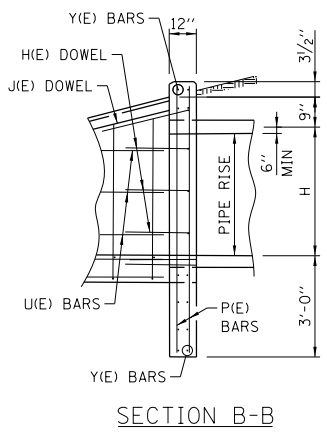



NOTE:
WHERE L₀, L₁, L₄ OR L₅ EXCEEDS THE FOLLOWING LENGTH, THE PIPE RUNNER SHALL BE STRENGTHENED OVER THE MIDSPAN AS SHOWN.

PIPE	LENGTH
3"Ø, SCH. 40	12'-8"
3"Ø, SCH. 80	15'-4"
3 1/2"Ø, SCH. 80	22'-1"
4"Ø, SCH. 80	29'-4"

GENERAL NOTES:

- ALL CONCRETE SHALL BE CLASS SI.
- ALL EXPOSED CONCRETE EDGES SHALL HAVE A 3/4" x 45° CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW FINISHED GROUND LEVEL. COVER FROM THE FACE OF CONCRETE TO THE FACE OF REINFORCEMENT BARS SHALL BE 2", UNLESS OTHERWISE SHOWN.
- CONCRETE QUANTITIES SHOWN ON SHEET 2 (OF 2) IN THIS SERIES ARE FOR REINFORCED CONCRETE BOX CULVERT SECTIONS AND ADDITIONAL CONCRETE REQUIRED IN HEADWALLS FOR PIPE OR ARCH CULVERT SECTIONS SHALL BE ADDED TO THESE QUANTITIES.
- THIS STANDARD MAY BE USED FOR CULVERTS WITH SKEW OF 30° ± 7.5%, AS SHOWN PER CULVERT SKEW ORIENTATION ON THIS SHEET.
- DESIGN: SAFETY PIPE RUNNERS ARE DESIGNED FOR A TRANSVERSING LOAD OF 1,800 POUNDS AT YIELD AS RECOMMENDED BY RESEARCH REPORT 280-1, SAFETY TREATMENT OF ROADSIDE CROSS DRAINAGE STRUCTURES, TEXAS TRANSPORTATION INSTITUTE, MARCH 1981.
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- FOR EROSION PROTECTION SEE STANDARD B19.
- ALL REINFORCEMENT BARS SHALL BE EPOXY COATED (E).

FOR BOX CULVERTS

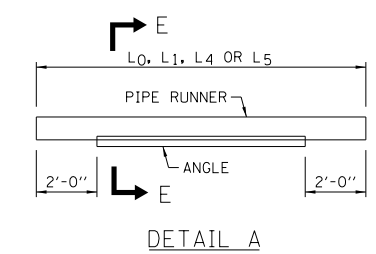


PIPE RUNNER DETAILS

DATE	REVISIONS
3-01-2022	REVISED HEADWALL THICKNESS AND REBAR TABLES
3-11-2015	REVISED NOTES
3-31-2014	TABLE QUANTITIES REVISED
2-07-2012	TABLE QUANTITIES REVISED


END TREATMENT WITH PIPE RUNNERS, FOR SINGLE AND MULTIPLE CULVERTS 30° SKEW, 1:4 SLOPE, H≤8' AND S=VARIES
STANDARD B18-06

APPROVED: *Paul Kovacs* CHIEF ENGINEERING OFFICER DATE 6-1-2009




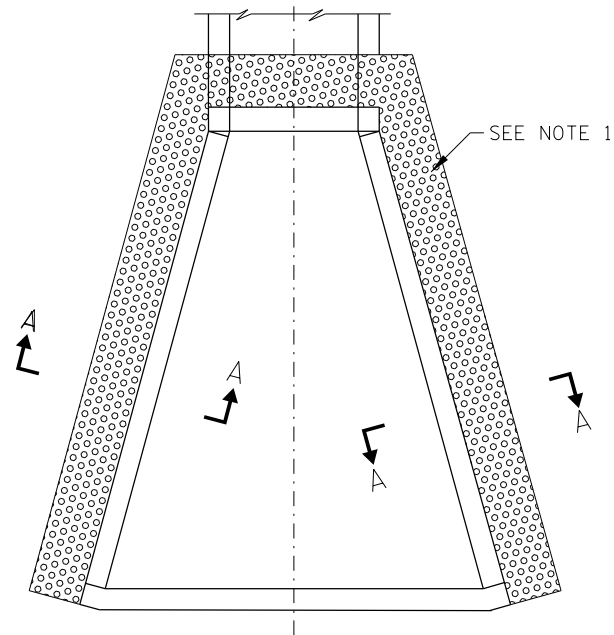


PLAN-0° SKEW, H ≤ 4'

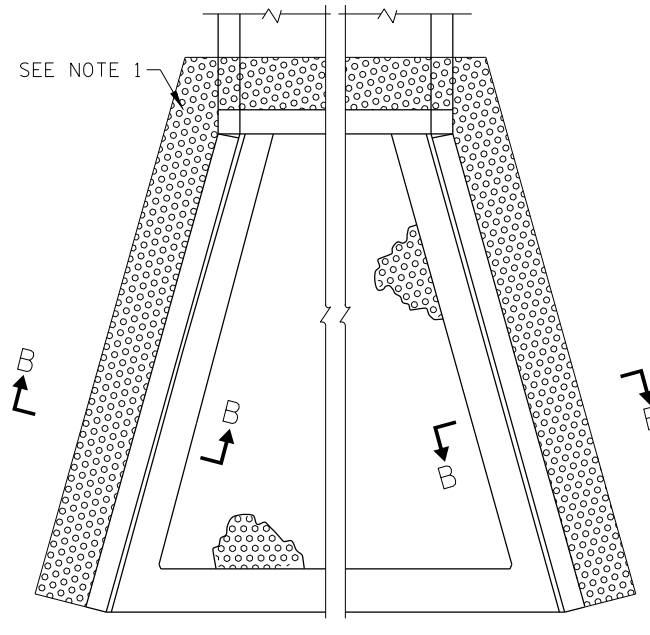


PLAN-0° SKEW, H ≤ 8'

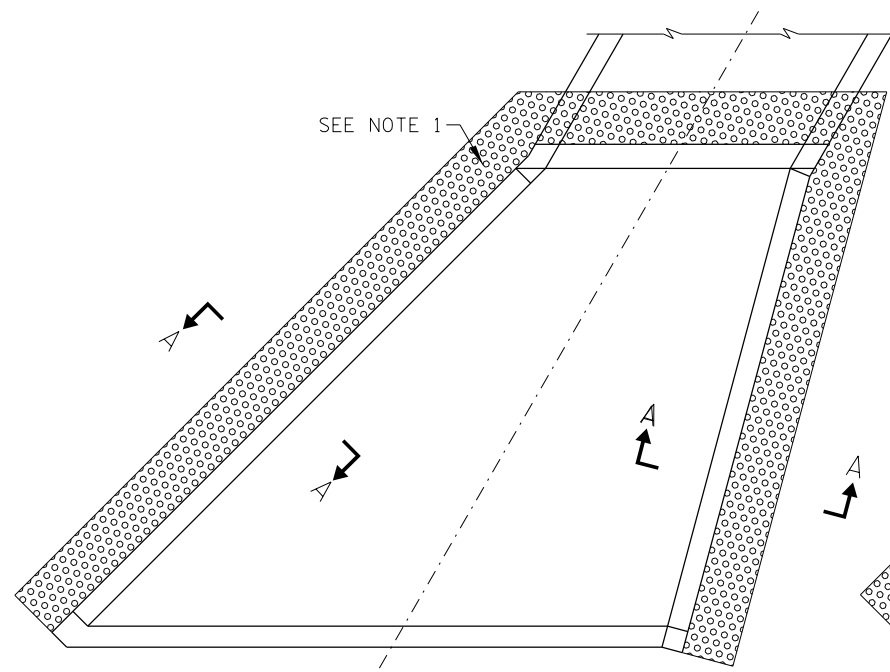


PLAN-SKEW, H ≤ 4'

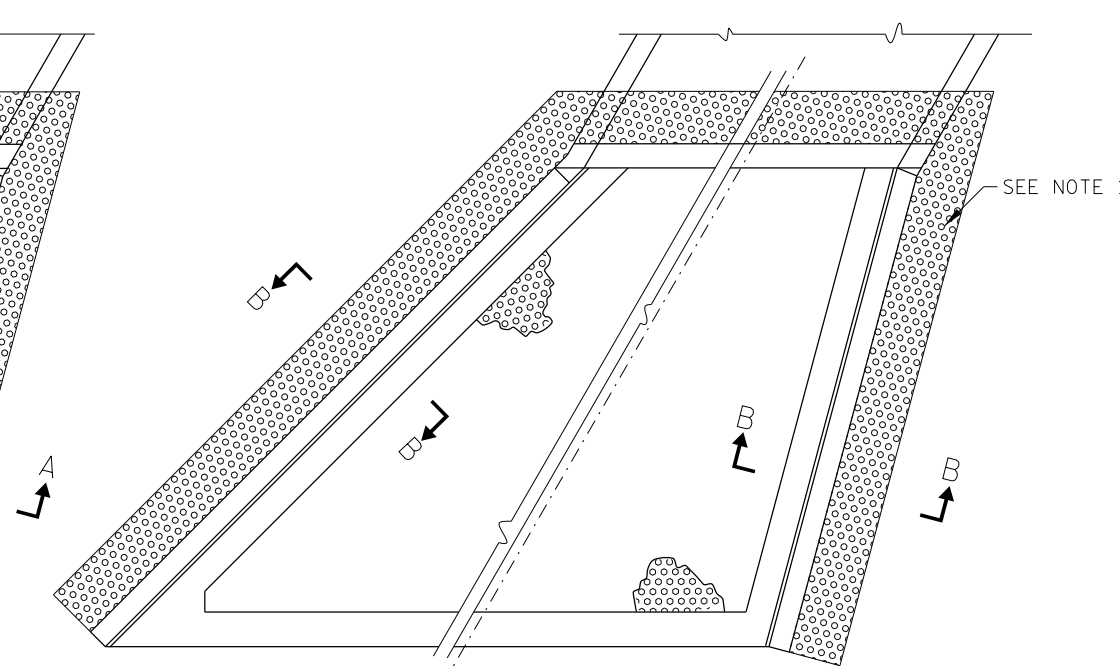


PLAN-SKEW, H ≤ 8'

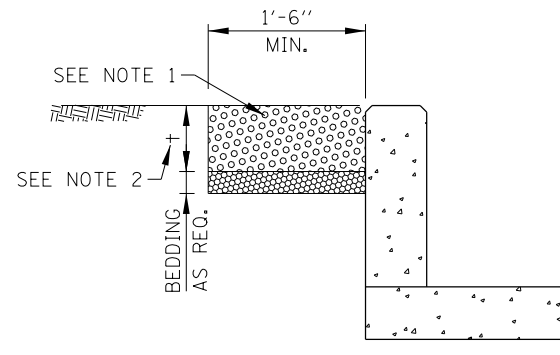

SECTION A-A

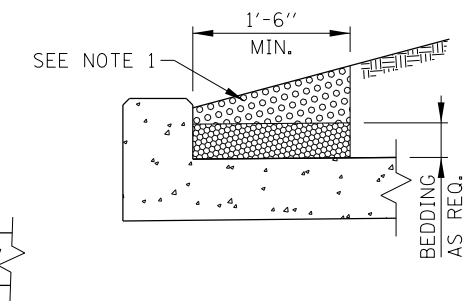


SECTION AT HEADWALL

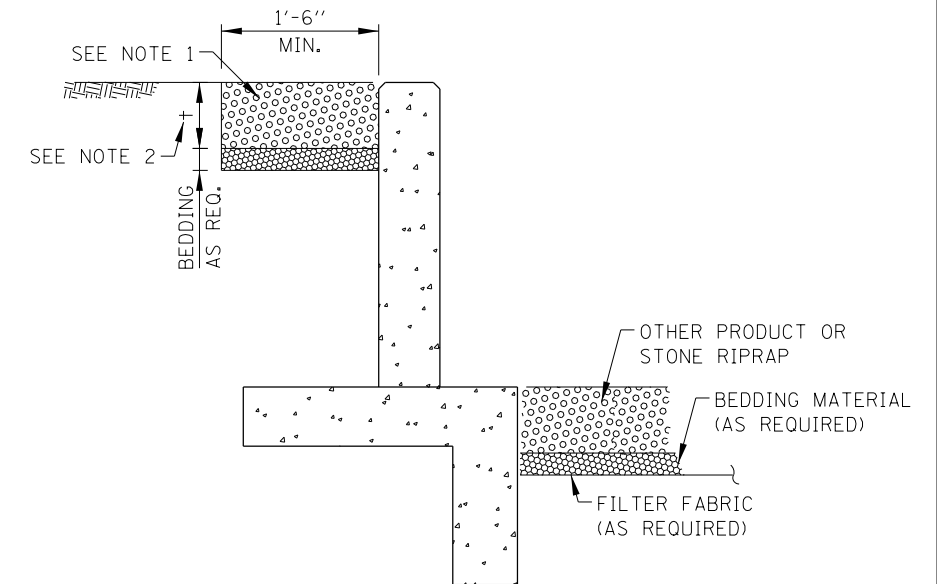

SECTION B-B

NOTES:

1. THE PREFERRED METHOD FOR ACHIEVING EROSION PROTECTION AT END SECTIONS SHOULD BE THROUGH THE USE OF PRODUCTS THAT PROMOTE REVEGETATION WITHIN THE AREA OF CONCERN.
2. THICKNESS "+" WILL BE DETERMINED BY THE MANUFACTURER'S RECOMMENDATION FOR THE PRODUCT USED.
3. EROSION PROTECTION PLACEMENT SHALL BE INSTALLED FLUSH WITH ADJACENT GRADE.
4. FOR USE WITH STANDARDS B10 TO B18.
5. STONE RIPRAP SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS AND DRAINAGE DESIGN MANUAL.



 APPROVED CHIEF ENGINEER DATE 3-1-2010

DATE	REVISIONS
3-11-2015	REVISED NOTES
3-01-2010	REVISED EROSION PROTECTION AND NOTES




EROSION PROTECTION

STANDARD B19-02

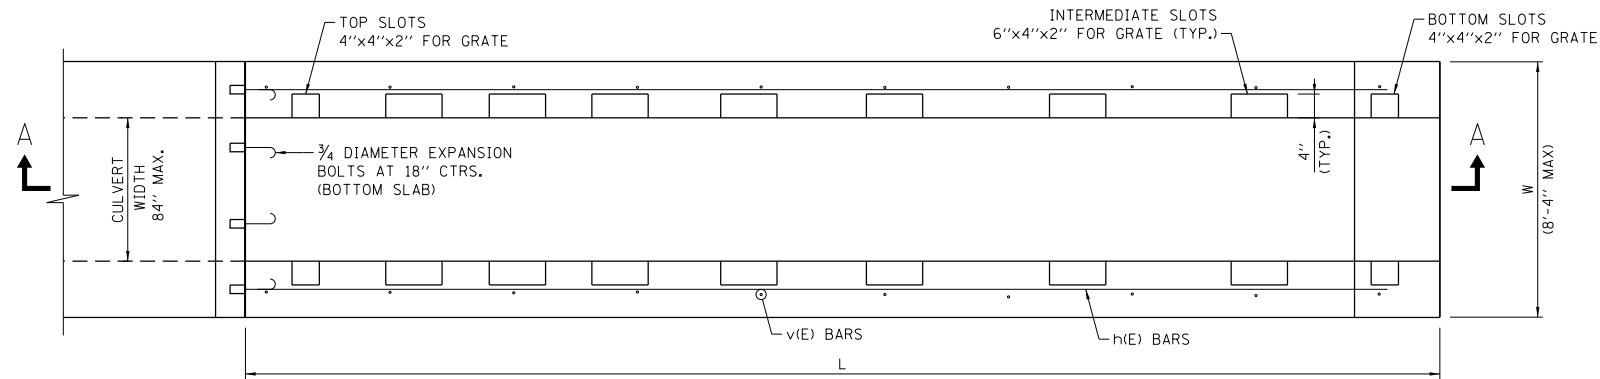

DIMENSIONS AND QUANTITIES IN TWO WINGWALLS 1:4 SLOPE

CULVERT HEIGHT	DIMENSIONS								NO. OF SPACES			CONCRETE CLASS SI C.Y. *	REINF. BARS (POUND) *
	H	L	S	T	U	A	E	B	C	D			
36"	3'-8"	14'-0"	14'-5 1/8"	2"	2'-8"	2'-2"	2'-2"	-	4	-	-	1.33	188
42"	4'-3"	16'-4"	16'-10"	2"	3'-2"	2'-8"	2'-2"	4	-	-	-	1.78	259
48"	4'-9"	18'-4"	18'-10 3/4"	2"	3'-2"	2'-2"	2'-2"	-	6	-	-	2.23	304
54"	5'-3"	20'-4"	20'-11 1/2"	2"	3'-6"	2'-2"	2'-2"	4	2	-	-	2.72	379
60"	5'-10"	22'-8"	23'-4 3/8"	2"	3'-6"	2'-2"	2'-2"	-	8	-	-	3.36	468

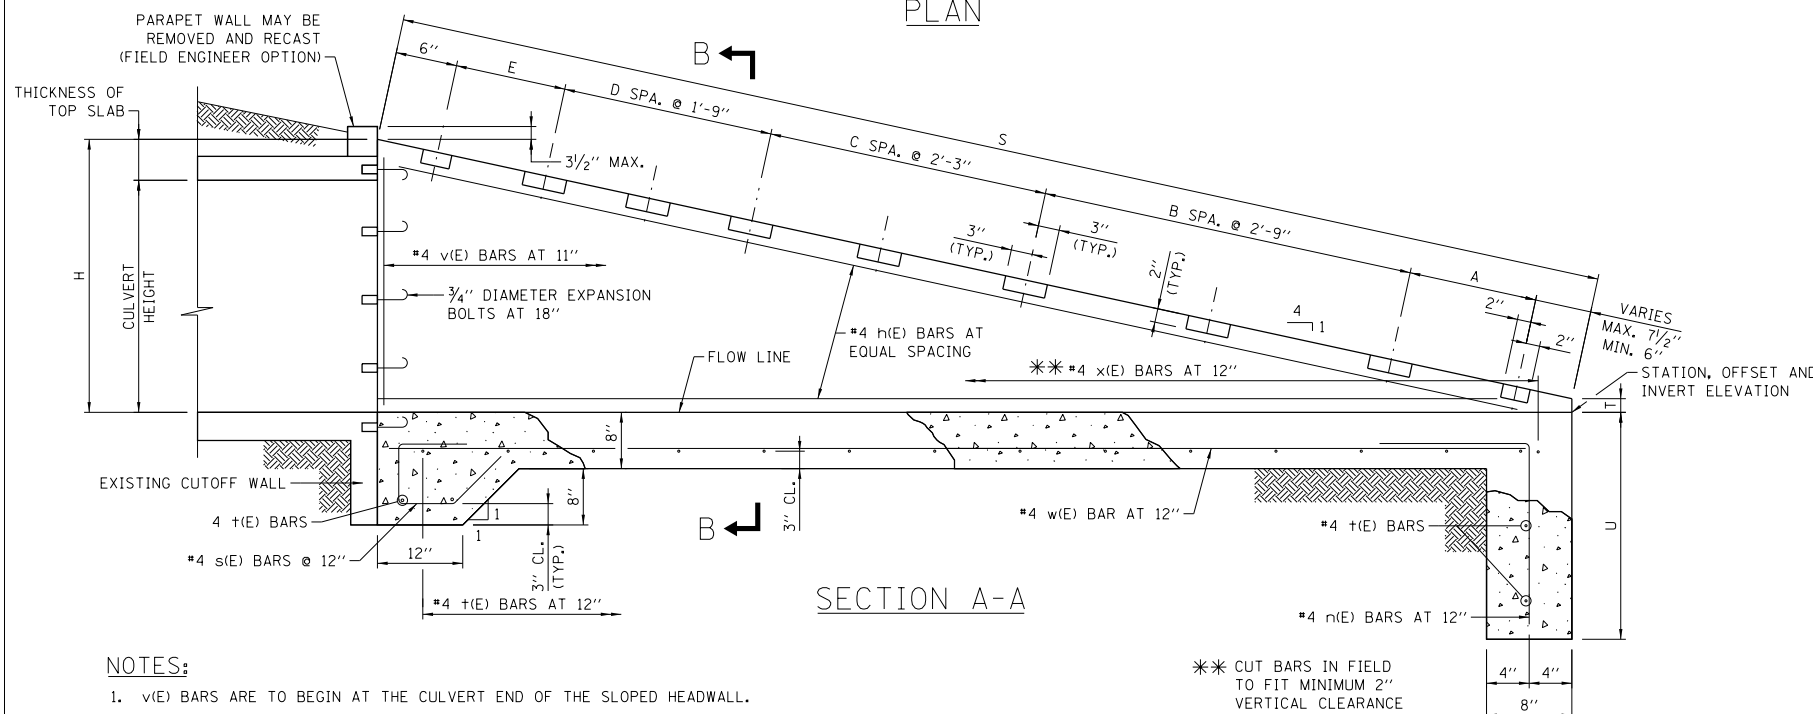

NOTES:

- v(E) BARS ARE TO BEGIN AT THE CULVERT END OF THE SLOPED HEADWALL.
- 3/4" DIAMETER EXPANSION BOLTS SHALL CONSIST OF SELF DRILLING EXPANSION SHIELDS AND 3/4" DIAMETER HOOKED BOLTS. HOOKED BOLTS SHALL EXTEND A MINIMUM OF 9" INTO NEW CONCRETE WITH ANCHORAGE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS. MINIMUM CERTIFIED PROOF LOAD = 4,080 LBS.

** CUT BARS IN FIELD TO FIT MINIMUM 2" VERTICAL CLEARANCE

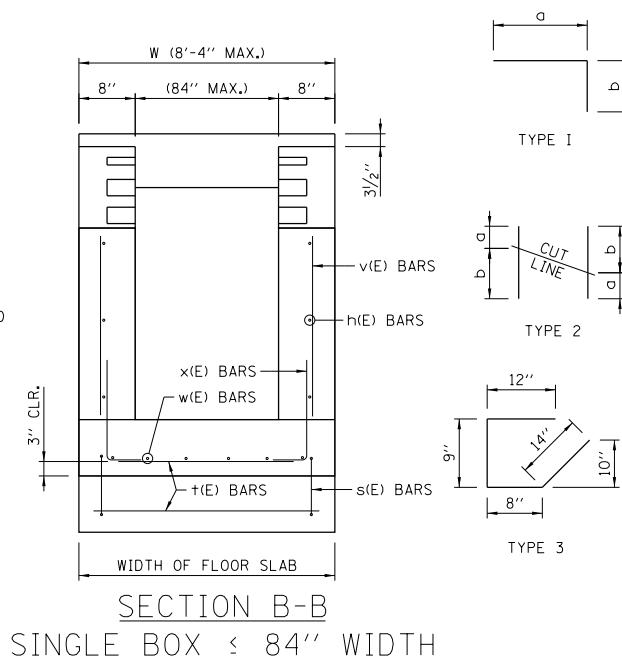


TABLE OF BARS IN ONE WINGWALL 1:4 SLOPE


NO. 4 REINFORCEMENT BARS						
CULVERT HEIGHT	MARK(E)	TYPE	NO. REQ'D	LENGTH	a	b
36"	h 36	STR.	4	13'-8"	2'-0"	3'-6"
	3/4" EXP BLT	---	3	---		
	v 36	2	7	5'-6"		
42"	h 42	STR.	5	16'-0"	1'-11"	4'-1"
	3/4" EXP BLT	---	4	---		
	v 42	2	10	6'-0"		
48"	h 48	STR.	5	18'-0"	1'-10"	4'-7"
	3/4" EXP BLT	---	4	---		
	v 48	2	13	6'-5"		
54"	h 54	STR.	6	20'-0"	1'-10"	5'-1"
	3/4" EXP BLT	---	4	---		
	v 54	2	15	6'-11"		
60"	h 60	STR.	7	22'-4"	2'-2"	1'-0"
	3/4" EXP BLT	---	5	---		
	v 60	2	17	7'-7"		
	x 60	1	23	3'-2"		

TABLE OF BARS IN SLAB 1:4 SLOPE (PER FT. OF FLOOR SLAB WIDTH)

NO. 4 REINFORCEMENT BARS								
CULVERT HEIGHT	MARK(E)	TYPE	NO. REQ'D	LENGTH	a	b	REINF. BAR LB. *	CONCRETE CLASS SI (C.Y.) *
36"	n 36	1	1	4'-1"	2'-1"	2'-0"	27	.45
	w 36	STR.	1	13'-5"				
	t 36	STR.	18	W-(0'-4")				
	3/4" EXP BLT	---	0.67	---				
	s 36	3	1	3'-7"				
42"	n 42	1	1	4'-7"	2'-7"	2'-0"	32	.53
	w 42	STR.	1	15'-9"				
	t 42	STR.	20	W-(0'-4")				
	3/4" EXP BLT	---	0.67	---				
	s 42	3	1	3'-7"				
48"	n 48	1	1	4'-7"	2'-7"	2'-0"	33	.58
	w 48	STR.	1	17'-9"				
	t 48	STR.	22	W-(0'-4")				
	3/4" EXP BLT	---	0.67	---				
	s 48	3	1	3'-7"				
54"	n 54	1	1	4'-11"	2'-11"	2'-0"	37	.64
	w 54	STR.	1	19'-9"				
	t 54	STR.	24	W-(0'-4")				
	3/4" EXP BLT	---	0.67	---				
	s 54	3	1	3'-7"				
60"	n 60	1	1	4'-11"	2'-11"	2'-0"	39	.70
	w 60	STR.	1	22'-1"				
	t 60	STR.	26	W-(0'-4")				
	3/4" EXP BLT	---	0.67	---				
	s 60	3	1	3'-7"				

GENERAL NOTES:

- ALL EXPOSED CONCRETE EDGES SHALL HAVE A 3/4" X 45° CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW FINISHED GROUND LEVEL.
- COVER FROM THE FACE OF CONCRETE TO FACE OF REINFORCEMENT BARS SHALL BE 2" UNLESS OTHERWISE SHOWN.
- CONCRETE QUANTITIES SHOWN ARE FOR REINFORCED CONCRETE BOX CULVERT HEADWALLS.
- PAY ITEMS ARE IDENTIFIED BY AN ASTERISK (*).
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- ALL REINFORCEMENT BARS SHALL BE EPOXY COATED (E).

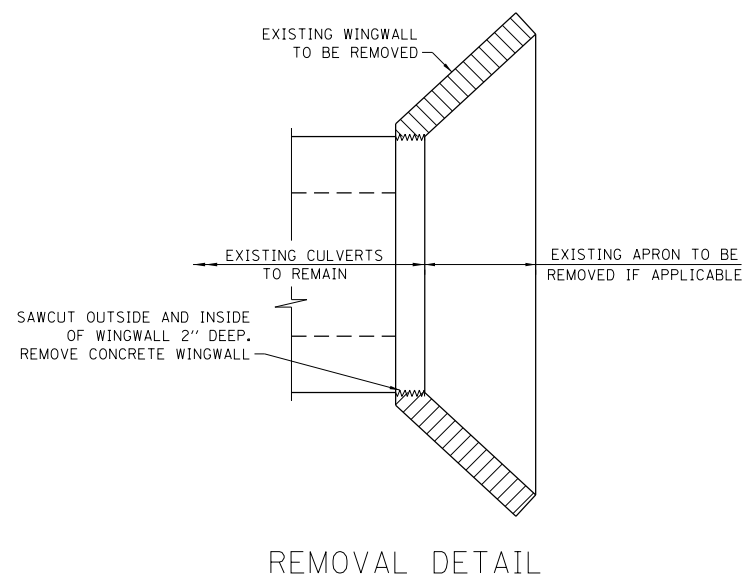

NOTES:

- TYPE 2 "v(E)" BARS SHALL BE ORDERED FULL LENGTH AND CUT IN THE FIELD. THE REMAINING PORTION OF THE "v(E)" BARS SHALL BE USED IN THE OTHER WALL.
- THE LONG LEG OF THE "n(E)" BAR SHALL BE VERTICAL.
- SEE STANDARD B23 FOR GRATING DETAILS.


DATE	REVISIONS
3-01-2022	REVISED HEADWALL TO WINGWALL IN REMOVAL DETAIL AND REVISED REBAR TABLE
3-31-2016	STATION, OFFSET & INVERT ELEVATION MOVED




HEADWALL TYPE IV CONCRETE BOX CULVERT ≤ 84" WIDTH

STANDARD B20-06


APPROVED: *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEERING OFFICER

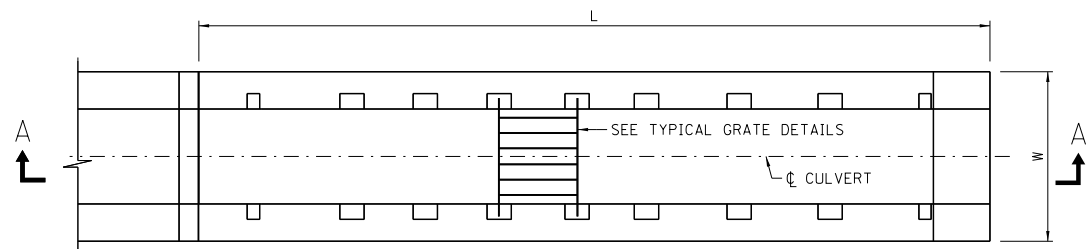

PLAN VIEW (NO SKEW)
SINGLE BOX CULVERT ≤ 84" WIDE

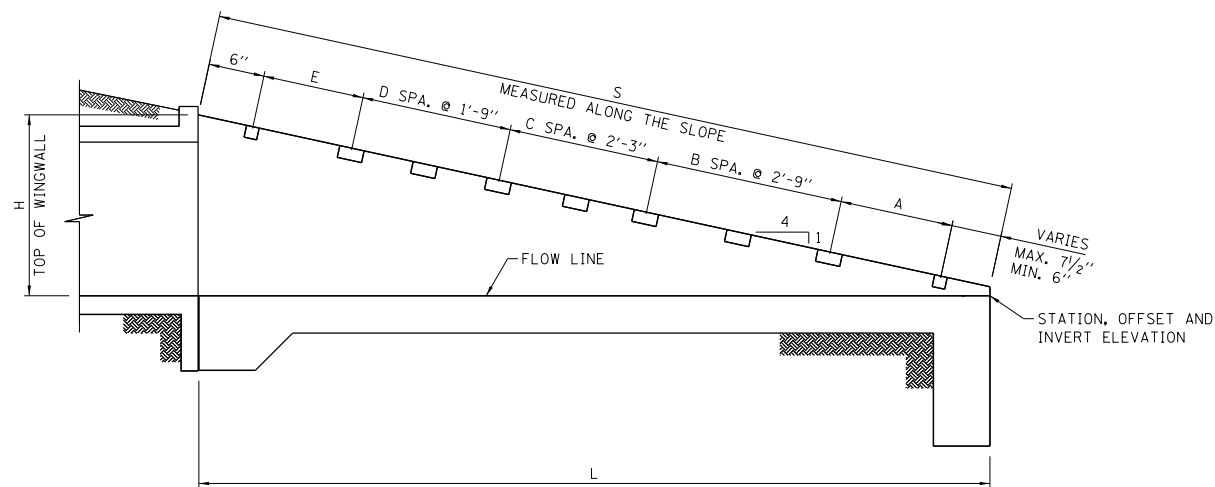


SECTION A-A
END TREATMENT - MULTIPLE OR SINGLE CELL
BOX CULVERT

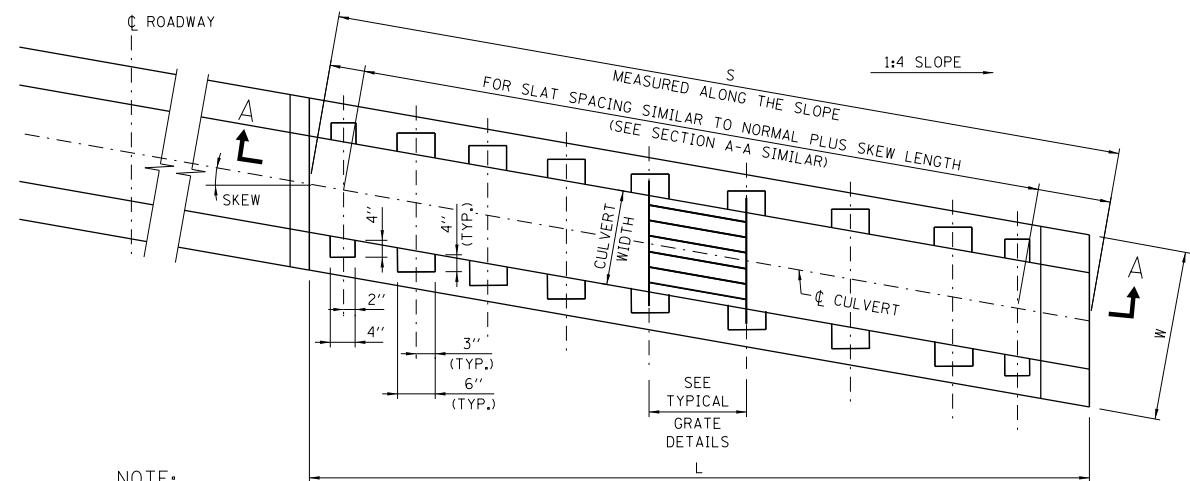


NOTE:

REINFORCEMENT BARS AND GRATE SPACING ARE SIMILAR TO BOX CULVERT AT NORMAL (NO SKEW).


PLAN VIEW (WITH SKEW)
SINGLE BOX CULVERT ≤ 84" WIDE

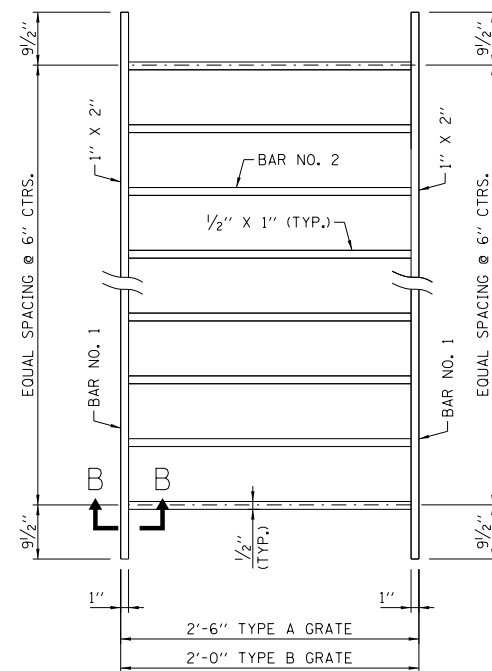

TYPICAL GRATE
(NO SKEW)

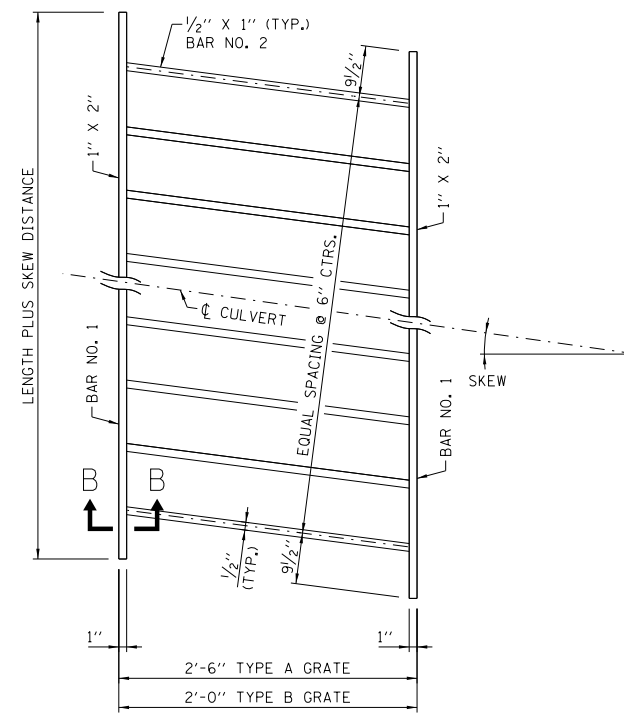

GRATE
(WITH SKEW)

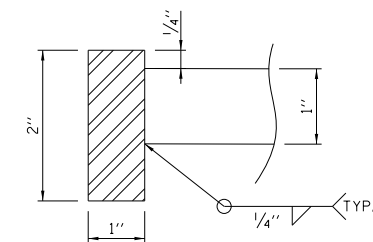

SECTION B-B

GRATING DIMENSIONS AND QUANTITIES
IN ONE HEADWALL TYPE IV
BASED ON A 1 FOOT WIDTH, 1:4 SLOPE, AND NO SKEW

CULVERT HEIGHT	GRATES		BARS FOR ONE GRATE				GRATING * (LBS.) EACH GRATE
	NUMBER REQ'D.	TYPE REQ'D.	BAR NO. 1		BAR NO. 2		
			BARS REQ'D.	LENGTH	BARS REQ'D.	LENGTH	
36"	6	B	2	W-0.75	$\frac{W-1.33}{0.5} - 1$	1'-10"	19.9W - 21.6
42"	5	A	2	W-0.75	$\frac{W-1.33}{0.5} - 1$	2'-4"	21.5W - 24.7
	1	B	2	W-0.75	$\frac{W-1.33}{0.5} - 1$	1'-10"	19.9W - 21.6
48"	8	B	2	W-0.75	$\frac{W-1.33}{0.5} - 1$	1'-10"	19.9W - 21.6
54"	4	A	2	W-0.75	$\frac{W-1.33}{0.5} - 1$	2'-4"	21.5W - 24.7
	4	B	2	W-0.75	$\frac{W-1.33}{0.5} - 1$	1'-10"	19.9W - 21.6
60"	10	B	2	W-0.75	$\frac{W-1.33}{0.5} - 1$	1'-10"	19.9W - 21.6

DIMENSIONS "S" FOR SLOPE 1:4
FOR VARIOUS CULVERT SIZES AND SKEWS

CULVERT HEIGHT	NO SKEW	≤ 10°	10° ≤ 20°	20° ≤ 30°
36"	14'-5 ¹ / ₈ "	14'-7 ³ / ₄ "	15'-4 ¹ / ₄ "	16'-8"
42"	16'-10"	17'-1"	17'-11"	19'-5 ¹ / ₄ "
48"	18'-10 ³ / ₄ "	19'-2 ¹ / ₄ "	20'-1 ¹ / ₄ "	21'-10"
54"	20'-11 ¹ / ₂ "	21'-3 ³ / ₈ "	22'-3 ³ / ₈ "	24'-2 ³ / ₈ "
60"	23'-4 ³ / ₈ "	23'-8 ³ / ₄ "	24'-10 ³ / ₈ "	26'-11 ³ / ₄ "

GENERAL NOTES:

- ALL TABLE DIMENSIONS AND QUANTITIES ARE FOR SINGLE BOX CULVERT HEADWALLS. TO ADAPT ANY OF THESE TABLES FOR DOUBLE BOX CULVERTS, DOUBLE THE NUMBER OF GRATES REQUIRED AND ADD AN ADDITIONAL WALL. (WALL THICKNESS SHALL BE SAME AS THE CENTER WALL THICKNESS OF THE BOX CULVERT).
- FOR QUANTITY CALCULATIONS DIMENSION "W" SHALL BE MEASURED IN FEET.
- QUANTITIES FOR SKEWED HEADWALLS NOT SHOWN.
- PAY ITEMS ARE IDENTIFIED BY AN ASTERISK (*).
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- GRATING IS DESIGNED FOR A TRANSVERSING LOAD OF 1,800 POUNDS AT YIELD.


APPROVED: *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEERING OFFICER

DATE	REVISIONS
3-01-2022	REVISED BAR NO. 1 THICKNESS AND WEIGHT OF HEADWALL GRATES
3-31-2016	STATION, OFFSET AND INVERT ELEVATION MOVED
2-07-2012	DELETED SECTION FROM PLAN VIEW




GRATING FOR
HEADWALL TYPE IV
BOX CULVERT ≤ 84" WIDTH

STANDARD B21-04

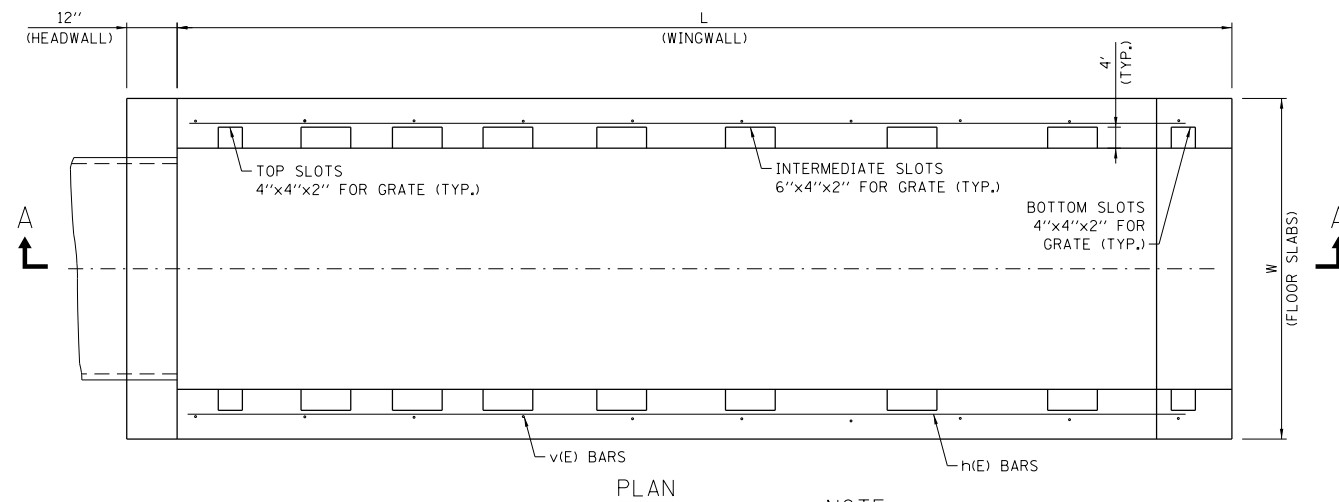


PLAN

NOTE:
v(E) BARS ARE TO BEGIN AT THE CULVERT
END OF THE SLOPE HEADWALL

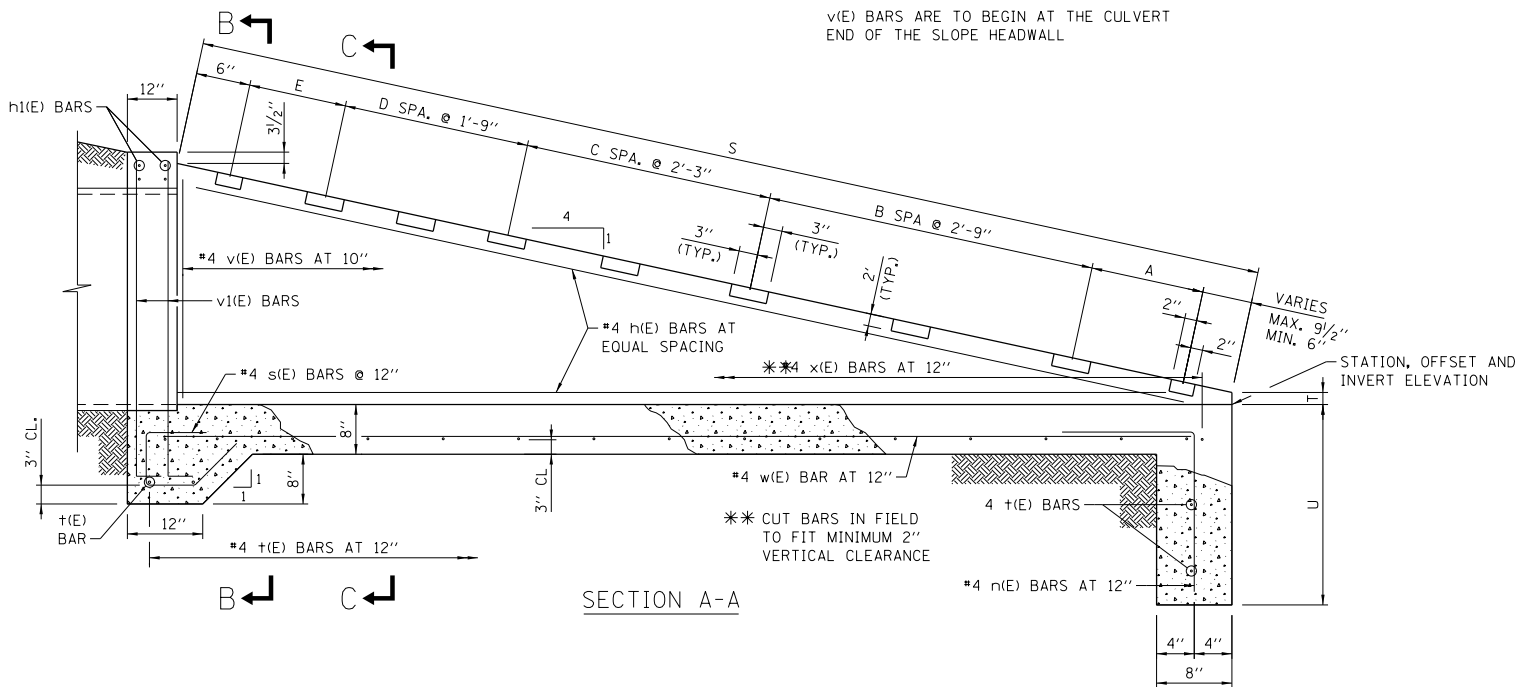


SECTION A-A

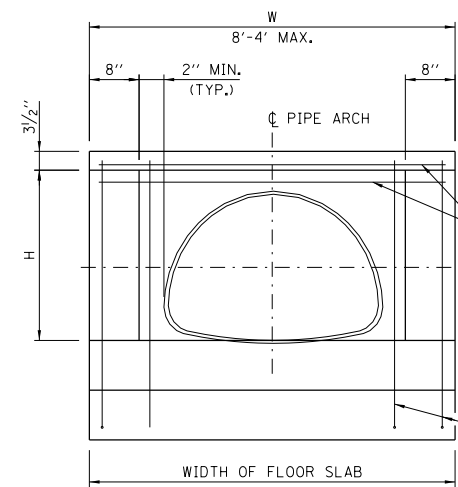


SECTION B-B

ELLIPTICAL PIPE OR PIPE-ARCH

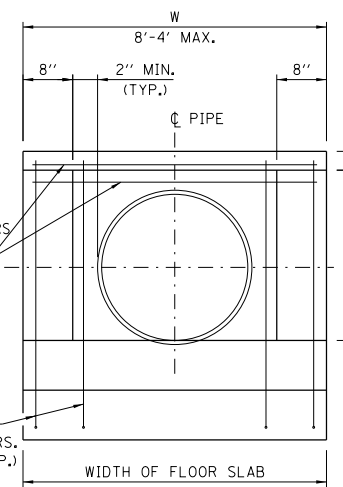

SECTION B-B


CIRCULAR PIPE

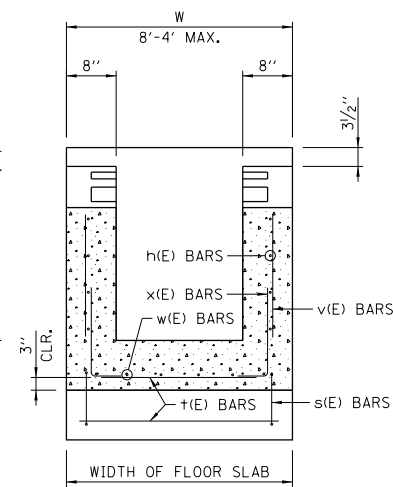


SECTION C-C

DIMENSIONS AND QUANTITIES IN TWO WINGWALLS 1:4 SLOPE


PIPE-ARCH ELLIPTICAL PIPE (SPAN ≤ 77")	CIRCULAR PIPE (DIAMETER)	DIMENSIONS							NO. OF SPACES			CONCRETE CLASS SI*	REINF. BAR # (POUND)
		H	L	S	T	U	A	E	B	C	D		
RISE ≤ 30"		3'-2"	12'-0"	12'-4 1/2"	2"	2'-8"	2'-2"	2'-2"	-	3	-	.98	151
RISE ≤ 36"		3'-8"	14'-0"	14'-5 5/8"	2"	2'-8"	2'-2"	2'-2"	-	4	-	1.33	188
RISE ≤ 42"		4'-3"	16'-4"	16'-10"	2"	3'-2"	2'-8"	2'-2"	4	-	-	1.78	251
RISE ≤ 48"		4'-9"	18'-4"	18'-10 3/4"	2"	3'-2"	2'-2"	2'-2"	-	6	-	2.23	295
RISE ≤ 54"	54"	5'-3"	20'-4"	20'-11 1/2"	2"	3'-6"	2'-2"	2'-2"	4	2	-	2.72	370
RISE ≤ 60"	60"	5'-10"	22'-8"	23'-4 3/4"	2"	3'-6"	2'-2"	2'-2"	-	8	-	3.36	428
	66"	6'-4"	24'-8"	25'-5 5/8"	2"	3'-6"	2'-2"	2'-2"	4	4	-	3.96	517



TYPE 1



TYPE 2



TYPE 3

TABLE OF BARS
IN ONE WINGWALL 1:4 SLOPE

NO. 4 REINFORCEMENT BARS						
H	MARK(E)	TYPE	NO. REQ'D	LENGTH	a	b
3'-2"	H 30	STR.	4	11'-8"		
	V 30	2	6	5'-0"	2'-0"	3'-0"
	X 30	1	13	3'-2"	2'-2"	1'-0"
3'-8"	H 36	STR.	4	13'-8"		
	V 36	2	8	5'-6"	2'-0"	3'-6"
	X 36	1	15	3'-2"	2'-2"	1'-0"
4'-3"	H 42	STR.	5	16'-0"		
	V 42	2	11	6'-0"	1'-11"	4'-1"
	X 42	1	17	3'-2"	2'-2"	1'-0"
4'-9"	H 48	STR.	5	18'-0"		
	V 48	2	14	6'-5"	1'-10"	4'-7"
	X 48	1	19	3'-2"	2'-2"	1'-0"
5'-3"	H 54	STR.	6	20'-0"		
	V 54	2	16	6'-11"	1'-10"	5'-1"
	X 54	1	21	3'-2"	2'-2"	1'-0"
5'-10"	H 60	STR.	6	22'-4"		
	V 60	2	18	7'-7"	1'-11"	5'-8"
	X 60	1	23	3'-2"	2'-2"	1'-0"
6'-4"	H 66	STR.	7	24'-4"		
	V 66	2	21	8'-1"	1'-11"	6'-2"
	X 66	1	25	3'-2"	2'-2"	1'-0"

TABLE OF BARS IN SLAB 1:4 SLOPE
(PER FT. OF FLOOR SLAB WIDTH)

NO. 4 REINFORCEMENT BARS							REINF. BARS (POUND)*	CONCRETE CLASS SI (C.Y.)*
H	MARK(E)	TYPE	NO. REQ'D	LENGTH	a	b		
3'-2"	h 131	STR.	4	W-(0'-4")			52	.38
	v 131	1	8	5'-0"	4'-4"	8"		
	n 30	1	1	4'-1"	2'-1"	2'-0"		
	w 30	STR.	1	12'-1"				
	t 30	STR.	15	W-(0'-4")				
3'-8"	h 136	STR.	4	W-(0'-4")			58	.43
	v 136	1	8	5'-6"	4'-10"	8"		
	n 36	1	1	4'-1"	2'-1"	2'-0"		
	w 36	STR.	1	14'-1"				
	t 36	STR.	19	W-(0'-4")				
4'-3"	h 142	STR.	4	W-(0'-4")			65	.50
	v 142	1	8	6'-1"	5'-5"	8"		
	n 42	1	1	4'-7"	2'-7"	2'-0"		
	w 42	STR.	1	16'-5"				
	t 42	STR.	21	W-(0'-4")				
4'-9"	h 148	STR.	4	W-(0'-4")			70	.55
	v 148	1	8	6'-7"	5'-11"	8"		
	n 48	1	1	4'-7"	2'-7"	2'-0"		
	w 48	STR.	1	18'-5"				
	t 48	STR.	23	W-(0'-4")				
5'-3"	h 154	STR.	4	W-(0'-4")			76	.60
	v 154	1	8	7'-1"	6'-5"	8"		
	n 54	1	1	4'-11"	2'-11"	2'-0"		
	w 54	STR.	1	20'-5"				
	t 54	STR.	25	W-(0'-4")				
5'-10"	h 160	STR.	4	W-(0'-4")			82	.66
	v 160	1	8	7'-8"	7'-0"	8"		
	n 60	1	1	4'-11"	2'-11"	2'-0"		
	w 60	STR.	1	22'-9"				
	t 60	STR.	27	W-(0'-4")				
6'-4"	h 166	STR.	4	W-(0'-4")			87	.71
	v 166	1	8	8'-2"	7'-6"	8"		
	n 66	1	1	4'-11"	2'-11"	2'-0"		
	w 66	STR.	1	24'-9"				
	t 66	STR.	29	W-(0'-4")				

GENERAL NOTES:


- TYPE 2 "v(E)" BARS SHALL BE ORDERED FULL LENGTH AND CUT IN THE FIELD. THE REMAINING PORTION OF THE "v(E)" BARS SHALL BE USED IN THE OTHER WALL.
- THE LONG LEG OF THE "h(E)" BARS SHALL BE VERTICAL.
- PAY ITEMS ARE IDENTIFIED BY AN ASTERISK (*).
- SEE STANDARD B23 FOR GRATING DETAILS.
- ALL CONCRETE SHALL BE CLASS SI.
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- ALL REINFORCEMENT BARS SHALL BE EPOXY COATED (E).

DATE	REVISIONS
3-01-2022	REVISED HEADWALL THICKNESS, REBAR SPACING AND REBAR TABLE
3-31-2016	STATION, OFFSET AND INVERT ELEVATION
3-11-2015	REVISED NOTES


HEADWALL TYPE IV
METAL PIPE & PIPE-ARCH
CULVERTS

STANDARD B22-05


APPROVED: *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEERING OFFICER

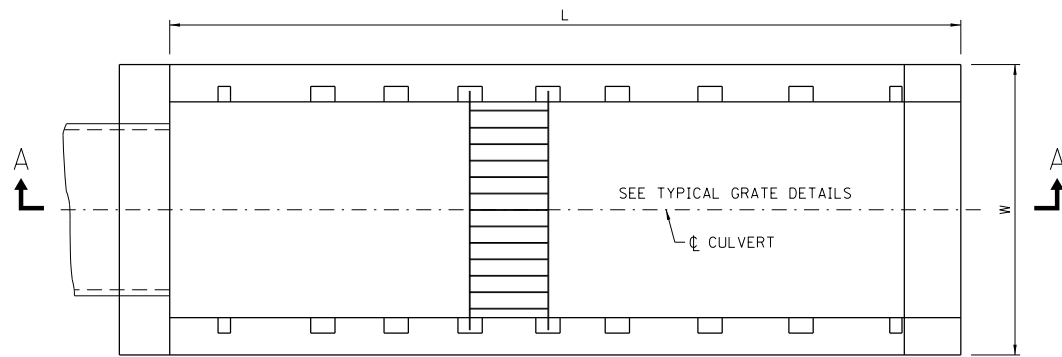

PLAN VIEW (NO SKEW)
SINGLE BOX CULVERT ≤ 84" WIDE

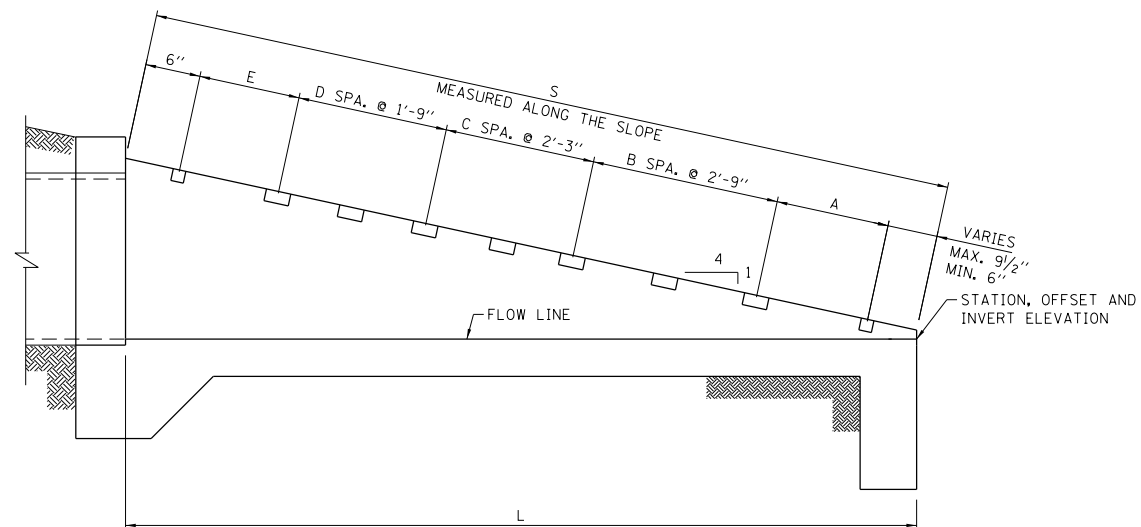


SECTION A-A
END TREATMENT - MULTIPLE OR SINGLE CELL
BOX CULVERT

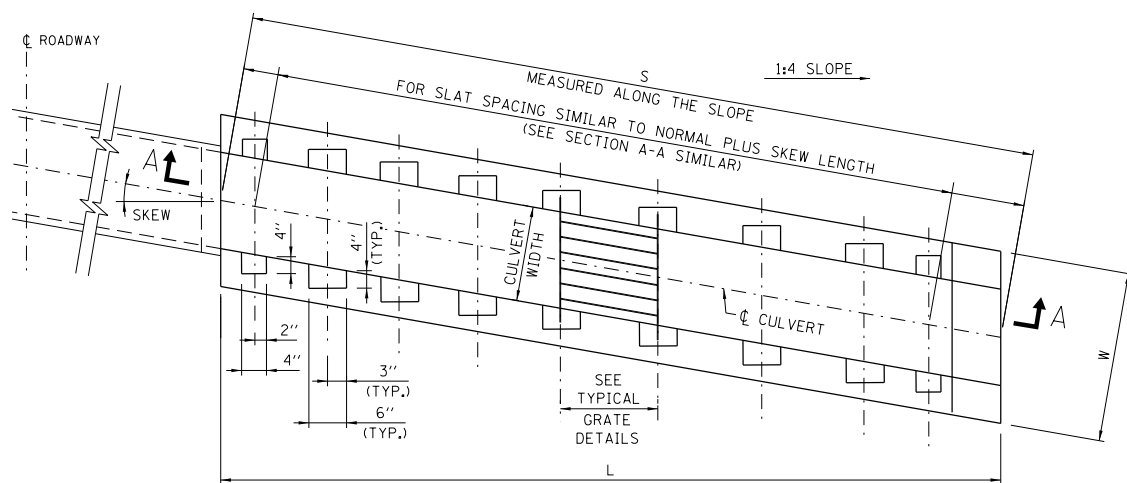


PLAN VIEW (WITH SKEW)

NOTE:
REINFORCEMENT BARS AND GRATE SPACING ARE
SIMILAR TO BOX CULVERT AT NORMAL (NO SKEW).

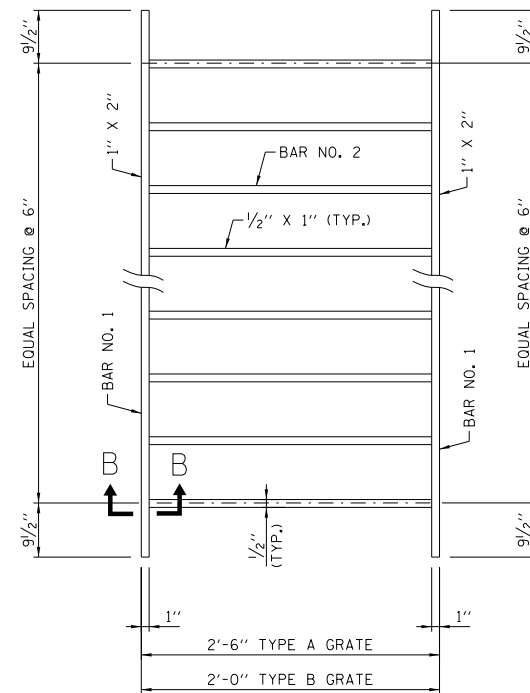

GRATE DETAILS
(WITH NO SKEW)

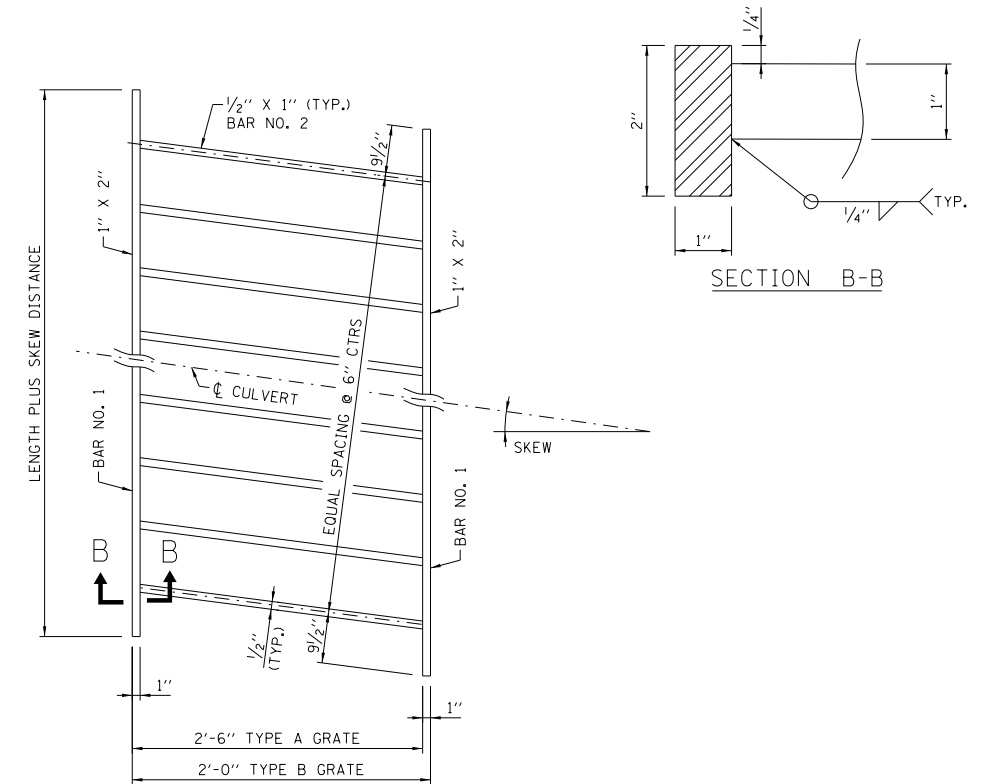

GRATE DETAILS
(WITH SKEW)

GRATING DIMENSIONS AND QUANTITIES IN ONE HEADWALL TYPE IV
BASED ON A 1 FOOT WIDTH, 1:4 SLOPE AND SKEW

H	GRATES		BARS FOR ONE GRATE				GRATING (POUND)* EACH GRATE
	NUMBER REQUIRED	TYPE REQ'D.	BAR NO. 1 REQ'D.	LENGTH	BAR NO. 2 REQ'D.	LENGTH	
3'-2"	5	B	2	W-.75	W-1.33 0.5 -1	1'-10"	19.9W - 21.6
3'-8"	6	B	2	W-.75	W-1.33 0.5 -1	1'-10"	19.9W - 21.6
4'-3"	5	A	2	W-.75	W-1.33 0.5 -1	2'-4"	21.5W - 24.7
	1	B	2	W-.75	W-1.33 0.5 -1	1'-10"	19.9W - 21.6
4'-9"	8	B	2	W-.75	W-1.33 0.5 -1	1'-10"	19.9W - 21.6
5'-3"	4	A	2	W-.75	W-1.33 0.5 -1	2'-4"	21.5W - 24.7
	4	B	2	W-.75	W-1.33 0.5 -1	1'-10"	19.9W - 21.6
5'-10"	10	B	2	W-.75	W-1.33 0.5 -1	1'-10"	19.9W - 21.6
	4	A	2	W-.75	W-1.33 0.5 -1	2'-4"	21.5W - 24.7
6'-4"	6	B	2	W-.75	W-1.33 0.5 -1	1'-10"	19.9W - 21.6

DIMENSIONS "S" FOR SLOPE 1:4
FOR VARIOUS CULVERT SIZES AND SKEWS

H	NO SKEW	≤ 10°	10° ≤ 20°	20° ≤ 30°
3'-2"	12'-4 1/2"	12'-6 3/4"	13'-2"	14'-3 3/8"
3'-8"	14'-5 1/4"	14'-7 3/4"	15'-4 1/4"	16'-8"
4'-3"	16'-10"	17'-1"	17'-11"	19'-5 1/4"
4'-9"	18'-10 3/4"	19'-2 1/4"	20'-1 1/4"	21'-10"
5'-3"	20'-11 1/2"	21'-3 3/8"	22'-3 5/8"	24'-2 3/4"
5'-10"	23'-4 3/8"	23'-8 3/4"	24'-10 3/8"	26'-11 3/4"
6'-4"	25'-5 1/8"	25'-9 3/4"	27'-0 5/8"	29'-4 1/4"

GENERAL NOTES:


- ALL TABLE DIMENSIONS AND QUANTITIES ARE FOR SINGLE CULVERT HEADWALLS. TO ADAPT ANY OF THESE TABLES FOR DOUBLE CULVERTS, DOUBLE THE NUMBER OF GRATES REQUIRED AND ADD AN ADDITIONAL WALL. (WALL THICKNESS SHALL BE SAME AS THE CENTER WALL THICKNESS OF THE CULVERT.)
- FOR QUANTITY CALCULATIONS DIMENSION "W" SHALL BE MEASURED IN FEET.
- QUANTITIES FOR SKEWED HEADWALLS NOT SHOWN.
- PAY ITEMS ARE IDENTIFIED BY AN ASTERISK (*).
- ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT (V:H).
- GRATING IS DESIGNED FOR A TRANSVERSING LOAD OF 1,800 POUNDS AT YIELD.

APPROVED: *Paul Kovacs* DATE 2-7-2012
CHIEF ENGINEERING OFFICER


DATE	REVISIONS
3-01-2022	REVISED BAR NO. 1 THICKNESS AND WEIGHT OF HEADWALL GRATES
3-31-2016	STATION, OFFSET AND INVERT ELEVATION MOVED
2-07-2012	DELETED SECTION VIEW FROM SKEW PLAN

GRATING FOR
HEADWALL TYPE IV PIPE
AND PIPE-ARCH CULVERTS


STANDARD B23-04

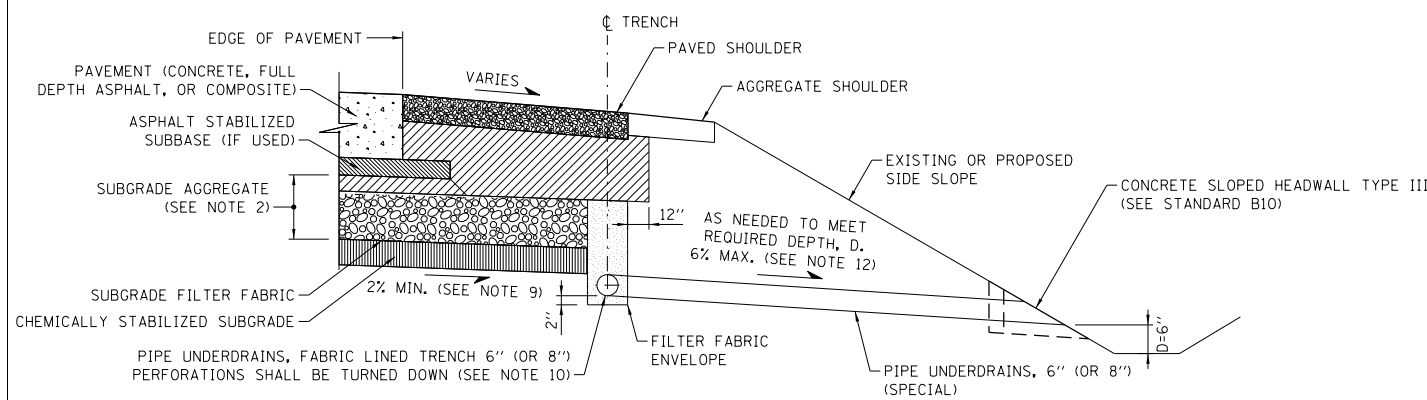


LOCATIONS WITHOUT GUTTER

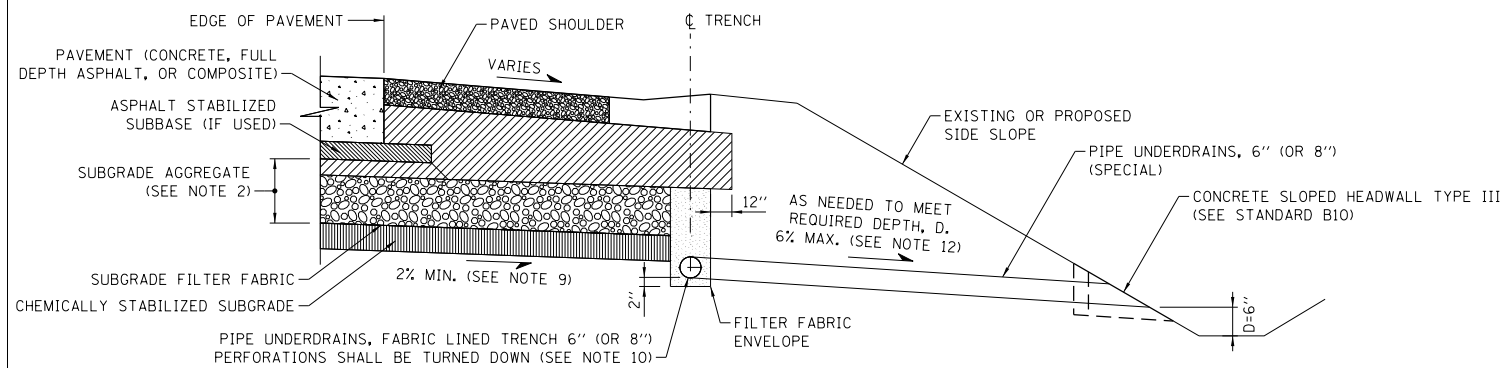

LOCATIONS WITH GUTTER

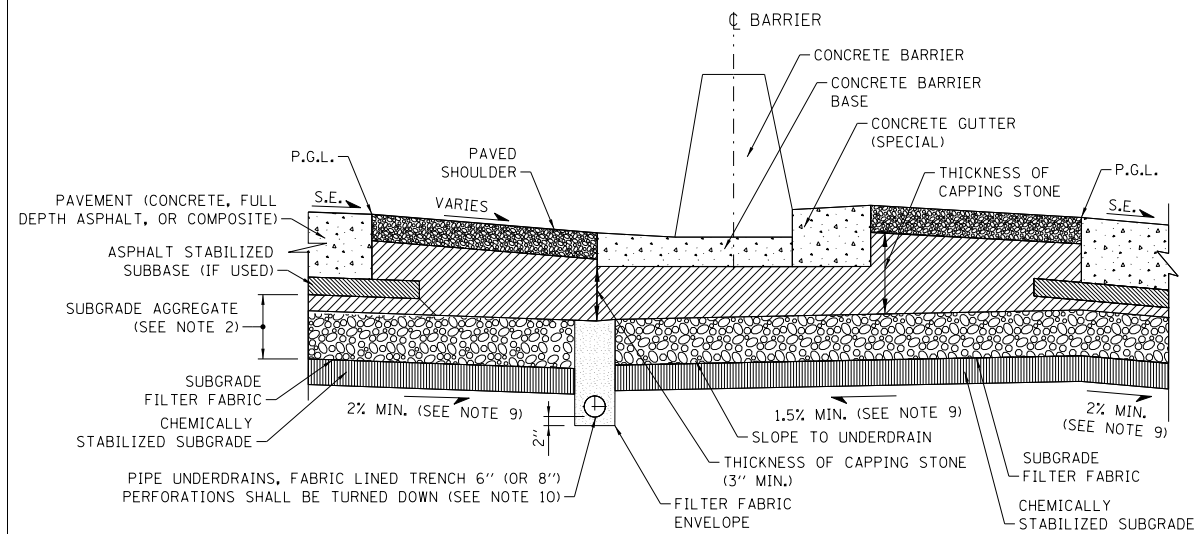


LOCATIONS WITH VARIABLE HEIGHT DOUBLE FACE BARRIER

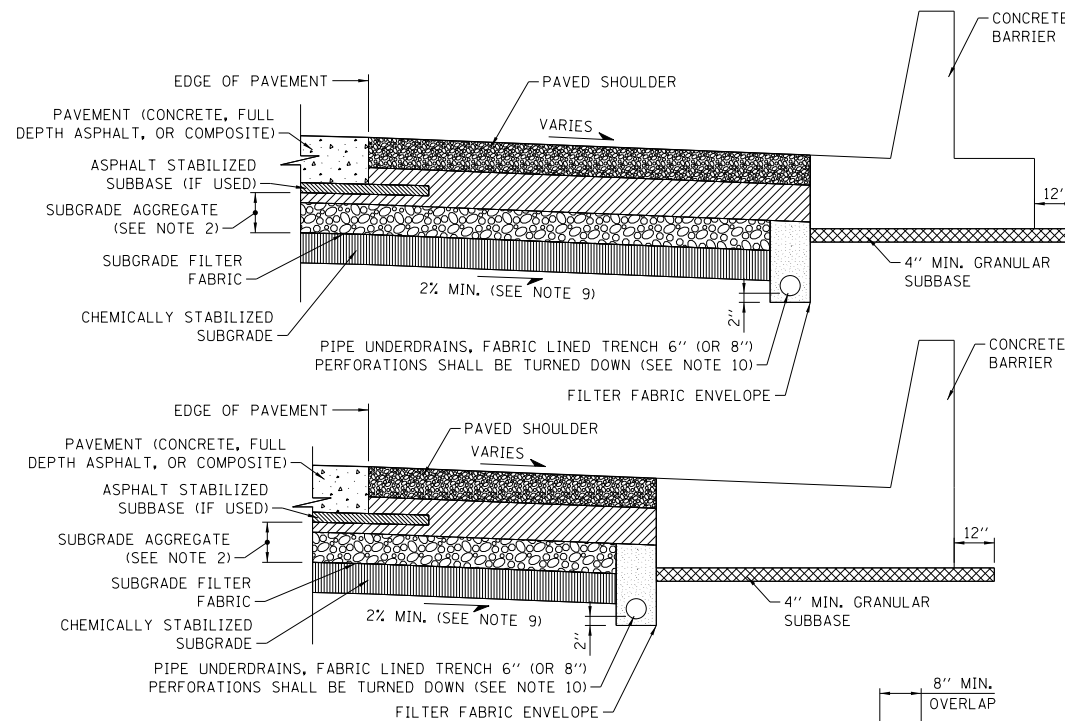


LOCATIONS WITH BARRIER


MAXIMUM ALLOWABLE DRAINAGE DISTANCE TO OUTLET OR SEPARATION DISTANCE BETWEEN OUTLETS	
ROADWAY PROFILE GRADE (%)	DISTANCE
≤ 1	250 FT.
BETWEEN 1 AND 2	375 FT.
≥ 2	500 FT. (NOTE 5)

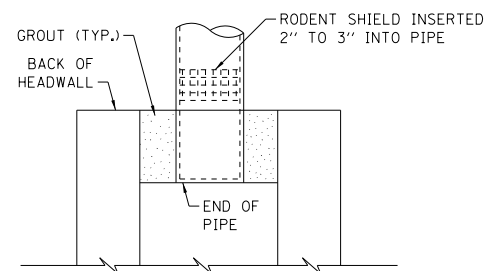


RODENT SHIELD PLACEMENT

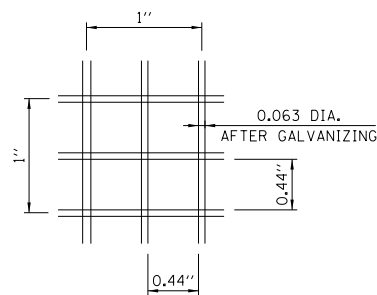


SECTION A-A

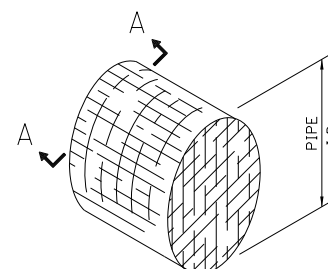


DETAIL OF RODENT SHIELD

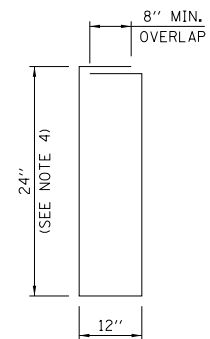

FILTER FABRIC ENVELOPE

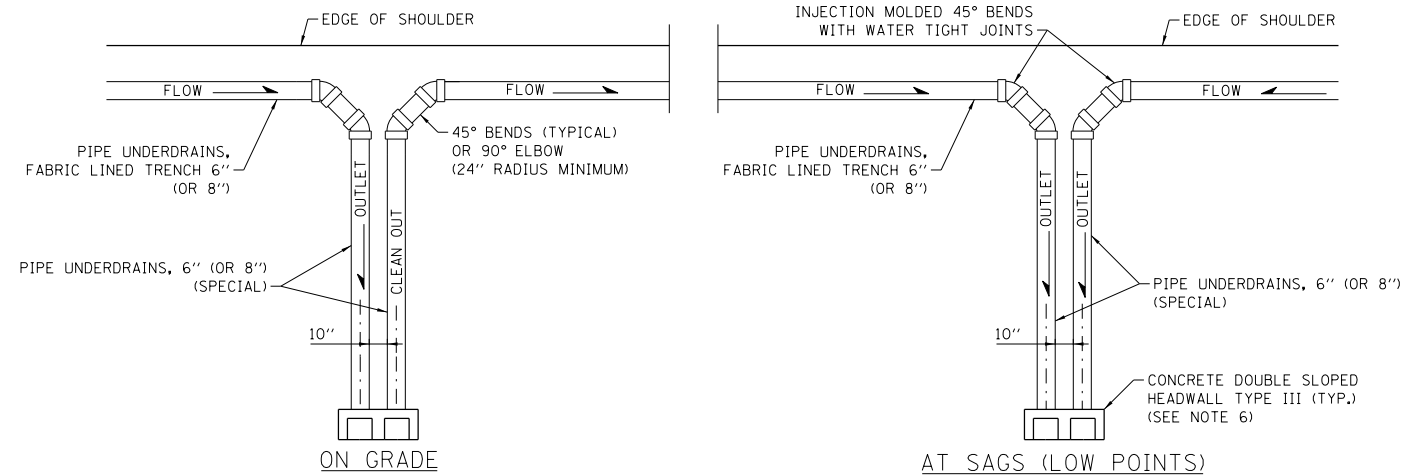

DETAIL OF PIPE UNDERDRAIN OUTLETS

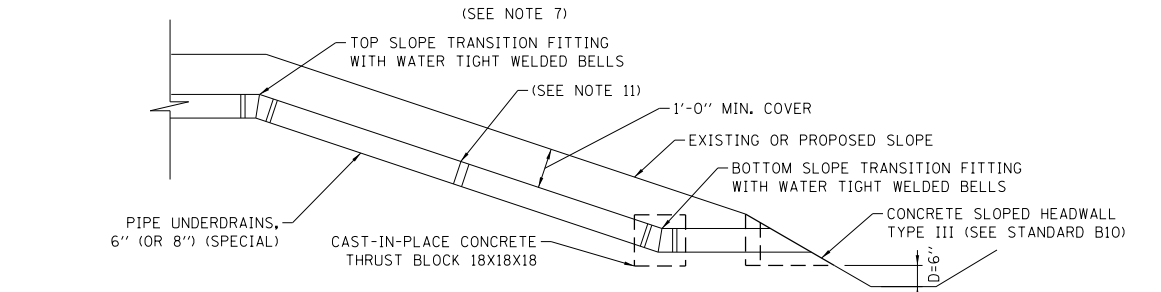

DETAIL OF PIPE UNDERDRAIN OUTLET ON HIGH FILL SLOPE

NOTES FOR PIPE UNDERDRAIN

- FOR NEW CONSTRUCTION OR WIDENING PROJECTS, THE PIPE UNDERDRAIN INSTALLATION SHALL OCCUR AFTER SUBGRADE HAS BEEN PREPARED AND AFTER LIFT OF PGE BASE IS PLACED AND BEFORE 3" AND VARIES CA-6 CAPPING STONE IS PLACED. FOR PAVEMENT RUBBLIZATION PROJECTS, THE PIPE UNDERDRAIN SHALL BE INSTALLED PRIOR TO RUBBLIZATION.
- SUBGRADE AGGREGATE SHALL CONSIST OF A 3" AND VARIES CA-6 CAP ABOVE A PGE BASE, THICKNESS AS NOTED IN THE PLANS.
- ON SUPERELEVATED CURVES PLACE LONGITUDINAL UNDERDRAIN ON LOW SIDE ONLY.
- IN AREAS WHERE ROADWAY LONGITUDINAL GRADE IS LESS THAN 0.5%, DIMENSION WILL INCREASE AS NECESSARY TO MAINTAIN MINIMUM 0.5% SLOPE IN PIPE UNDERDRAIN.
- IF 500' MAXIMUM DISTANCE IS EXCEEDED, PIPE UNDERDRAIN SHALL BE INCREASED TO 8" DIAMETER AND TRENCH WIDTH INCREASED TO 16".
- AT OUTLET LOCATIONS, PIPE UNDERDRAINS SHALL SEPARATE SUFFICIENTLY TO PROVIDE SPACE FOR TWO CONCRETE SLOPED HEADWALLS, OR TWO PIPES CAN RUN PARALLEL INTO A DOUBLE SLOPED HEADWALL.
- IN AREAS WHERE A CLOSED DRAINAGE SYSTEM EXISTS, THE PIPE UNDERDRAIN, 6" (OR 8") (SPECIAL) SHALL DRAIN TO THE NEAREST CATCH BASIN. THE UPPER END OF A RUN ON GRADE SHALL ALSO BE CONNECTED TO A CATCH BASIN TO BE USED AS A CLEANOUT.
- THE OUTLET END OF THE SUBDRAIN SHALL BE PROTECTED BY A PERMANENT RODENT SHIELD. THE RODENT SHIELD SHALL HAVE THE CONFIGURATION SHOWN AND BE CONSTRUCTED FROM HOT DIP GALVANIZED STEEL INDUSTRIAL WIRE CLOTH 3x3 MESH, 0.063"x0.063" WIRE SIZE IN ACCORDANCE WITH AASHTO M232 (ASTM A153).
- BOTTOM OF SUBGRADE AGGREGATE SLOPE FROM ROADWAY PROFILE GRADE SHALL NOT BE LESS THAN 1.5% TOWARD THE PIPE UNDERDRAIN IN SUPERELEVATED SECTIONS.
- A CA 16 BACKFILLED TRENCH SHALL BE USED WITH THE INSTALLATION OF A PIPE UNDERDRAIN SYSTEM, EXCEPT THE PERCENT PASSING THE NO. 16 (1.18 mm) SIEVE SHALL BE 4 ± 4 PERCENT.
- ALL JOINTS IN SLOPE DRAIN SYSTEM SHALL BE WATERTIGHT WITH A WELDED INTERNAL CYLINDER ON THE SPIGOT END OF THE PIPE. FIELD JOINTS SHALL BE WRAPPED WITH A DOUBLE WIDE MARMAC COUPLER, OR EQUIVALENT.
- IF REQUIRED PIPE UNDERDRAIN SLOPE EXCEEDS 6%, PIPE UNDERDRAIN OUTLET ON HIGH FILL SLOPE DETAIL SHALL APPLY.






DATE	REVISIONS
3-01-2021	ADDED DETAIL FOR BARRIER
3-01-2020	ADDED COMPOSITE PAVEMENT AS OPTION
3-01-2019	REVISED PIPE UNDERDRAIN OUTLETS TO SHOW 45 DEGREE BENDS OR 90 DEGREE ELBOW.
	ADDED DETAIL FOR OUTLET AT HIGH FILL SLOPE.
3-01-2018	ADDED MINIMUM THICKNESS OF CAPPING STONE



PIPE UNDERDRAINS

STANDARD B24-09

APPROVED: *Paul Kovacs*
CHIEF ENGINEERING OFFICER
DATE: 6-1-2009

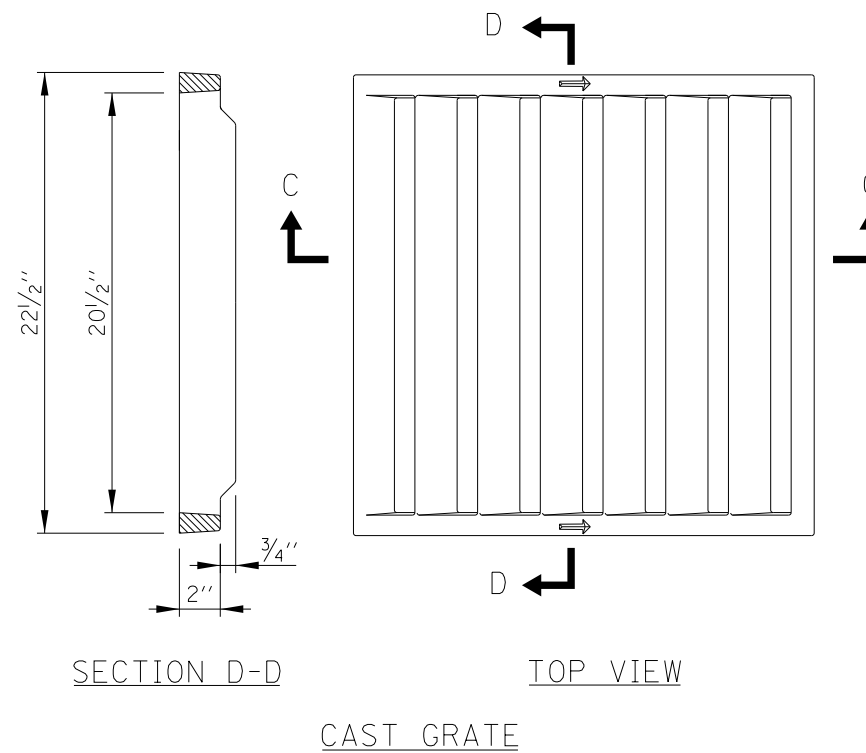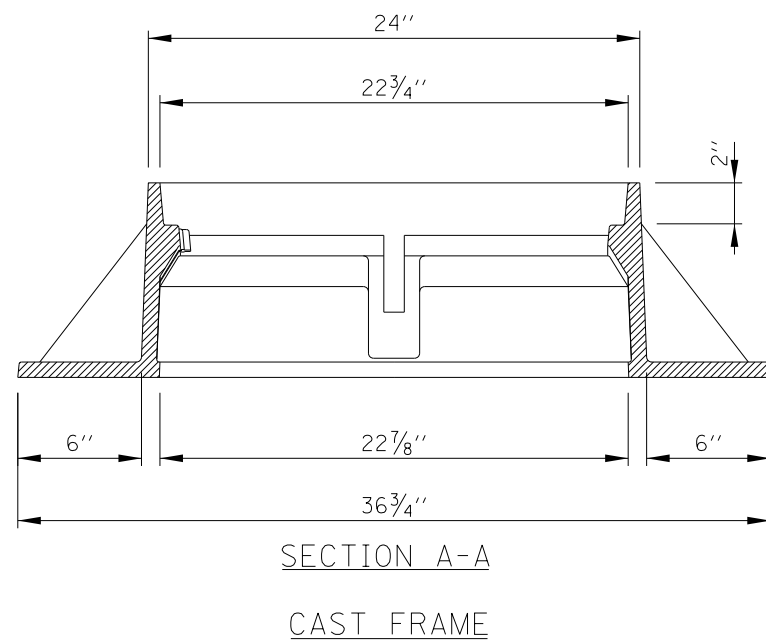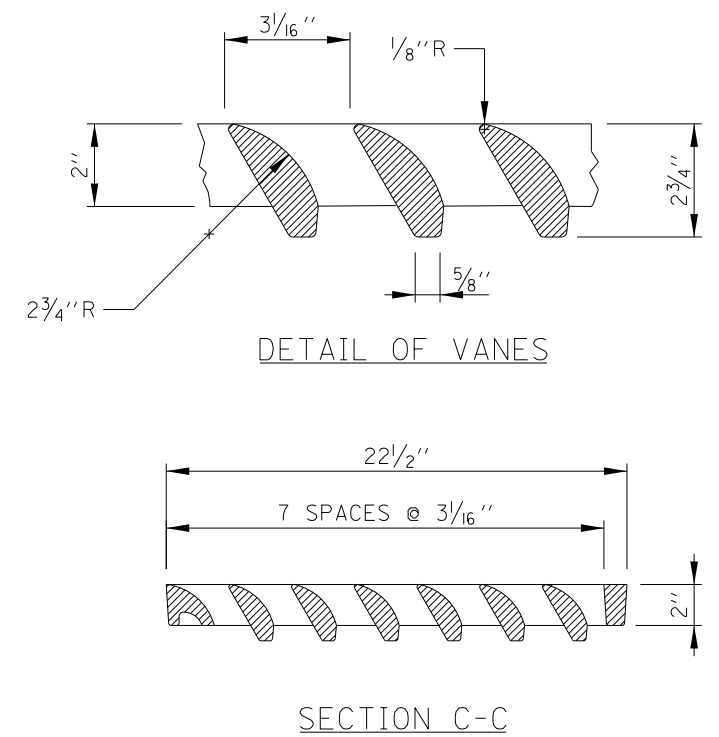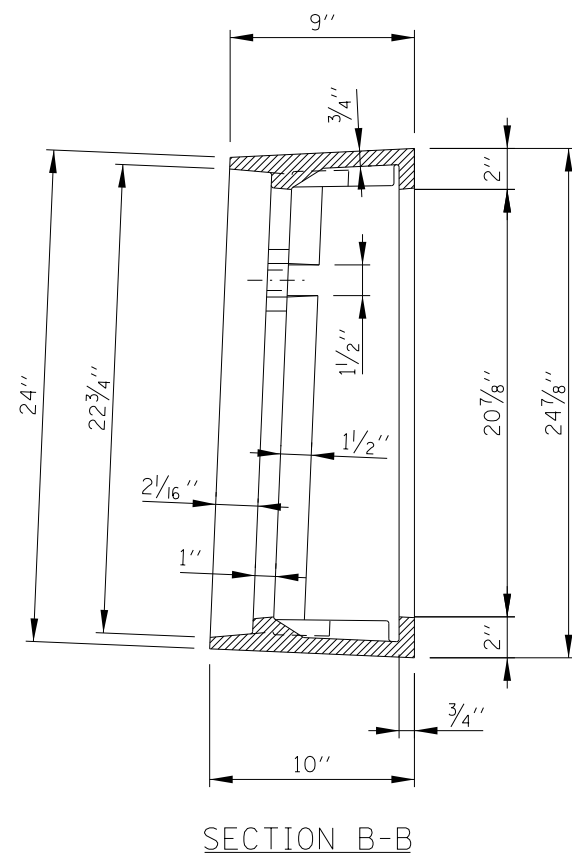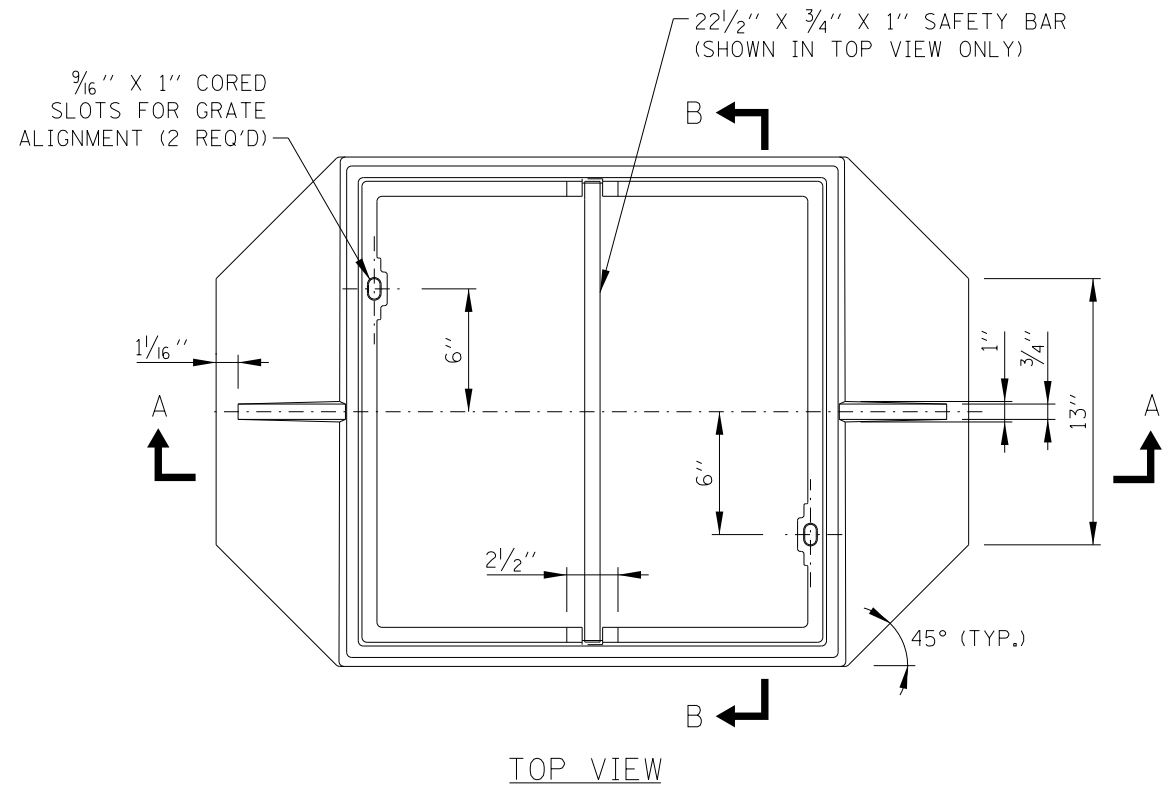

NOTES:

1. ALL FRAMES AND GRATES SHALL CONFORM TO THE REQUIREMENTS OF ART. 1006.14 FOR GRAY IRON CASTINGS AND TO ART. 1006.15 FOR DUCTILE IRON CASTINGS.
2. FRAME AND GRATE TO BE NEENAH FOUNDRY COMPANY, NEENAH NO. R-3528-V, EAST JORDAN IRON WORKS 7535 OR APPROVED EQUAL.
3. GRATE SHALL NOT BE BOLTED TO FRAME.




Paul Kovacs
APPROVED... CHIEF ENGINEER... DATE 6-30-2008

DATE	REVISIONS
03-31-14	ADDED FRAME AND GRATE CASTINGS



FRAME AND GRATE
TYPE 20A


STANDARD B25-01

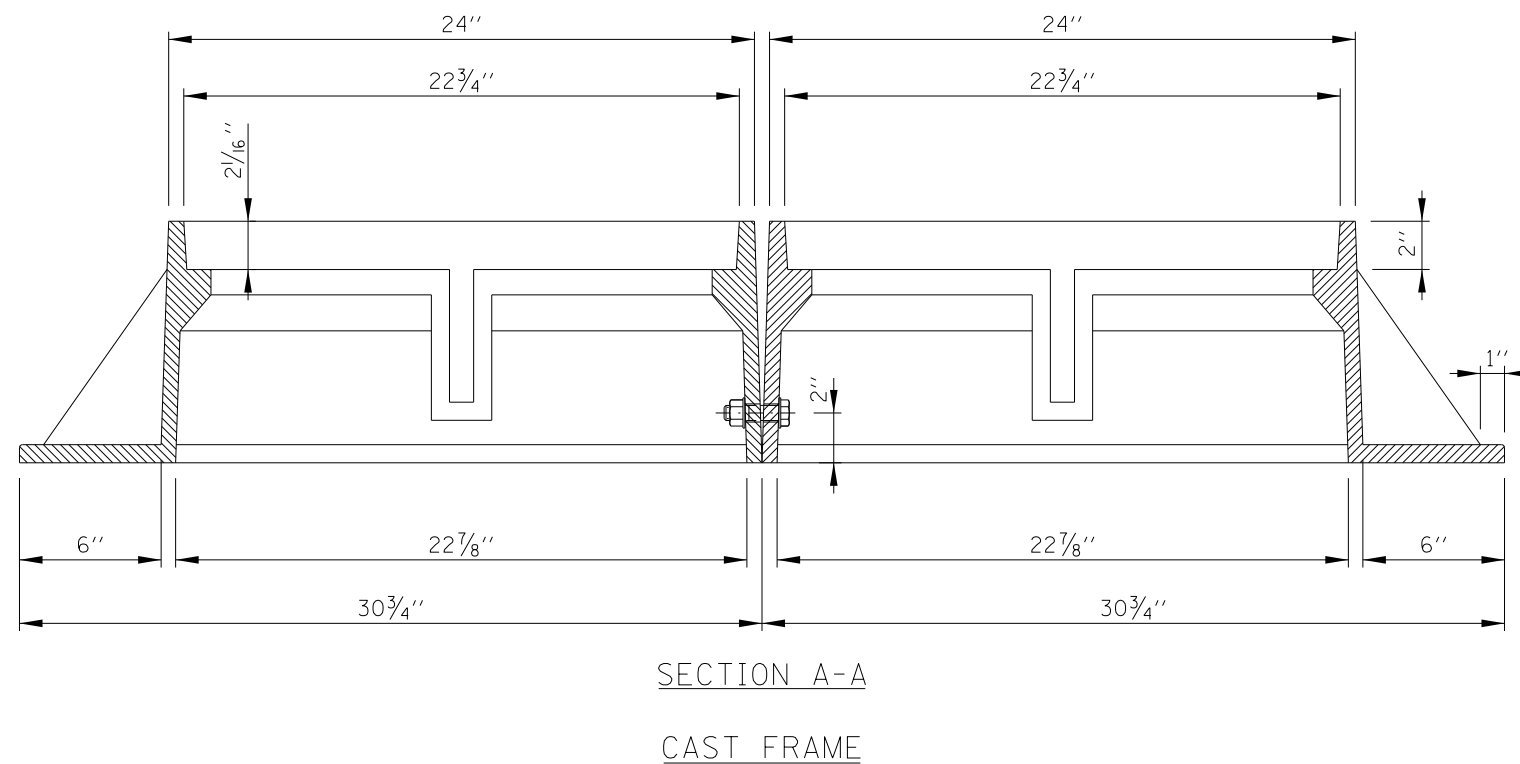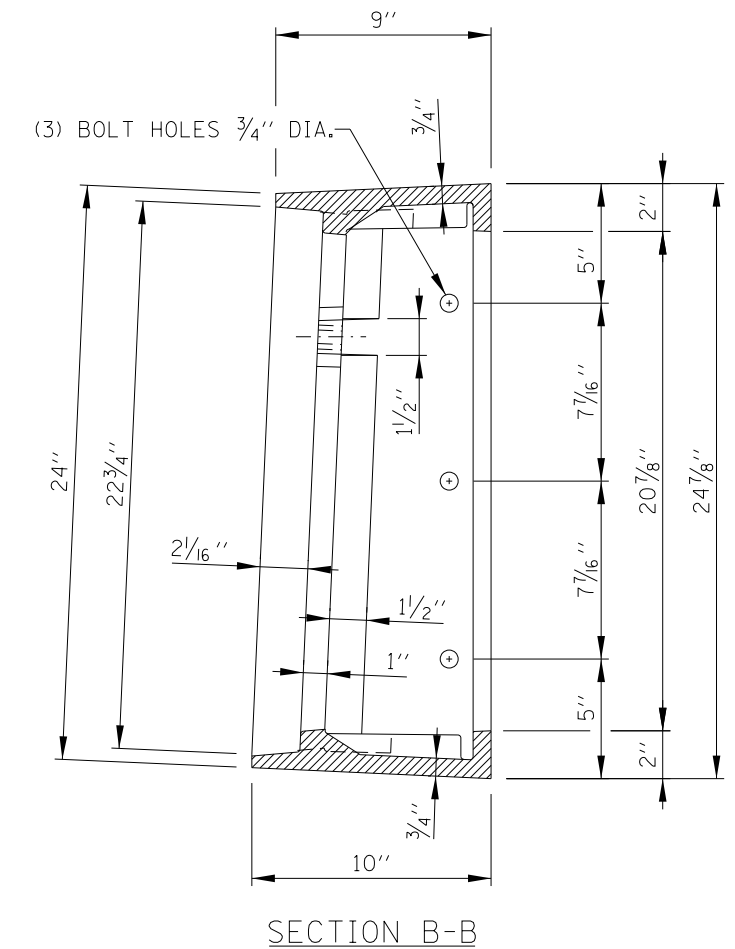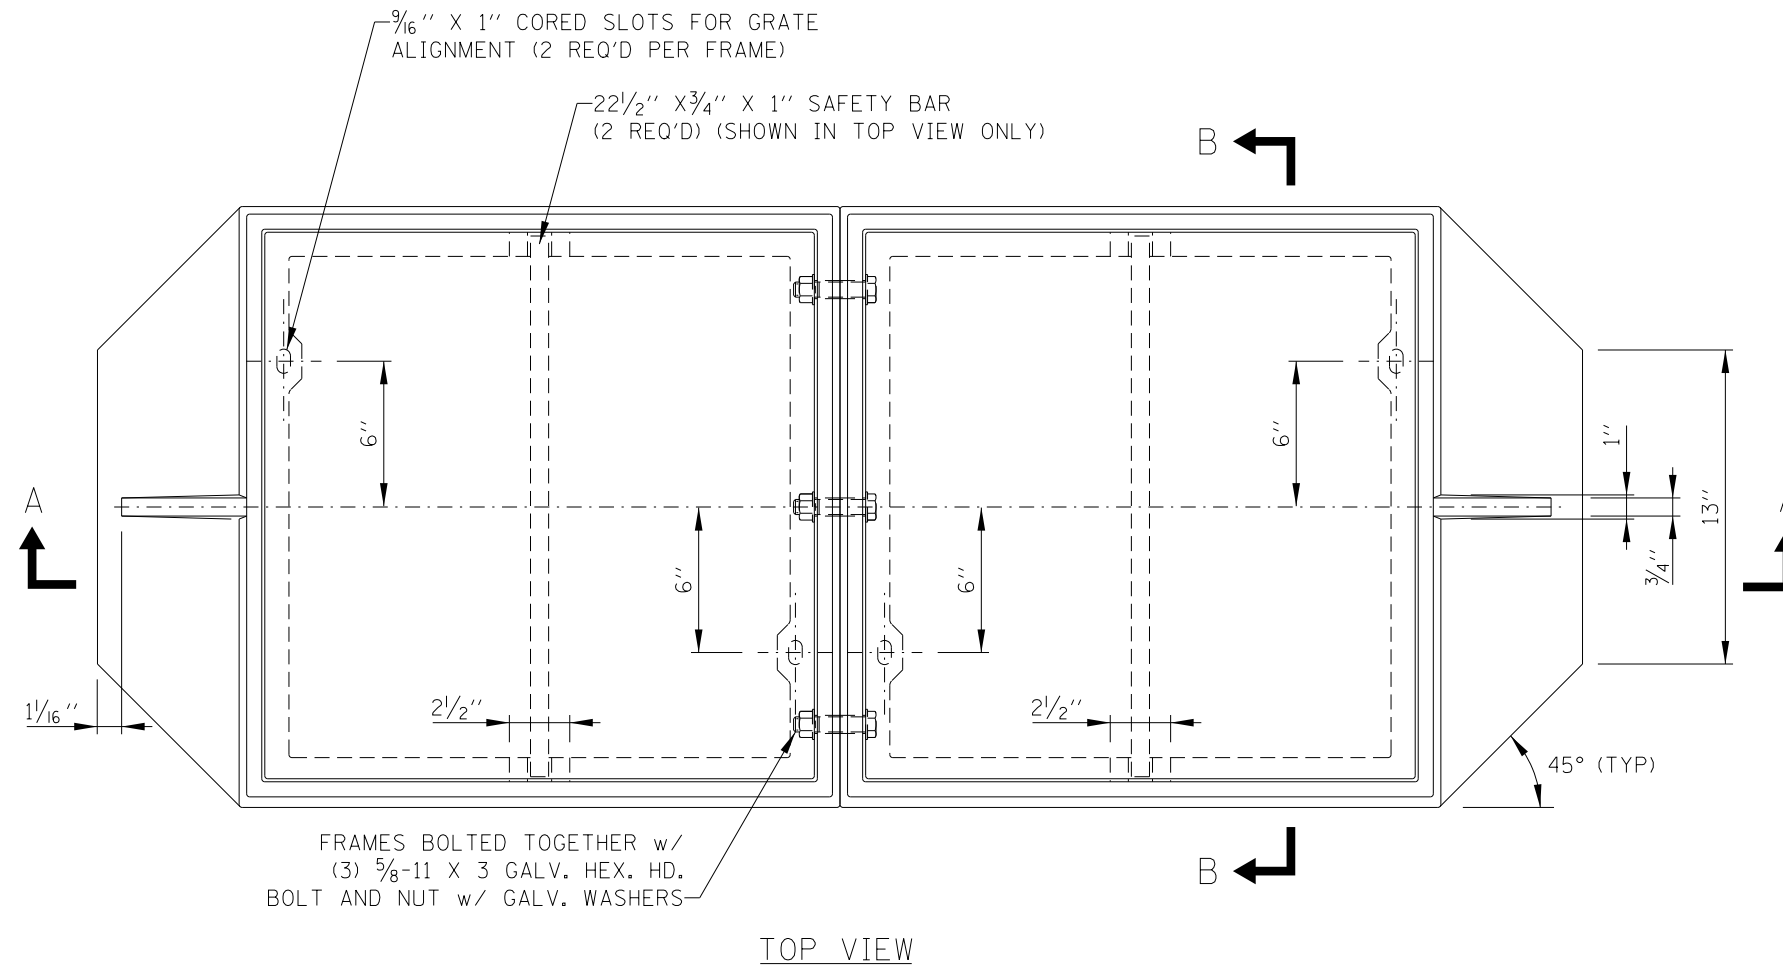


FRAME AND GRATE
TYPE 22A


STANDARD B27-01

DATE	REVISIONS
03-31-14	ADDED FRAME AND GRATE CASTINGS



 APPROVED..... CHIEF ENGINEER..... DATE 6-30-2008

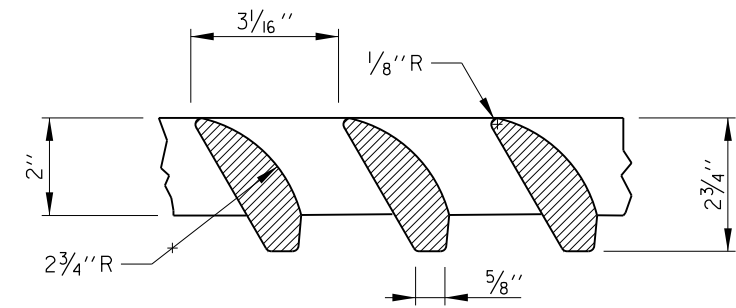

DETAIL OF VANES

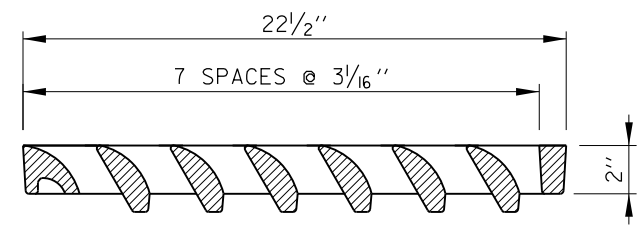

SECTION C-C

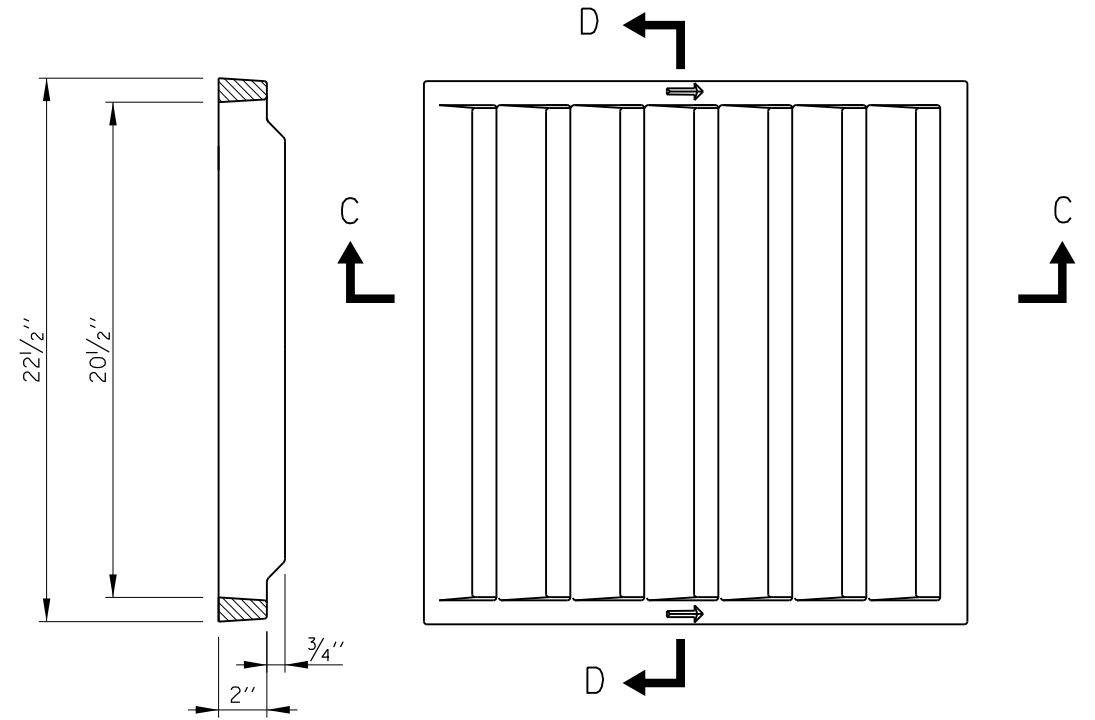

SECTION D-D

TOP VIEW

CAST GRATE
(2 REQ'D)


NOTES:




1. ALL FRAMES AND GRATES SHALL CONFORM TO THE REQUIREMENTS OF ART. 1006.14 FOR GRAY IRON CASTINGS AND TO ART. 1006.15 FOR DUCTILE IRON CASTINGS.
2. FRAME AND GRATE TO BE NEENAH FOUNDRY COMPANY, NEENAH NO. R-3529-V, EAST JORDAN IRON WORKS 7536 OR APPROVED EQUAL.
3. GRATE SHALL NOT BE BOLTED TO FRAME.



FRAME AND GRATE
TYPE 22A

STANDARD B27-01


 APPROVED CHIEF ENGINEER DATE 6-30-2008

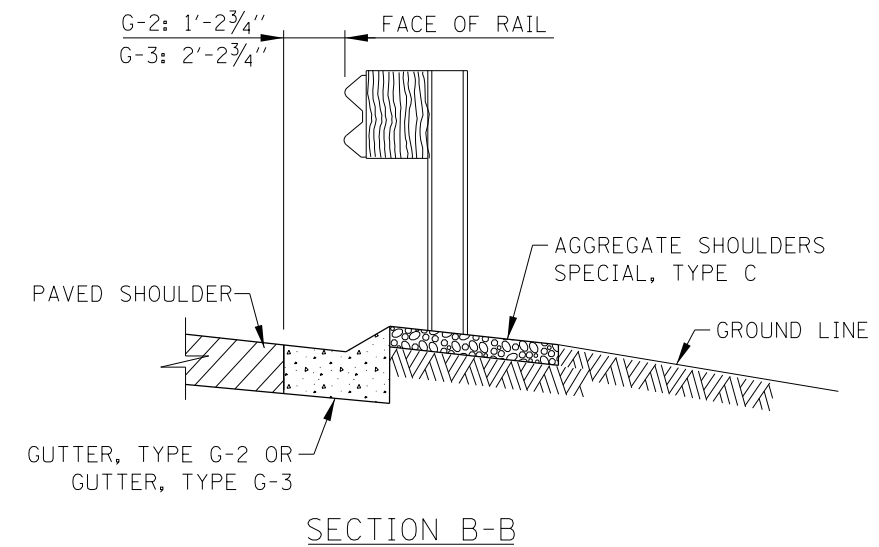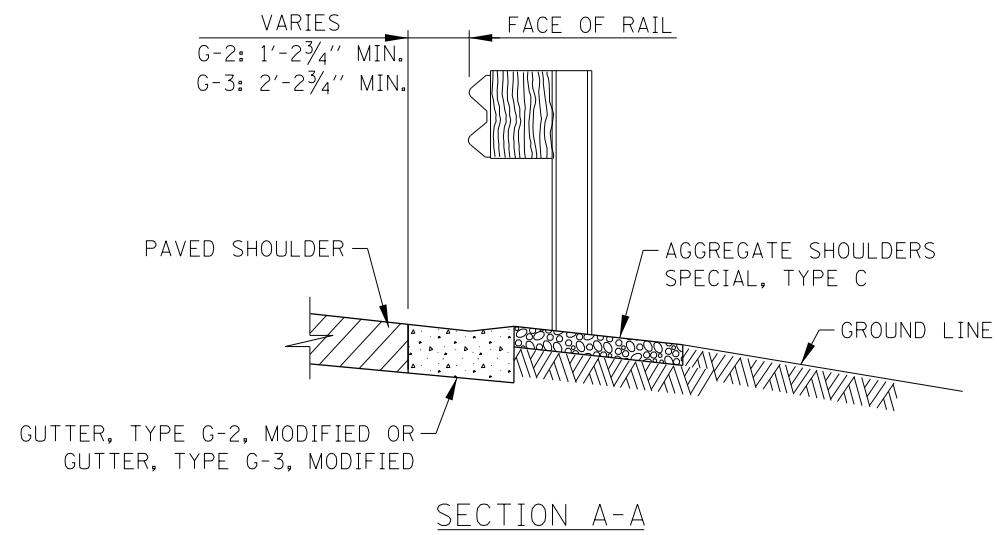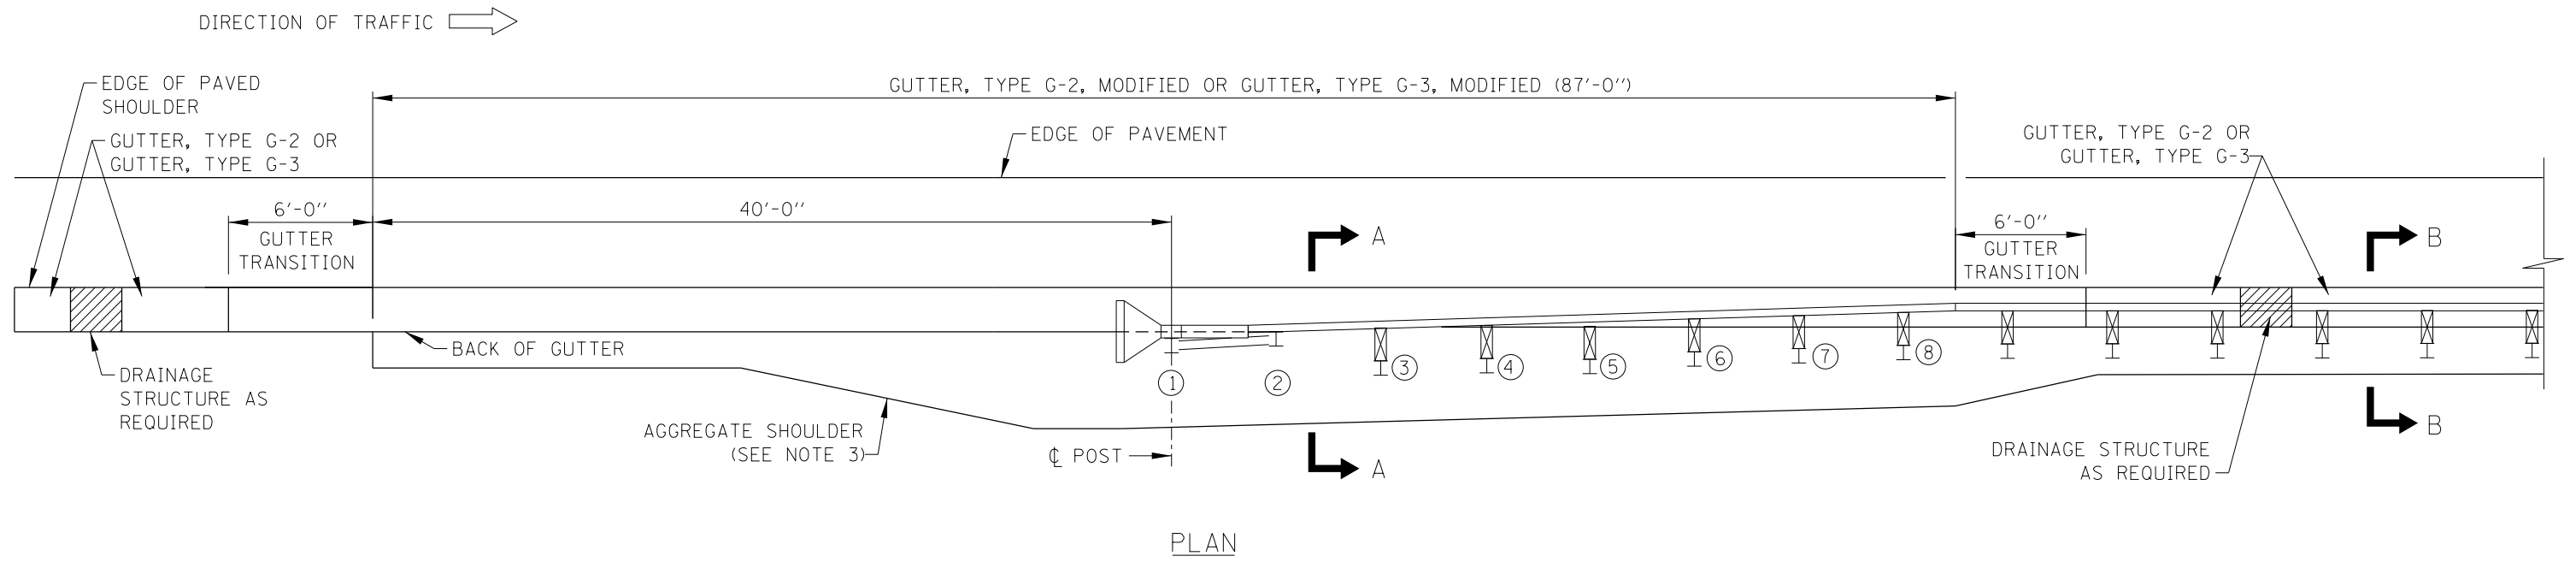

GUTTER, TYPE G-2 TRANSITION AND GUTTER, TYPE G-3 TRANSITION
AT TRAFFIC BARRIER TERMINAL, TYPE T1 (SPECIAL)

GENERAL NOTES:

1. GUTTER TRANSITIONS SHALL BE PAID FOR PER FOOT AS GUTTER, TYPE G-2 OR GUTTER, TYPE G-3, AS SPECIFIED IN THE PLANS.
2. REFERENCE ILLINOIS TOLLWAY STANDARD DRAWING C1 FOR ADDITIONAL GUARDRAIL INFORMATION.
3. REFERENCE ILLINOIS TOLLWAY STANDARD DRAWING C6 FOR SHOULDER WIDENING INFORMATION.


Paul Kovacs
APPROVED, CHIEF ENGINEERING OFFICER DATE 3-1-2010

DATE	REVISIONS
3-01-2018	CHANGED LINSTYLE AT WEDGE TO DASHED.
3-31-2017	DELETED SHEET 2
3-11-2015	REVISED NOTES
3-01-2013	REVISED GUTTER
1-01-2011	REVISED GUTTER TRANSITION TERMINATION




GUTTER TRANSITION AT TRAFFIC BARRIER TERMINAL TYPE T1 (SPECIAL)


STANDARD B28-05

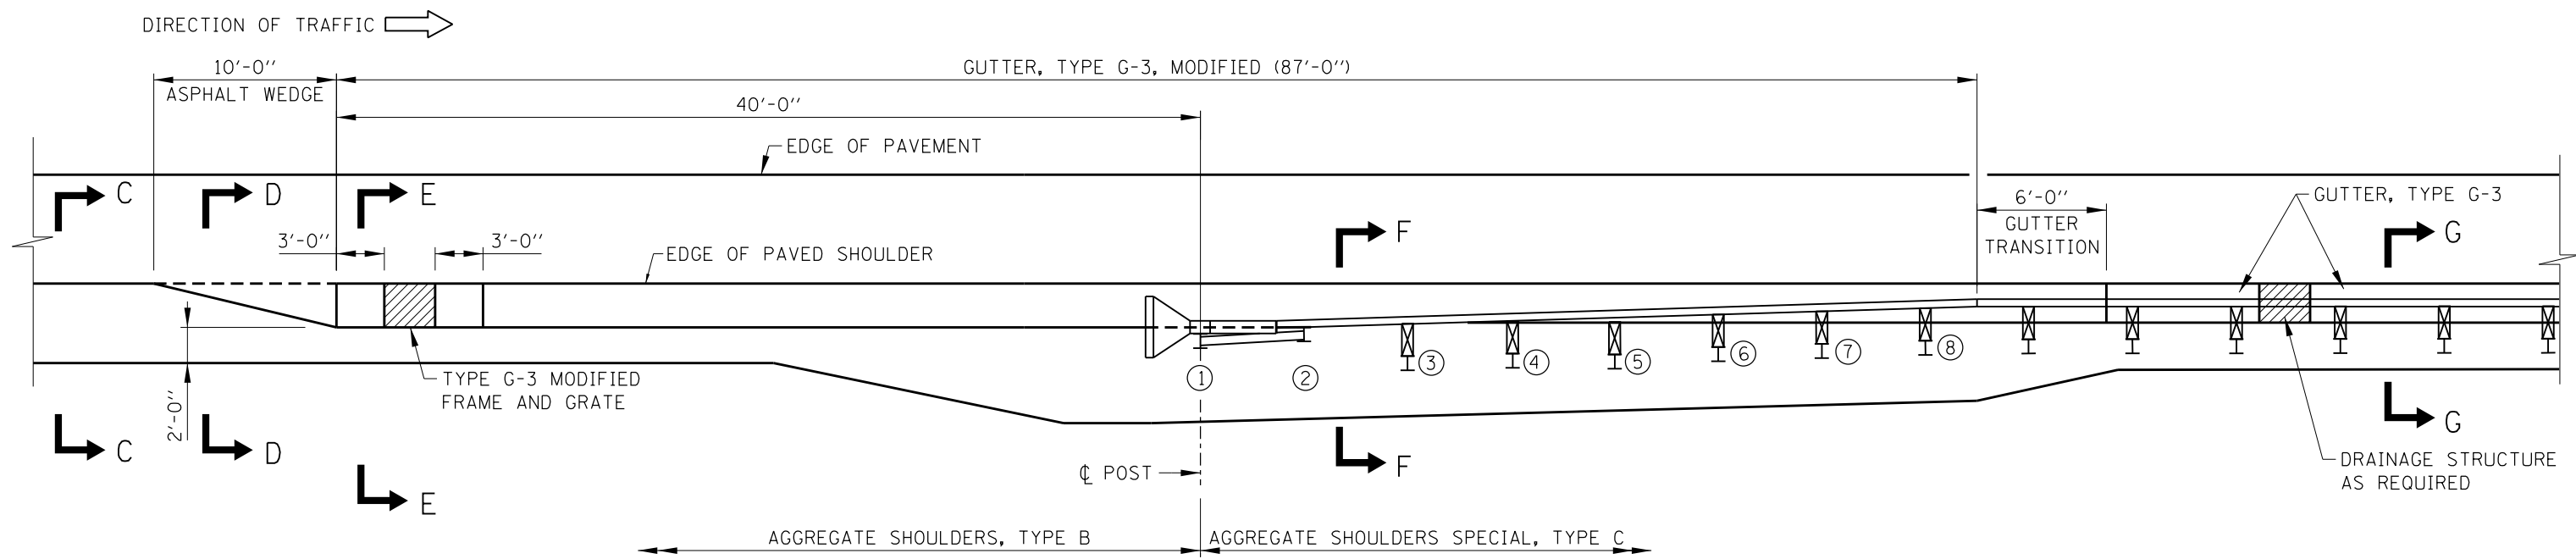


PLAN

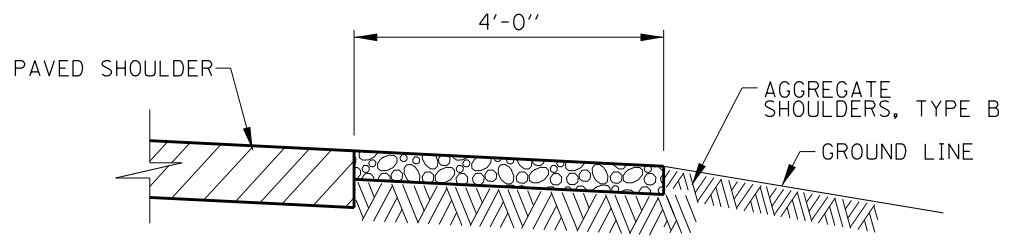


SECTION C-C

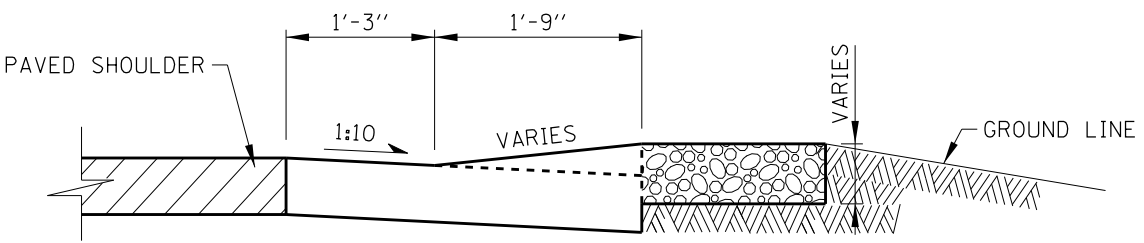


SECTION E-E
GUTTER, TYPE G-3, MODIFIED TRANSITION

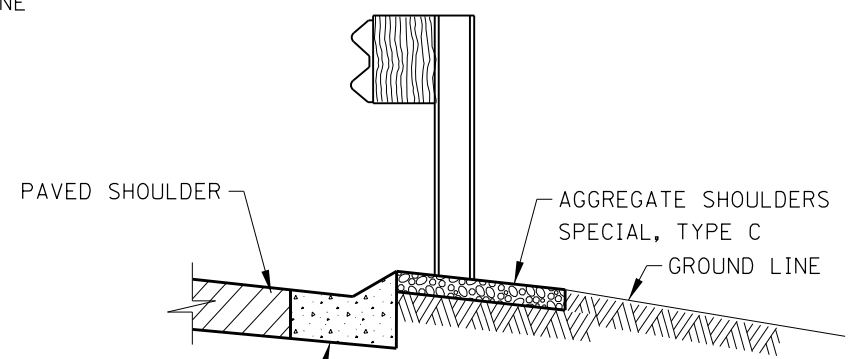

SECTION G-G

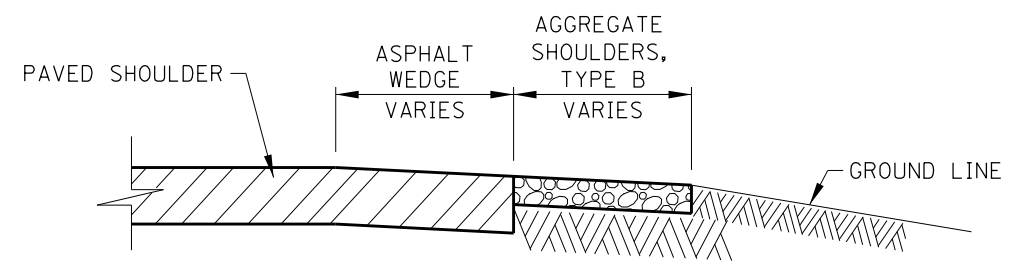

SECTION D-D
ASPHALT SHOULDER TRANSITION

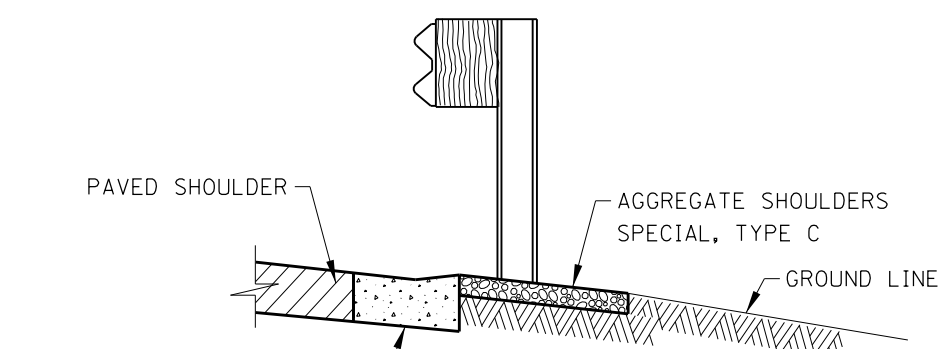

SECTION F-F


NOTE:
SEE SHEET 1 OF THIS SERIES FOR NOTES

GUTTER, TYPE G-3 TRANSITION TERMINATION AT TRAFFIC BARRIER TERMINAL, TYPE T1 (SPECIAL)


Paul Kovacs
APPROVED, CHIEF ENGINEERING OFFICER DATE 3-1-2010

GUTTER TRANSITION AT TRAFFIC BARRIER TERMINAL TYPE T1 (SPECIAL)
STANDARD B28-05


DIRECTION OF TRAFFIC →

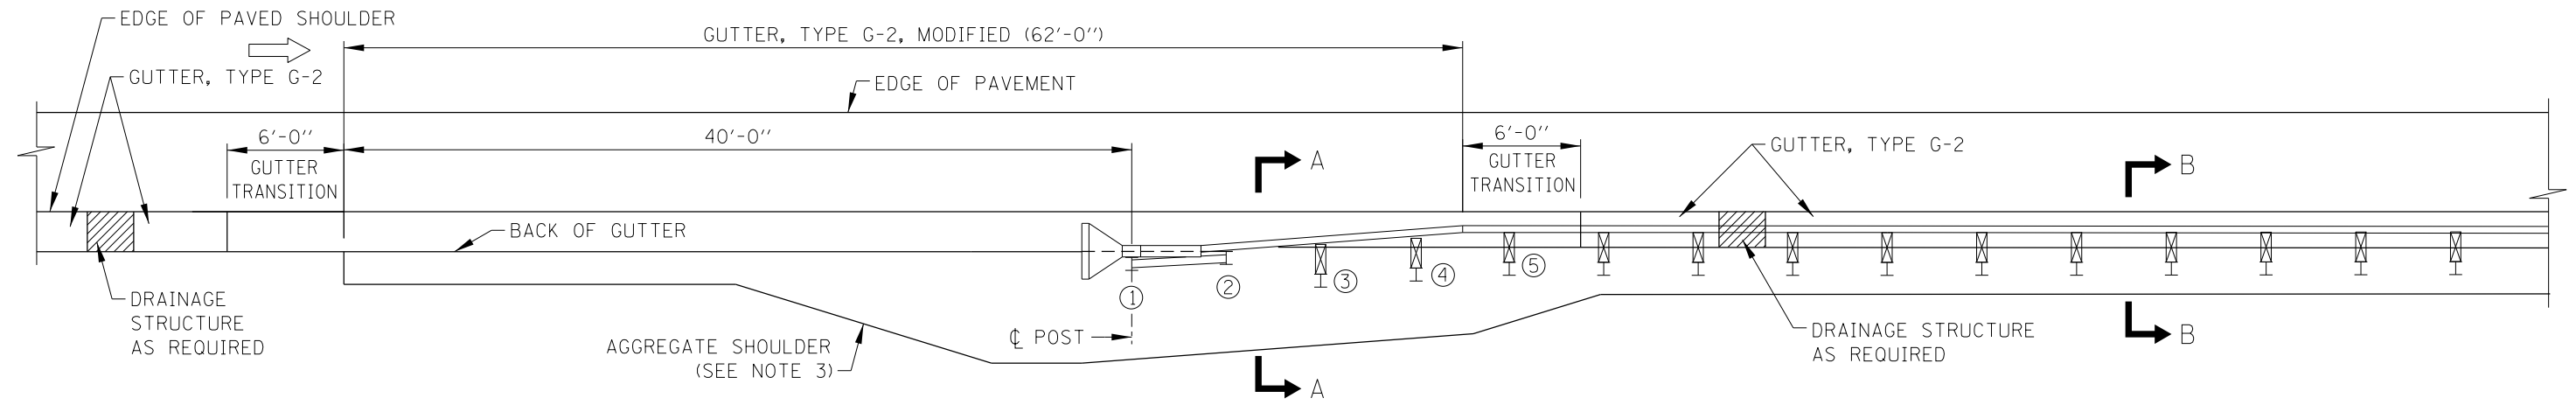

PLAN

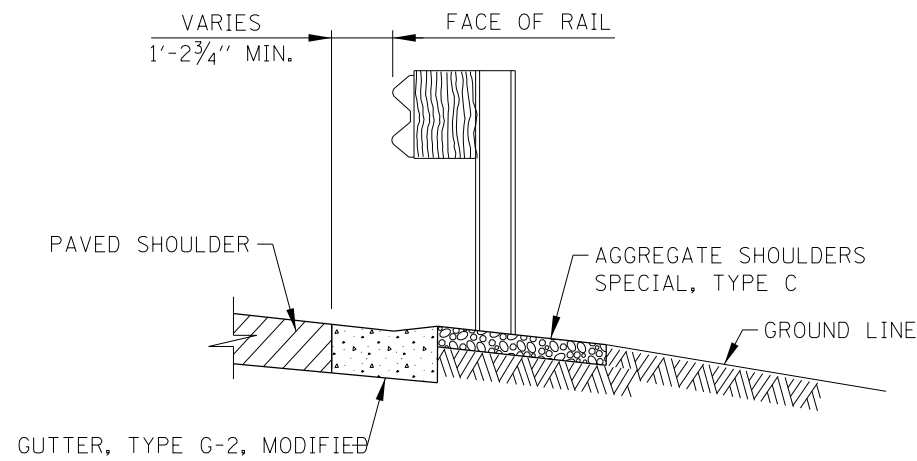

SECTION A-A

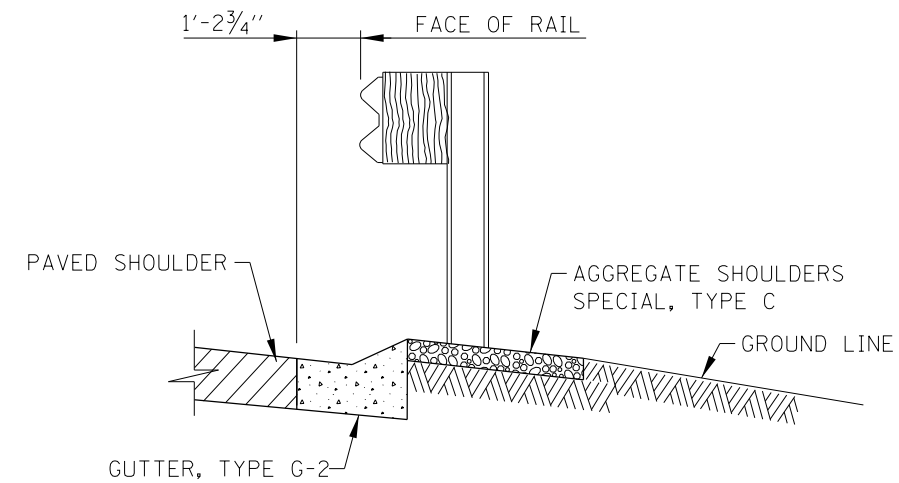


SECTION B-B

GUTTER, TYPE G-2 TRANSITION AT TRAFFIC BARRIER TERMINAL, TYPE T1-A (SPECIAL)

GENERAL NOTES:

1. GUTTER TRANSITIONS SHALL BE PAID FOR PER FOOT AS GUTTER, TYPE G-2 OR AS SPECIFIED IN THE PLANS.
2. REFERENCE ILLINOIS TOLLWAY STANDARD DRAWING C1 FOR ADDITIONAL GUARDRAIL INFORMATION.
3. REFERENCE ILLINOIS TOLLWAY STANDARD DRAWING C12 FOR SHOULDER WIDENING INFORMATION.



 APPROVED..... CHIEF ENGINEER..... DATE 1-1-2011...

DATE	REVISIONS
3-31-2017	REMOVED SHLDR DIMS
3-11-2015	REVISED NOTES
3-01-2013	REVISED GUTTER




GUTTER TRANSITION AT TRAFFIC BARRIER TERMINAL TYPE T1-A (SPECIAL)


STANDARD B29-03

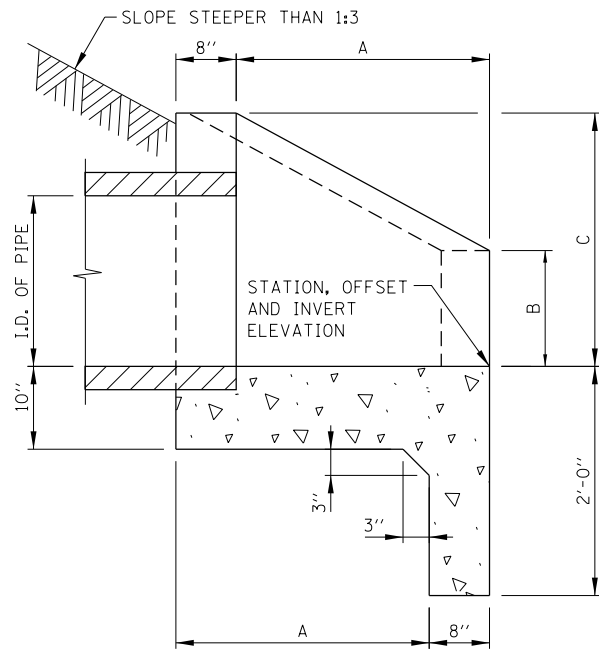

SECTION A-A
(DIMENSIONS)

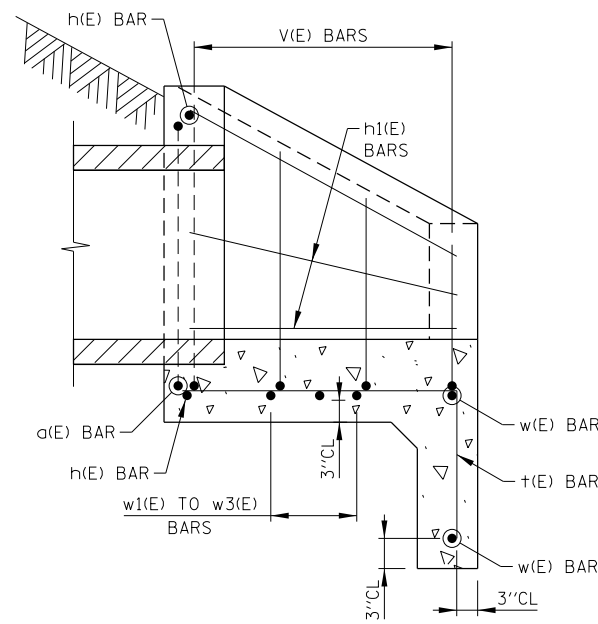


SECTION A-A
(REINFORCEMENT)

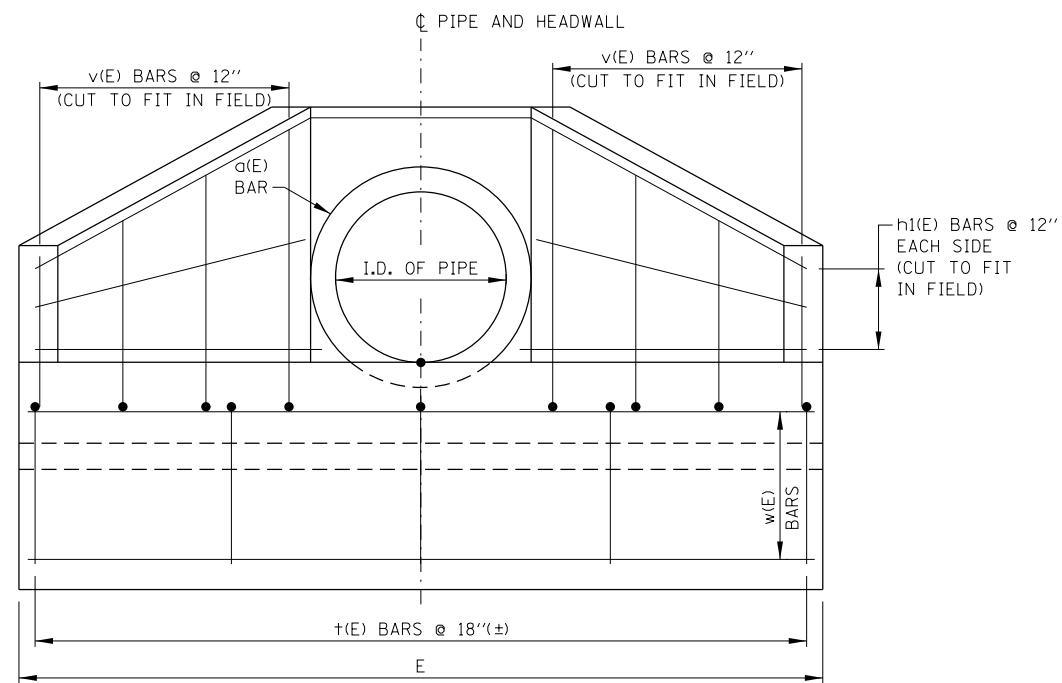


FRONT ELEVATION

- NOTES:**
- SLOPED HEADWALLS TYPES I AND II SHALL BE CONSTRUCTED FLUSH WITH EXISTING OR PROPOSED SLOPE.
 - CLASS SI CONCRETE SHALL BE USED THROUGHOUT.
 - ALL REINFORCEMENT BARS SHOWN SHALL BE EPOXY COATED (E).
 - BAR BENDING DETAILS ARE DIMENSIONED OUT TO OUT OF BARS.
 - ALL EXPOSED EDGES SHALL HAVE A 3/4"-45° CHAMFER. CHAMFER ON VERTICAL EDGES SHALL BE CONTINUED A MINIMUM OF ONE FOOT BELOW THE FINISHED GROUND LINE.
 - COVER FROM THE FACE OF CONCRETE TO FACE OF REINFORCEMENT BAR SHALL BE 3" FOR SURFACES FORMED AGAINST EARTH AND 2" FOR ALL OTHER SURFACES UNLESS OTHERWISE SHOWN.
 - CARE SHALL BE EXERCISED IN REMOVING ANY LENGTH OF EXISTING PIPE SO THE REMAINING PIPE IS UNDAMAGED AND FULLY FUNCTIONING.
 - ALL SLOPES ARE EXPRESSED AS UNITS OF VERTICAL DISPLACEMENT TO UNITS OF HORIZONTAL DISPLACEMENT.
 - TYPES I AND II HEADWALLS TO BE USED ONLY FOR SLOPES STEEPER THAN 1:3. DIMENSIONS AND QUANTITIES ARE BASES ON A SLOPE 1:2.
 - I.D. DENOTES INSIDE DIAMETER OF PIPE. O.D. DENOTES OUTSIDE DIAMETER OF PIPE.
 - FOR EROSION PROTECTION SEE STANDARD B19.

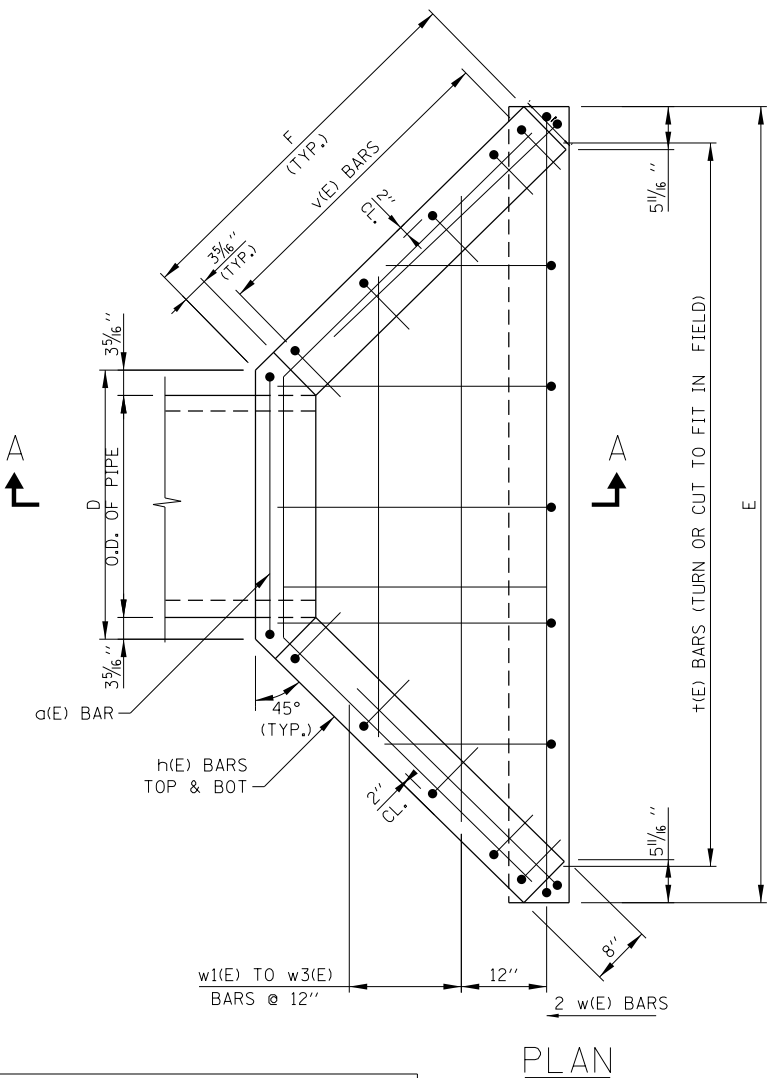

PLAN

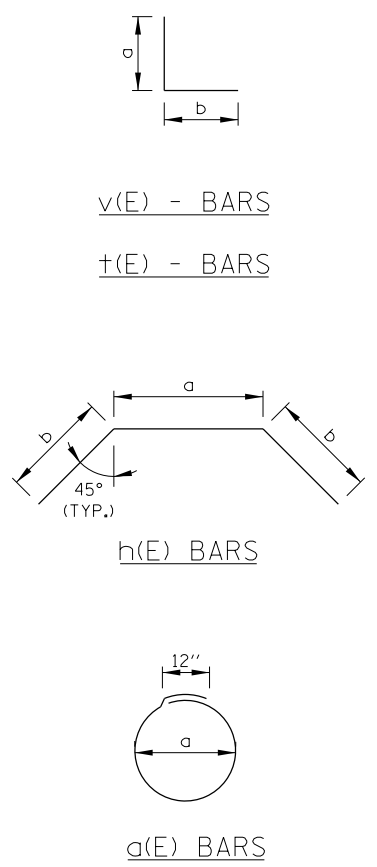

HEADWALL - TYPE I
(PIPE DIAMETER ≤ 36")

TABLE OF DIMENSIONS AND QUANTITIES FOR ONE HEADWALL

INSIDE DIA. OF PIPE	SLOPE OF FILL	DIMENSIONS						CONCRETE CLASS SI	REINF. BARS (POUND)
		A	B	C	D	E	F		
21"	1:3	4'-0"	1'-2"	2'-6"	2'-9 7/8"	11'-1 7/8"	5'-11 3/16"	1.6 C.Y.	75
24"	1:3	4'-3"	1'-4"	2'-9"	3'-0 5/8"	11'-11 3/8"	6'-3 3/16"	2.1 C.Y.	80
27"	1:3	4'-0"	1'-8"	3'-0"	3'-4 1/8"	11'-8 7/8"	5'-11 3/16"	2.0 C.Y.	100
30"	1:3	5'-0"	1'-7"	3'-3"	3'-7 5/8"	14'-0 3/8"	7'-4 3/16"	2.7 C.Y.	120
36"	1:3	6'-0"	1'-10"	3'-10"	4'-2 5/8"	16'-7 3/8"	8'-9 1/8"	3.6 C.Y.	145

TABLE OF REINFORCING STEEL FOR ONE HEADWALL

BAR MARK (E)	SIZE	21" I.D. PIPE				24" I.D. PIPE				27" I.D. PIPE				30" I.D. PIPE				36" I.D. PIPE			
		NO.	LENGTH	a	b	NO.	LENGTH	a	b	NO.	LENGTH	a	b	NO.	LENGTH	a	b	NO.	LENGTH	a	b
a	#4	1	9'-3"	31 1/2"	-	1	10'-2"	2'-11"	-	1	11'-1"	3'-2 1/2"	-	1	12'-0"	3'-6"	-	1	13'-10"	4'-1"	-
h	#4	2	8'-7"	2'-3"	3'-2"	2	10'-2"	2'-6"	3'-10"	2	11'-0"	2'-10"	4'-1"	2	9'-5"	3'-1"	3'-2"	2	11'-0"	3'-8"	4'-1"
h1	#4	4	3'-2"	-	-	4	3'-10"	-	-	4	4'-2"	-	-	5	4'-7"	-	-	6	5'-6"	-	-
v	#4	6	4'-0"	1'-0"	3'-0"	8	4'-3"	1'-0"	3'-3"	8	4'-6"	1'-0"	3'-6"	10	4'-9"	1'-0"	3'-9"	10	5'-4"	1'-0"	4'-4"
t	#4	6	4'-0"	1'-6"	2'-6"	6	4'-3"	1'-6"	2'-9"	6	4'-8"	1'-6"	3'-1"	7	4'-10"	1'-6"	3'-4"	8	5'-4"	1'-6"	3'-10"
w	#4	2	7'-7"	-	-	2	8'-6"	-	-	2	10'-1"	-	-	2	10'-0"	-	-	2	12'-0"	-	-
w1	#4	1	6'-0"	-	-	1	6'-11"	-	-	1	7'-11"	-	-	1	8'-7"	-	-	1	10'-6"	-	-
w2	#4	1	-	-	-	1	4'-11"	-	-	1	5'-11"	-	-	1	6'-7"	-	-	1	8'-6"	-	-
w3	#4	-	-	-	-	-	-	-	-	-	-	-	-	1	4'-7"	-	-	1	7'-6"	-	-

APPROVED: *Paul Kovacs* DATE: 2-7-2012
CHIEF ENGINEERING OFFICER




DATE	REVISIONS
3-01-2022	REVISED HEADWALL DIMENSIONS
3-11-2015	REVISED NOTES
2-07-2012	ADDED 21" AND 27" DIA PIPE AND REVISED TABLE QUANTITIES

HEADWALLS
TYPE I AND II


STANDARD B30-03

NOTE:


1. FOR ADDITIONAL NOTES SEE SHEET 1 IN THIS SERIES.

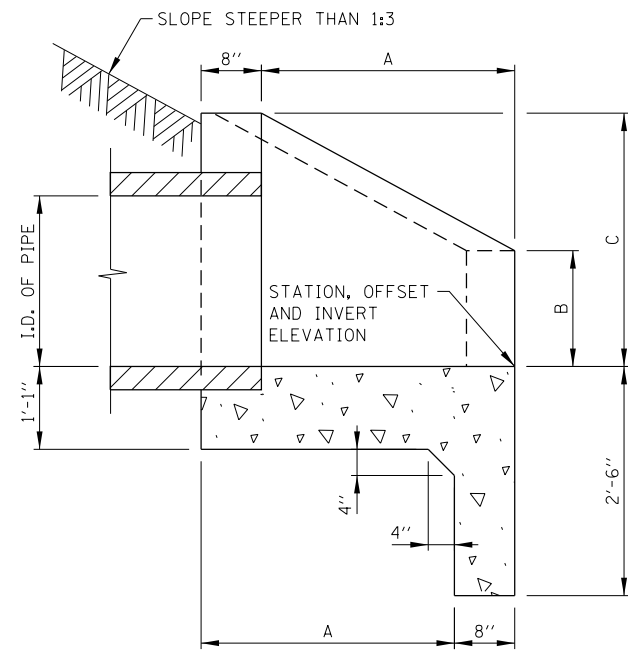


SECTION A-A
(DIMENSIONS)

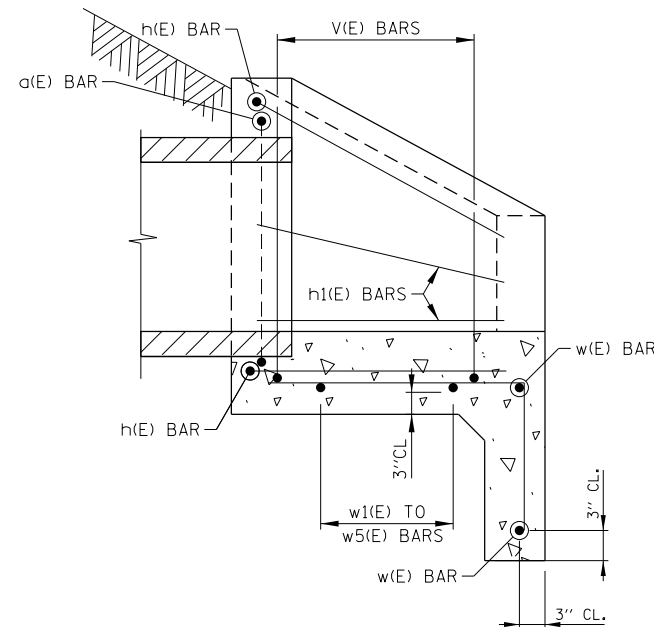


SECTION A-A
(REINFORCEMENT)

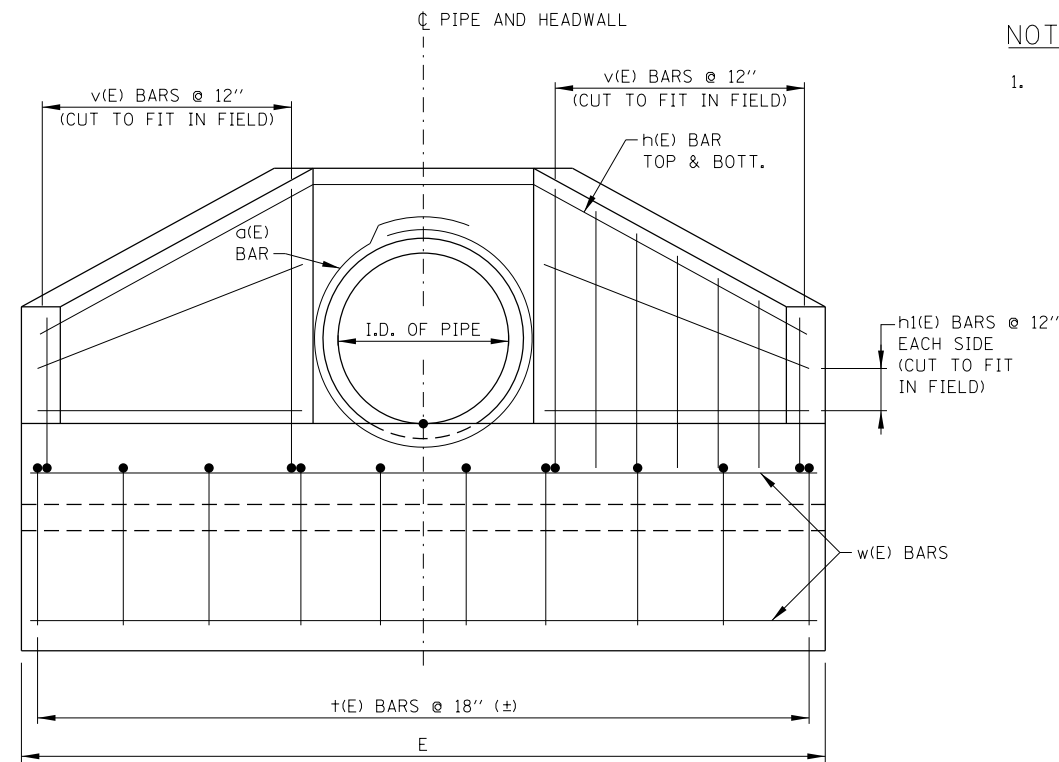

FRONT ELEVATION

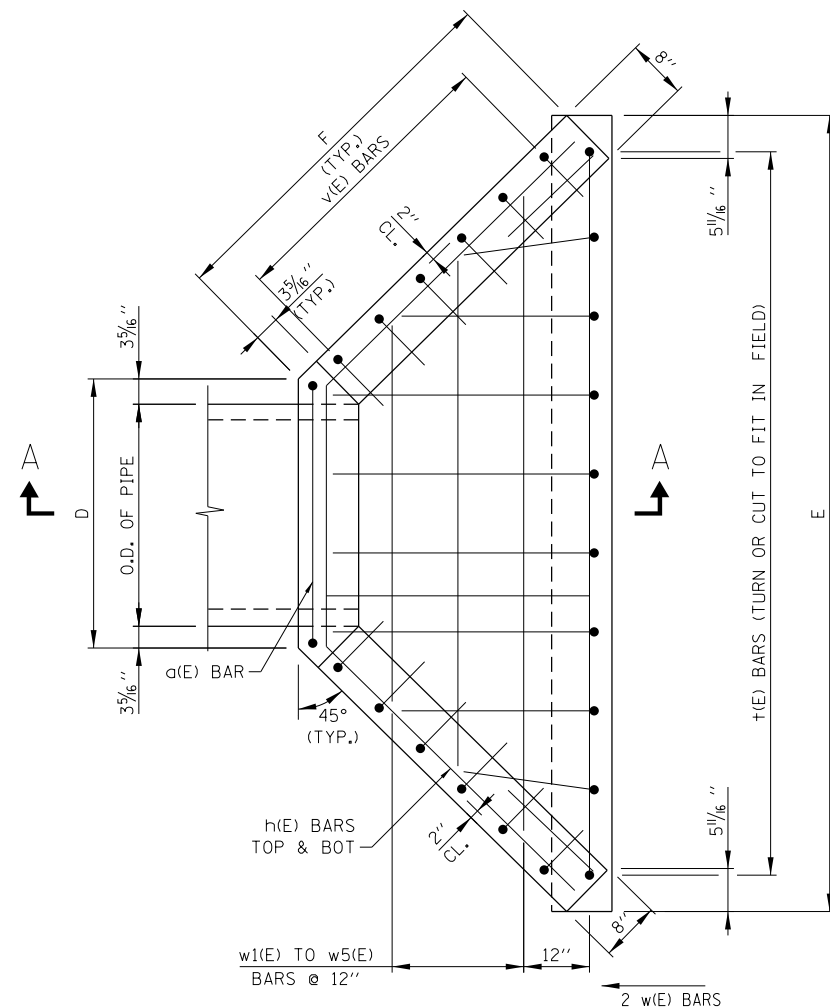

PLAN

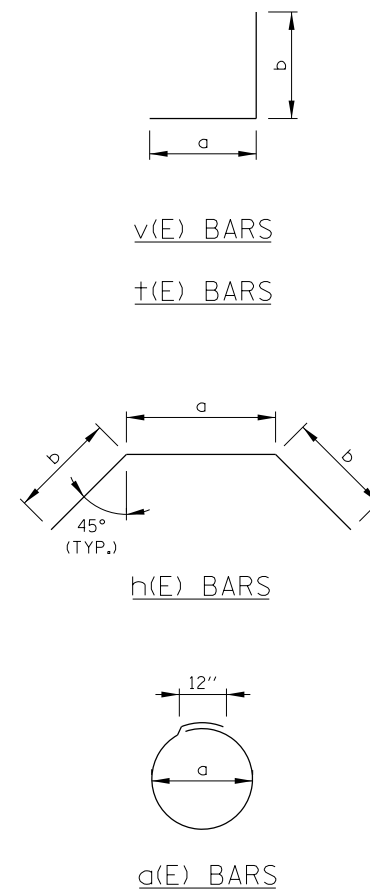

HEADWALL - TYPE II
(PIPE DIAMETER ≥ 36")


TABLE OF BARS FOR ONE HEADWALL

BAR MARK (E)	SIZE	42" PIPE				48" PIPE				54" I.D. PIPE				60" I.D. PIPE			
		NO.	LENGTH	a	b	NO.	LENGTH	a	b	NO.	LENGTH	a	b	NO.	LENGTH	a	b
a	#5	2	15'-11"	4'-9"	-	2	17'-9"	5'-4"	-	2	19'-7"	5'-11"	-	2	21'-5"	6'-6"	-
h	#5	2	17'-7"	5'-3"	6'-2"	2	19'-9"	5'-9"	7'-0"	2	22'-0"	6'-4"	7'-10"	2	24'-1"	6'-9"	8'-8"
h1	#5	8	6'-6"	-	-	10	7'-4"	-	-	10	8'-2"	-	-	12	9'-0"	-	-
t	#5	10	6'-1"	1'-6"	4'-7"	11	6'-8"	1'-6"	5'-2"	13	7'-3"	1'-6"	5'-9"	15	7'-10"	1'-6"	6'-4"
v	#5	14	5'-10"	1'-0"	4'-10"	16	6'-6"	1'-0"	5'-6"	16	7'-1"	1'-0"	6'-1"	18	7'-8"	1'-0"	6'-8"
w	#5	2	14'-3"	-	-	2	15'-10"	-	-	2	17'-8"	-	-	2	18'-10"	-	-
w1	#5	1	12'-0"	-	-	1	13'-8"	-	-	1	15'-2"	-	-	1	16'-10"	-	-
w2	#5	1	10'-0"	-	-	1	11'-8"	-	-	1	13'-4"	-	-	1	15'-0"	-	-
w3	#5	1	8'-0"	-	-	1	9'-8"	-	-	1	11'-6"	-	-	1	13'-2"	-	-
w4	#5	-	-	-	-	1	8'-0"	-	-	1	9'-8"	-	-	1	11'-4"	-	-
w5	#5	-	-	-	-	-	-	-	-	-	7'-8"	-	-	1	9'-6"	-	-

TABLE OF DIMENSIONS AND QUANTITIES FOR ONE HEADWALL


INSIDE DIA. OF PIPE	SLOPE OF FILL	DIMENSIONS						CONCRETE CLASS SI	REINF. BARS (POUND)
		A	B	C	D	E	F		
42"	1:3	6'-7 1/2"	2'-2"	4'-4 1/2"	4'-9 5/8"	18'-5 3/8"	9'-7 3/4"	3.8 C.Y.	400
48"	1:3	7'-6"	2'-5"	4'-11"	5'-4 5/8"	20'-9 3/8"	10'-10 3/16"	4.1 C.Y.	450
54"	1:3	8'-4 1/2"	2'-8"	5'-5 1/2"	5'-11 5/8"	23'-1 3/8"	12'-1 1/16"	5.6 C.Y.	500
60"	1:3	9'-3"	2'-11"	6'-0"	6'-6 5/8"	25'-5 3/8"	13'-4 5/16"	6.5 C.Y.	600



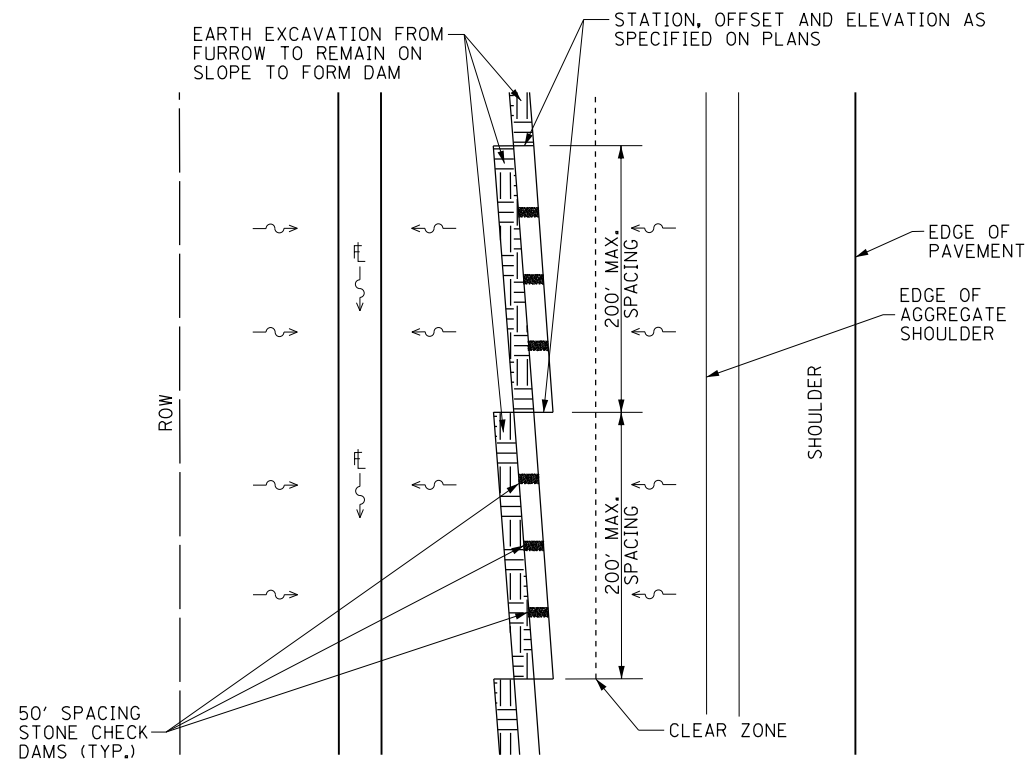




DEFINED CLEAR ZONE LOCATIONS

PLAN VIEW: NOT TO SCALE

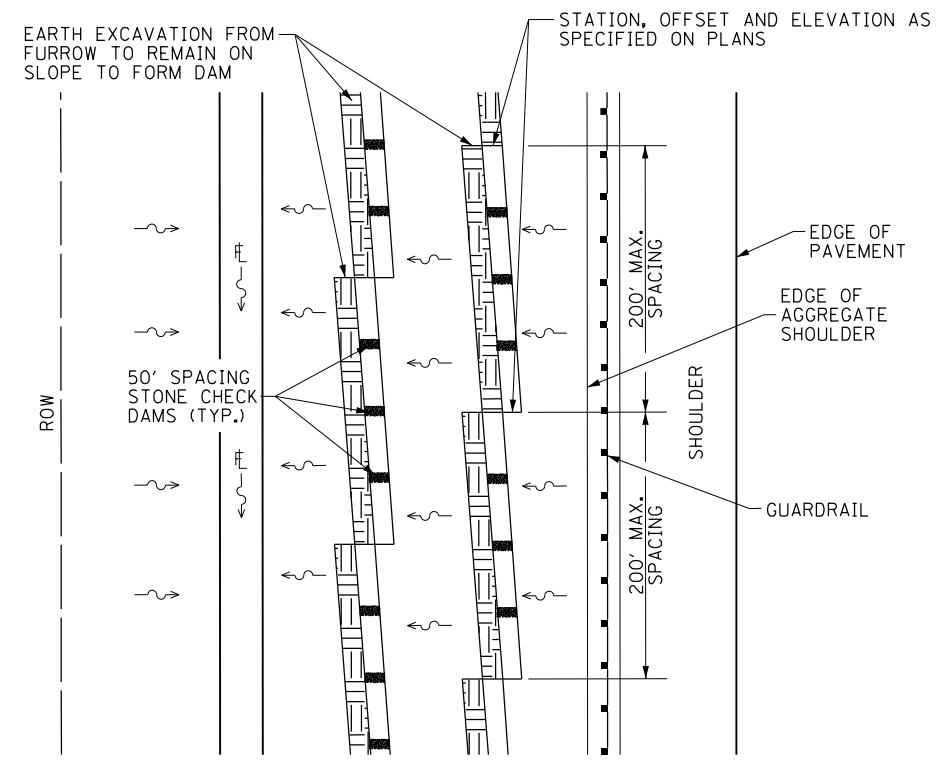

SHIELDED LOCATIONS

PLAN VIEW: NOT TO SCALE

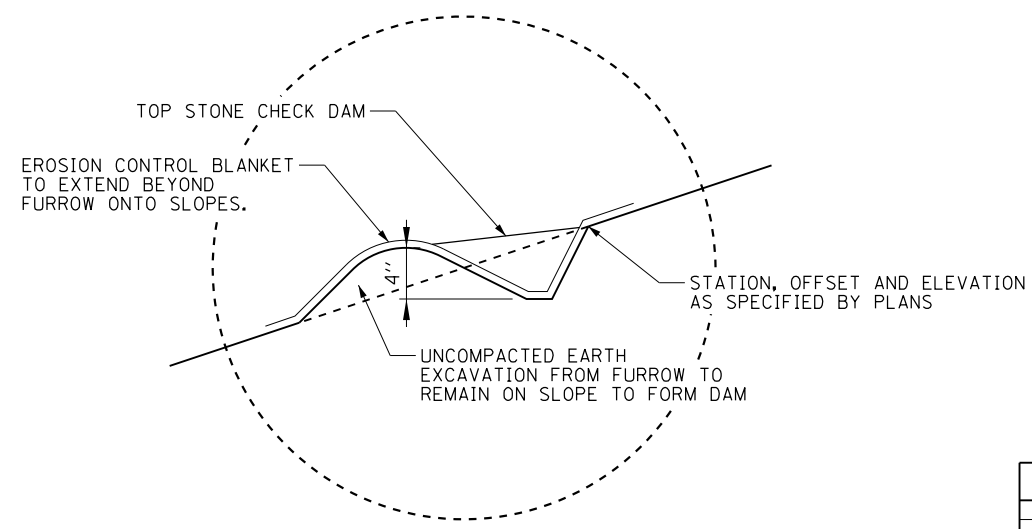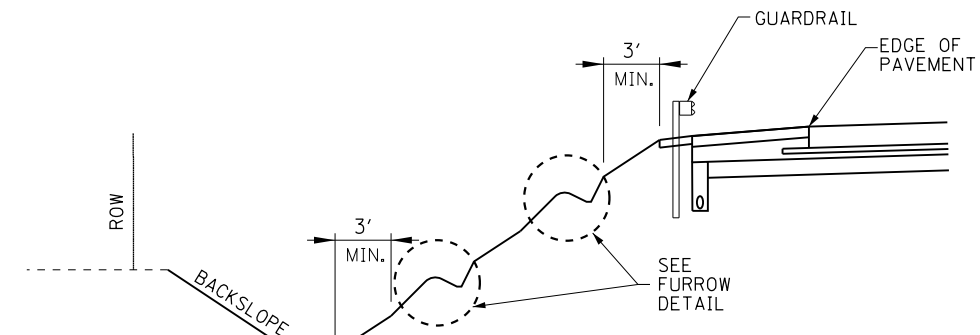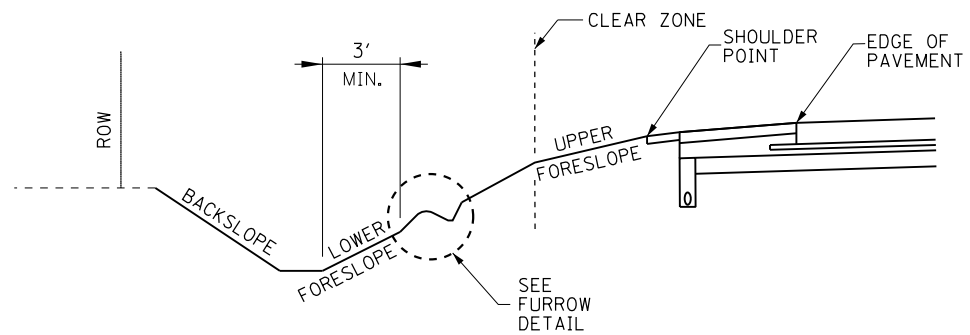

FURROW DETAIL
SECTION VIEW: NOT TO SCALE

NOTES:

1. INSTALL STONE CHECK DAMS AT 50' SPACING ALONG FURROW. STONE CHECK DAMS TO CONSIST OF CA-7 STONE, 2' LONG, FILLED TO FULL DEPTH OF FURROW
2. FURROW TO BE SLICED/TILLED ALONG LEVEL CONTOUR BEGINNING.
3. FURROWS SHALL NOT BE INSTALLED IN UNSHIELDED, UNDEFINED CLEAR ZONE LOCATIONS.


APPROVED: *Paul Kovacs* CHIEF ENGINEER DATE 3-31-2016

DATE	REVISIONS


Illinois Tollway

FURROW DETAIL


STANDARD B31-00

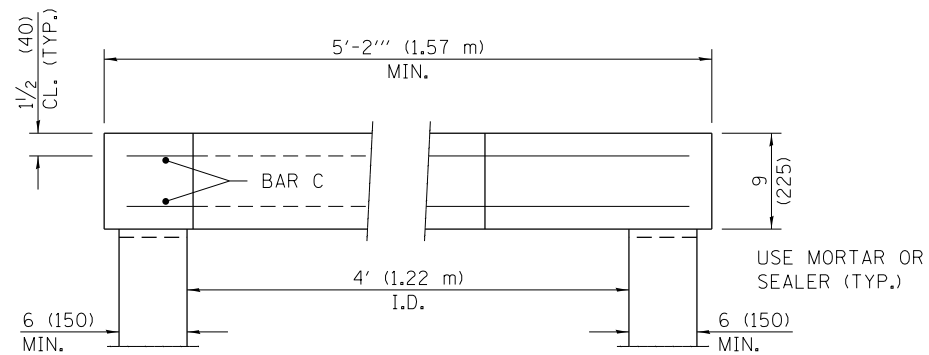

SECTION A-A

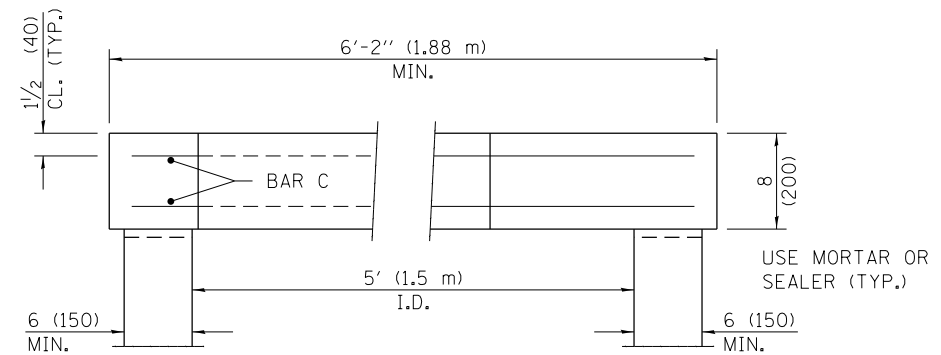


SECTION B-B

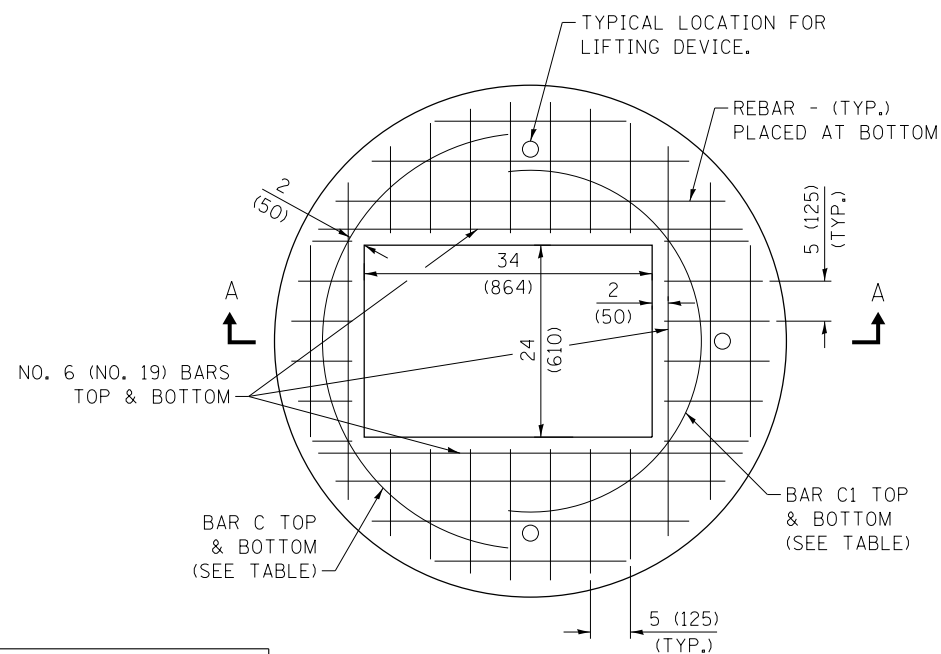

4' MANHOLE PLAN
SHOWING REBAR REINFORCEMENT
NO. 6 (NO. 19) UNLESS OTHERWISE SHOWN

NO. 4 (NO. 13)		
BAR	LENGTH	RADIUS
C	6'-6" (1.98 m)	26 (660)
C1	6'-6" (1.98 m)	22 (59)

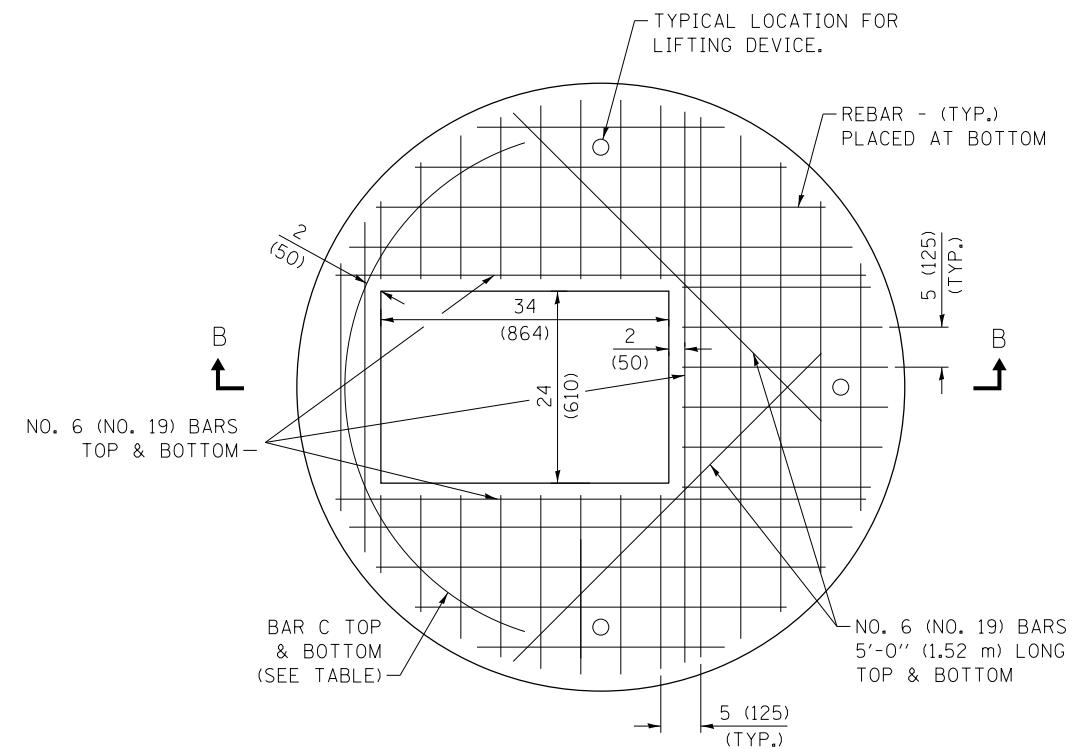

5' MANHOLE PLAN
SHOWING REBAR REINFORCEMENT
NO. 6 (NO. 19) UNLESS OTHERWISE SHOWN

NO. 4 (NO. 13) BAR C	
LENGTH	RADIUS
7'-0" (2.13 m)	32 (813)




FLAT SLAB TOP
4'-5'-6'-7'-8'-9'
DIAMETER


STANDARD B32-01

DATE	REVISIONS
3-01-2022	REVISED SLAB THICKNESS AND REBAR SPACING


APPROVED *Paul Kovacs* DATE 3-31-2017
CHIEF ENGINEERING OFFICER

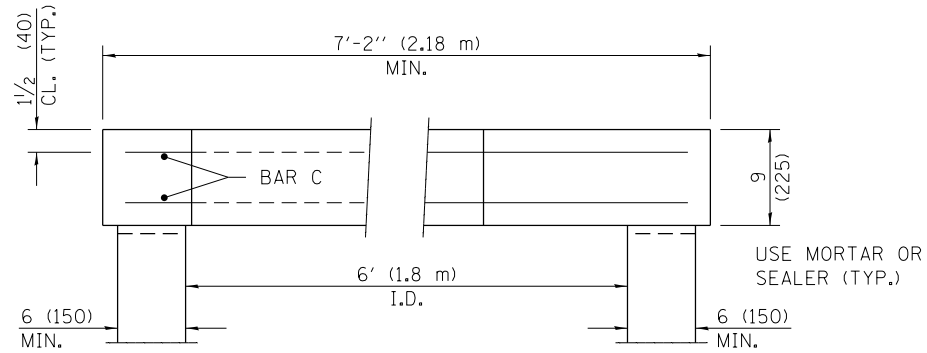

SECTION A-A

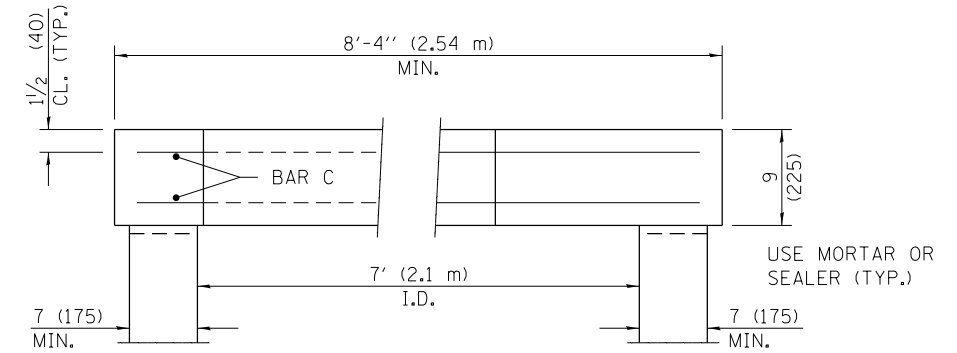


SECTION B-B

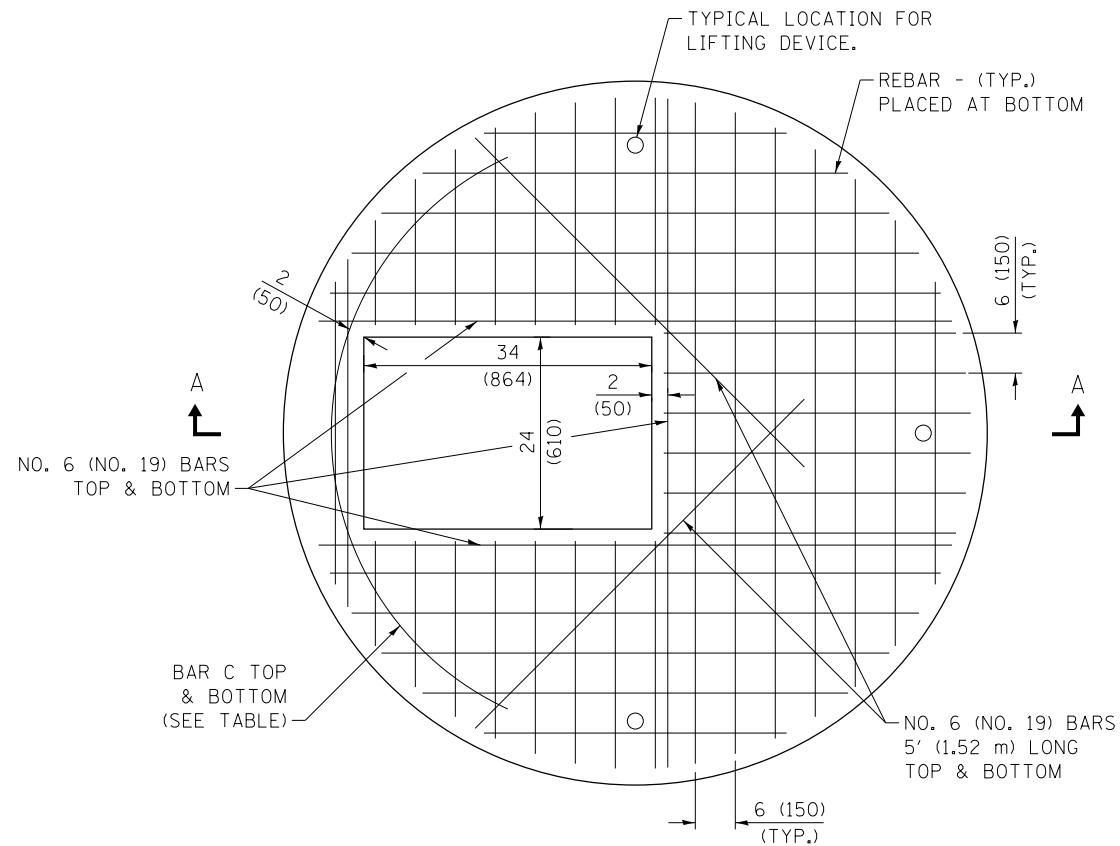

6' MANHOLE PLAN
SHOWING REBAR REINFORCEMENT
NO. 6 (NO. 19) UNLESS OTHERWISE SHOWN

NO. 4 (NO. 13) BAR C	
LENGTH	RADIUS
7'-6" (2.29 m)	38 (965)

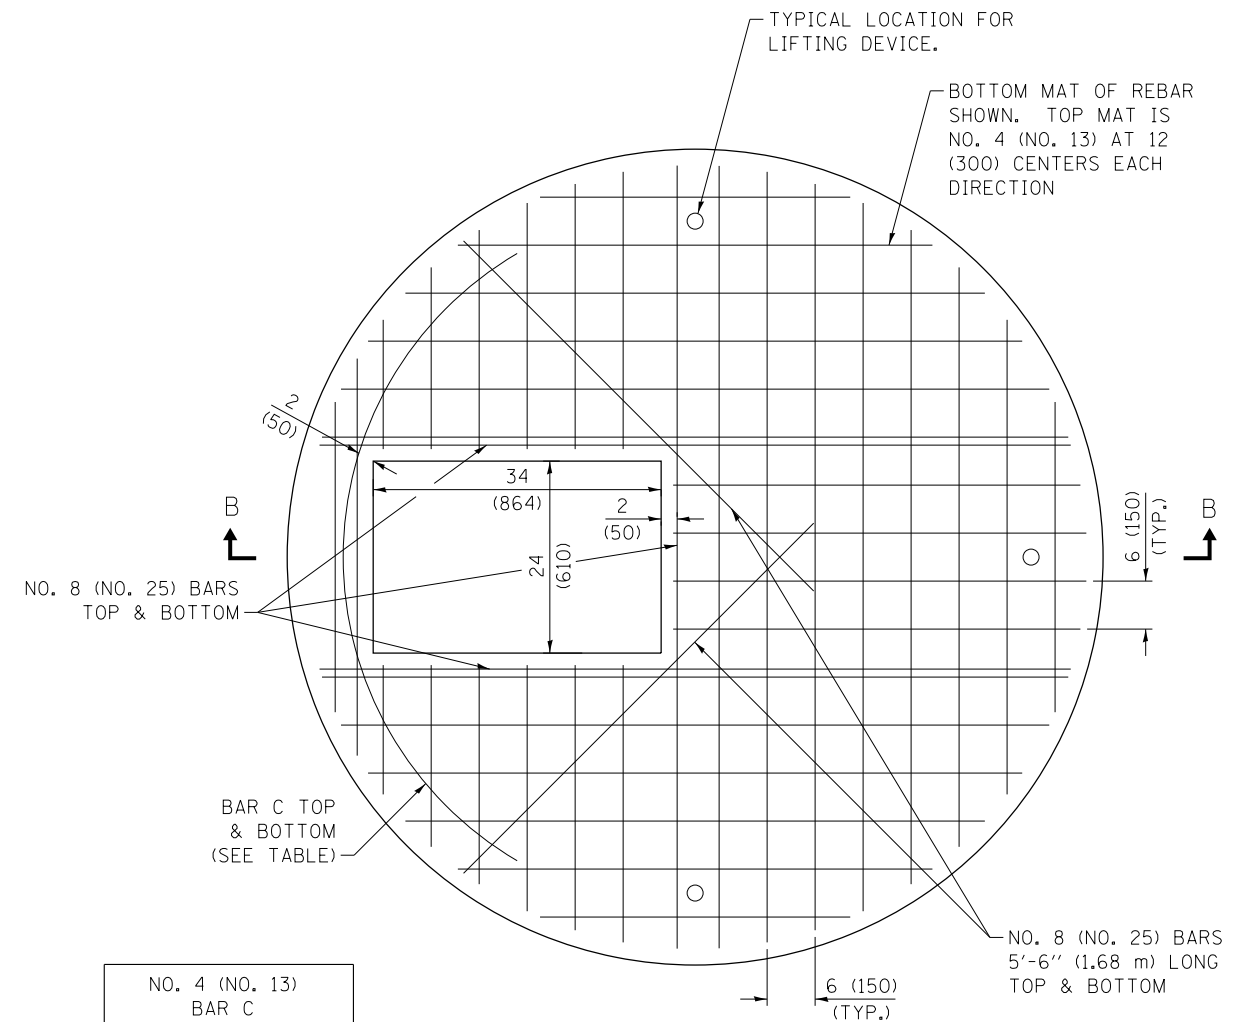

7' MANHOLE PLAN
SHOWING REBAR REINFORCEMENT
NO. 8 (NO. 25) UNLESS OTHERWISE SHOWN


NO. 4 (NO. 13) BAR C	
LENGTH	RADIUS
8'-0" (2.44 m)	3'-8" (1.12 m)




FLAT SLAB TOP
4'-5'-6'-7'-8'-9'
DIAMETER

STANDARD B32-01


APPROVED *Paul Kovacs* DATE 3-31-2017
CHIEF ENGINEERING OFFICER

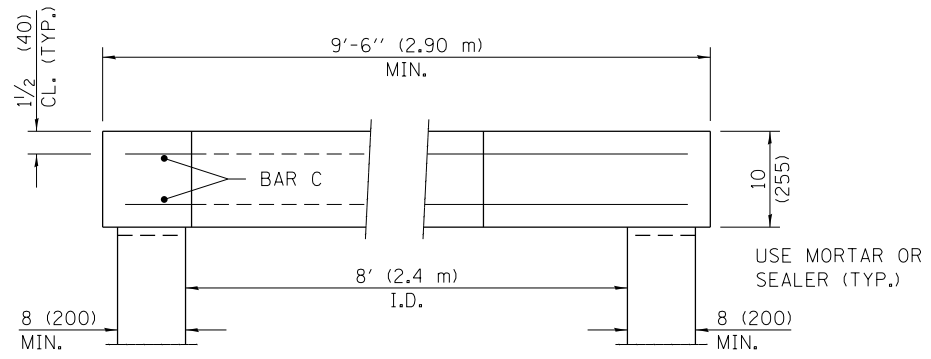

SECTION A-A

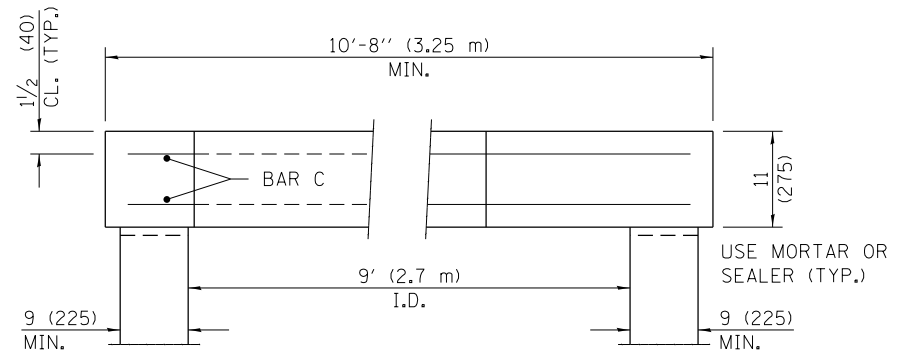


SECTION B-B

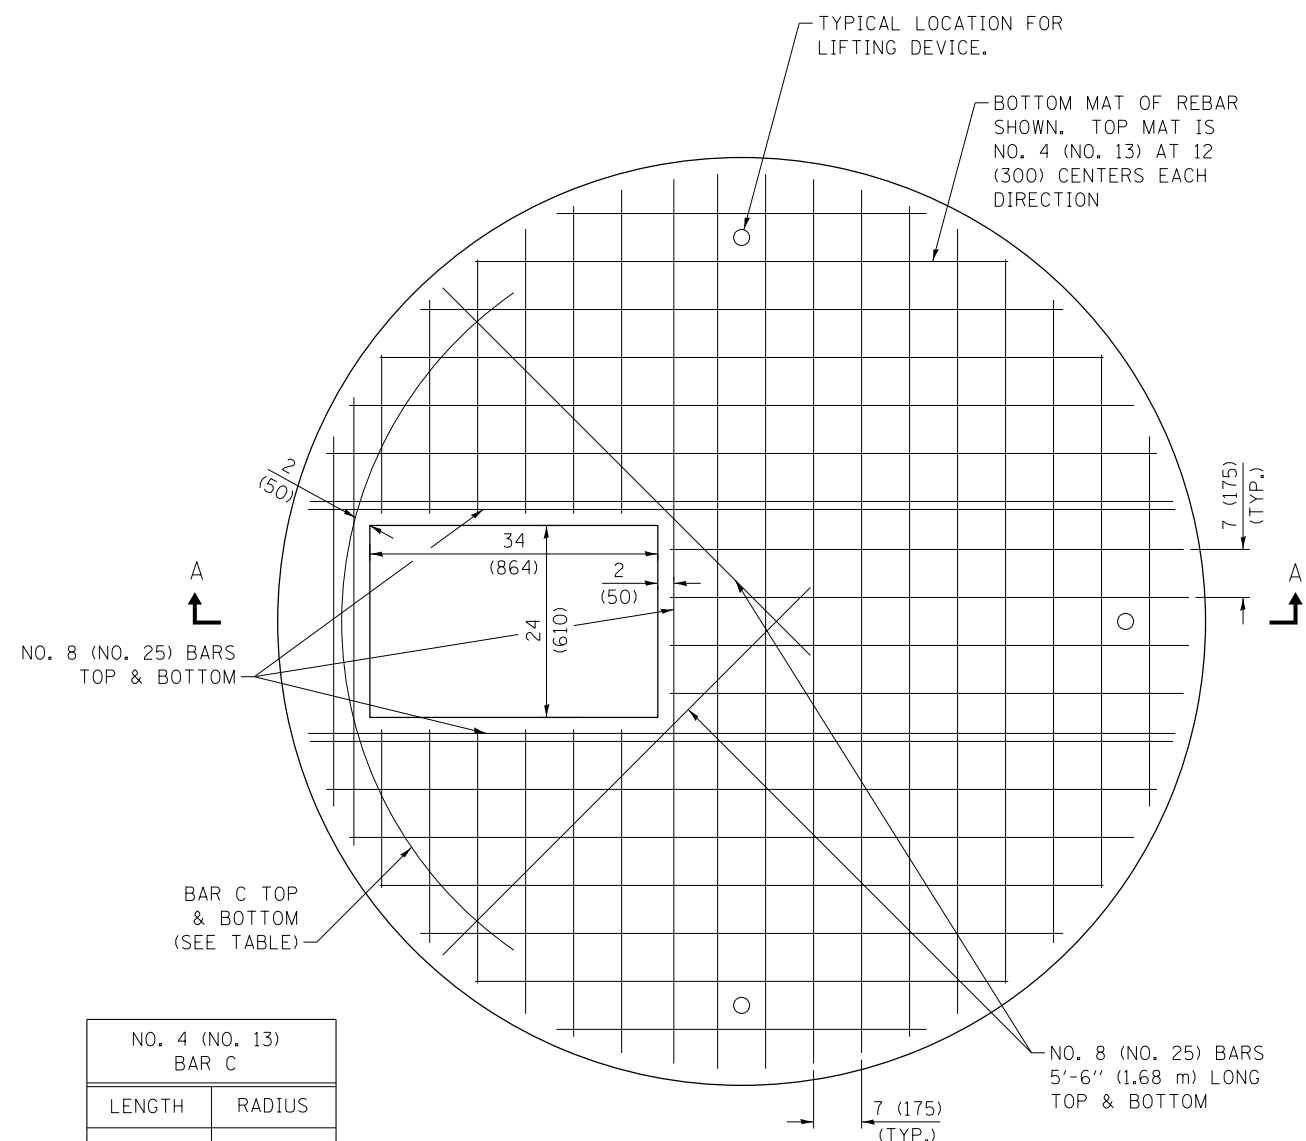

8' MANHOLE PLAN
SHOWING REBAR REINFORCEMENT
NO. 8 (NO. 25) UNLESS OTHERWISE SHOWN

NO. 4 (NO. 13) BAR C	
LENGTH	RADIUS
8'-6" (2.59 m)	4'-2" (1.27 m)

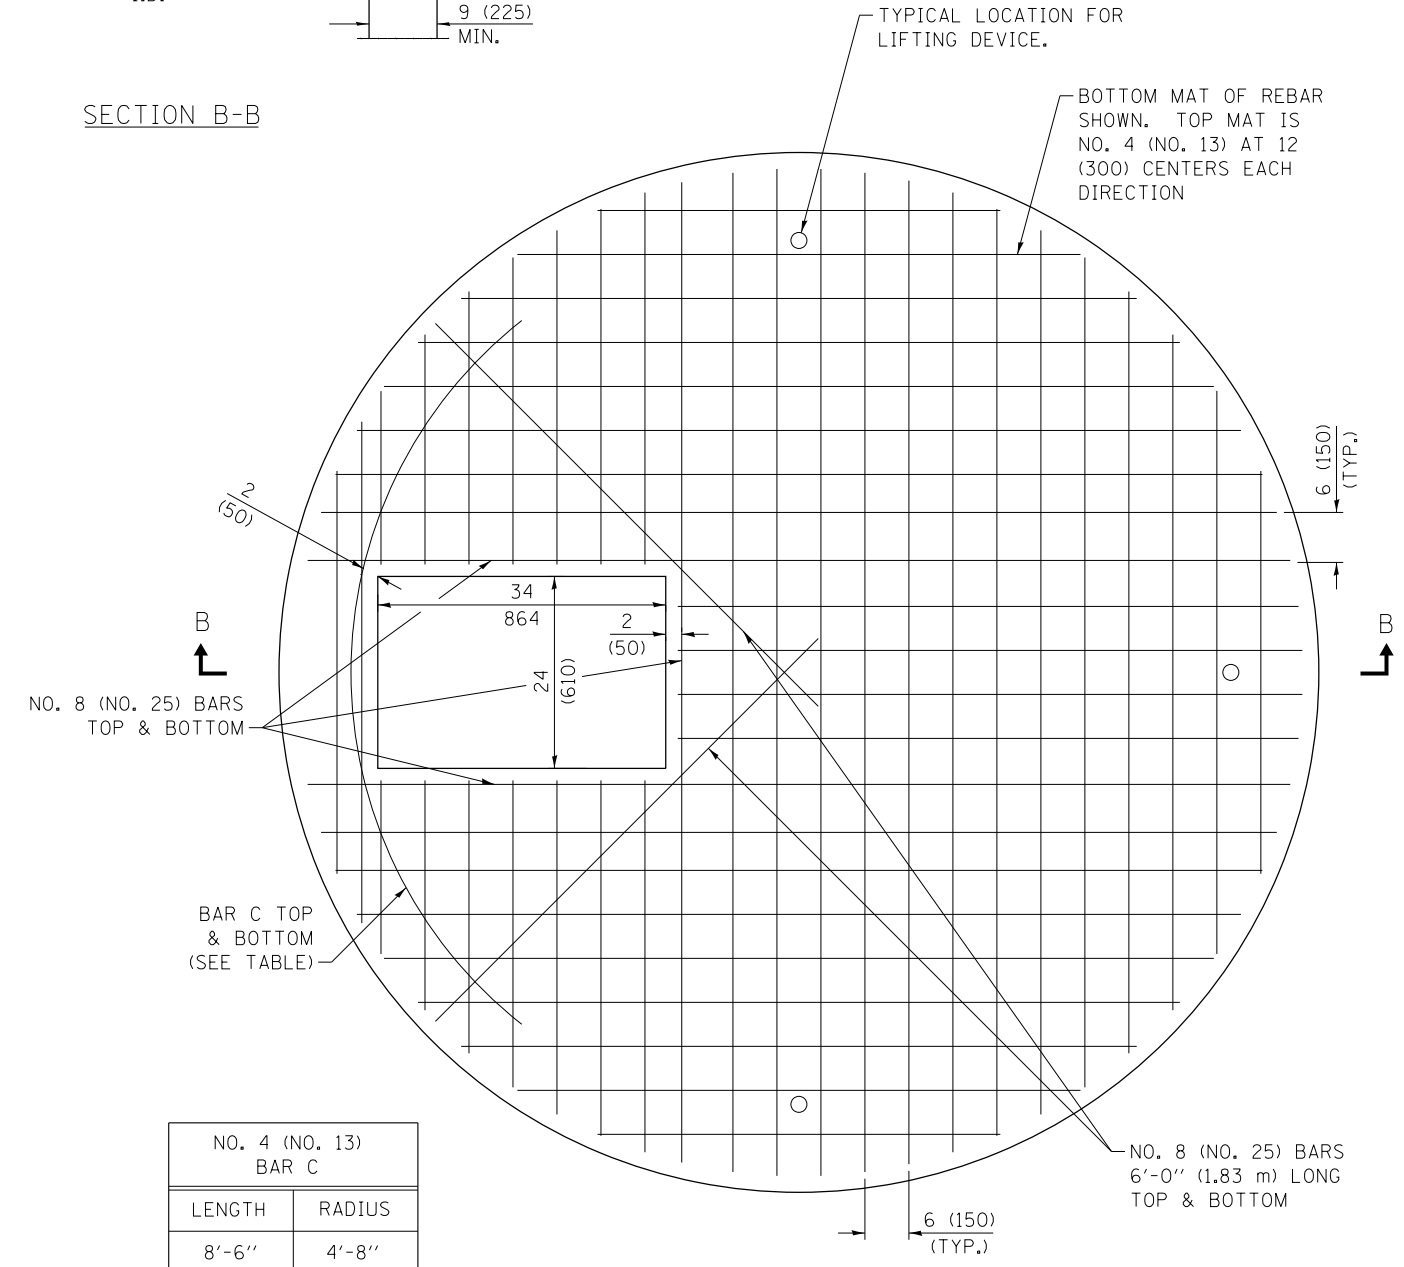

9' MANHOLE PLAN
SHOWING REBAR REINFORCEMENT
NO. 8 (NO. 25) UNLESS OTHERWISE SHOWN

NO. 4 (NO. 13) BAR C	
LENGTH	RADIUS
8'-6" (2.59 m)	4'-8" (1.42 m)

APPROVED *Paul Kovacs* DATE 3-31-2017
CHIEF ENGINEERING OFFICER

SHEET 3 OF 3

FLAT SLAB TOP
4'-5'-6'-7'-8'-9'
DIAMETER

STANDARD B32-01